

STATE OF Alabama)
COUNTY OF Shelby)

140 6010 0170 08 0032 700
Riverchase, Country Club, 1st Add. 2nd Add.
Valleydale Sub.

383374

KNOW ALL MEN BY THESE PRESENTS, that the undersigned,

B. L. HAYLEY AND WIFE, LANO A. HAYLEY

for and in consideration of the sum of One and No/100 Dollars (\$1.00), to

us in hand paid by Alabama Power Company, a corporation, the receipt

whereof is acknowledged, do hereby grant to said Alabama Power Company,

its successors and assigns, the right to construct, install, operate and maintain,

and the right to permit other corporations and persons to construct, install,

operate and maintain, along a route to be selected by the grantee, (generally shown

crosshatched on the attached drawing) its successors and assigns, all conduits,

cables, translosures and other appliances and facilities useful or necessary in

connection therewith, for the underground transmission and distribution of electric

power and for underground communication service, upon, under and across the following

described land situated in Shelby County, Alabama:

7N Lot #23 of Riverchase Country Club, 2nd Addition as recorded in Map Book
92N 6, Page 145 in the Probate Office of Shelby County, Alabama.

THIS INSTRUMENT WAS PREPARED BY:
NAME R.C. COGGIN, CORP. REAL EST.
ADDRESS ALA. POWER CO. - BIHAM
SOURCE OF TITLE
BOOK PAGE
SUBDIVISION LOT PLAT BK PAGE
QQ Q S T R

19780502000052260 1/5 \$.00
Shelby Cnty Judge of Probate, AL
05/02/1978 12:00:00AM FILED/CERT

BOOK 311 PAGE 827

Together with all the rights and privileges necessary or convenient for the full enjoyment or use thereof, including the right of ingress and egress to and from said facilities and the right to excavate for installation, replacement, repair and removal thereof; and also the right to cut and keep clear all trees, underbrush, shrubbery, roots and other growth, and to keep clear any and all obstructions or obstacles of whatever character on, under or above said facilities.

TO HAVE AND TO HOLD the same to the said Company, its successors and assigns, forever.

IN WITNESS WHEREOF, we have hereunto set our hands and seals, this the 11 day of FEB, 19 78.

WITNESS:

B. L. Hayley (Seal)
Lans G. Hayley (Seal)



19780502000052260 2/5 \$.00
Shelby Cnty Judge of Probate, AL
05/02/1978 12:00:00AM FILED/CERT

STATE OF ALABAMA)


COUNTY OF SHELBY)

I, DAVID R. GRESHAM, a Notary Public, in and
for said County in said State, hereby certify that B. L. HAYLEY AND
WIFE, LINDA A. HAYLEY
whose names ARE signed to the foregoing instrument and who ARE
known to me, acknowledged before me on this day that being informed of the
contents of the instrument THEY executed the same voluntarily, on the
day the same bears date.

Given under my hand and official seal, this the 11 day of
FEB, 1978.


David R. Gresham

NOTARY PUBLIC STATE AT LARGE

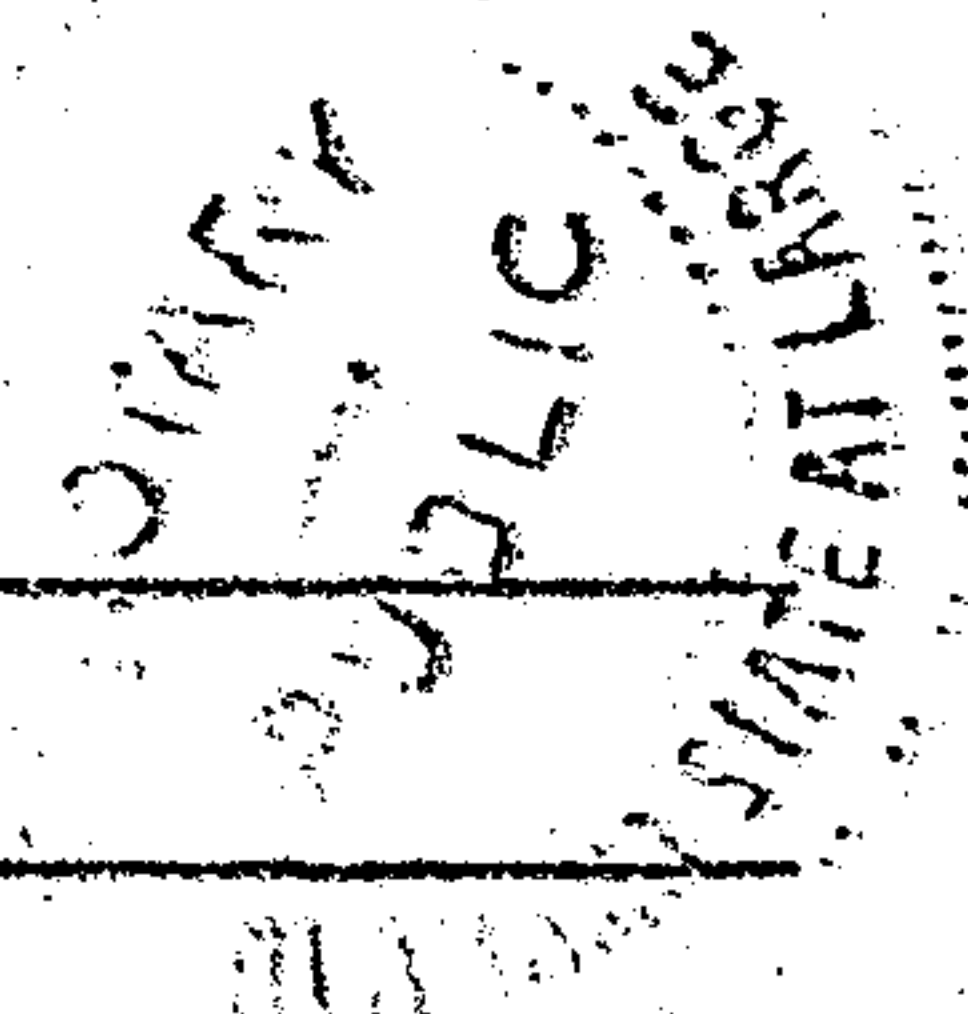


19780502000052260 3/5 \$.00
Shelby Cnty Judge of Probate, AL
05/02/1978 12:00:00AM FILED/CERT



BOOK 311 PAGE 828

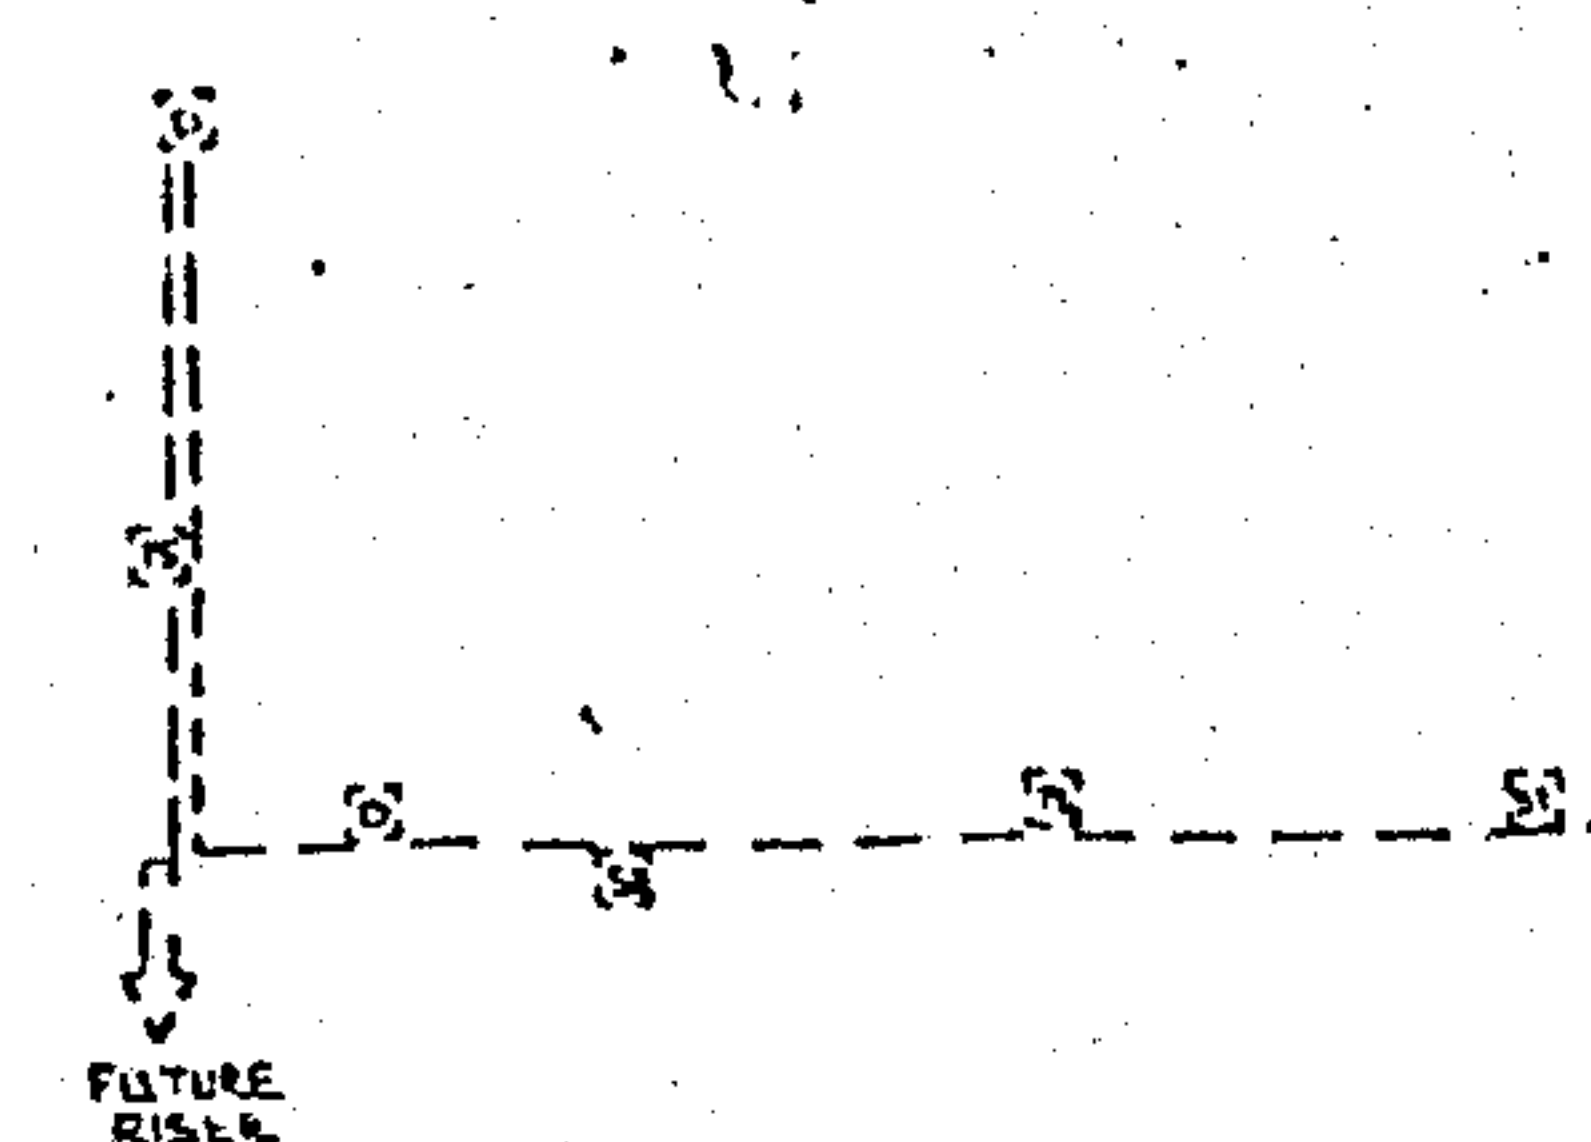

BOOK 311 PAGE 829

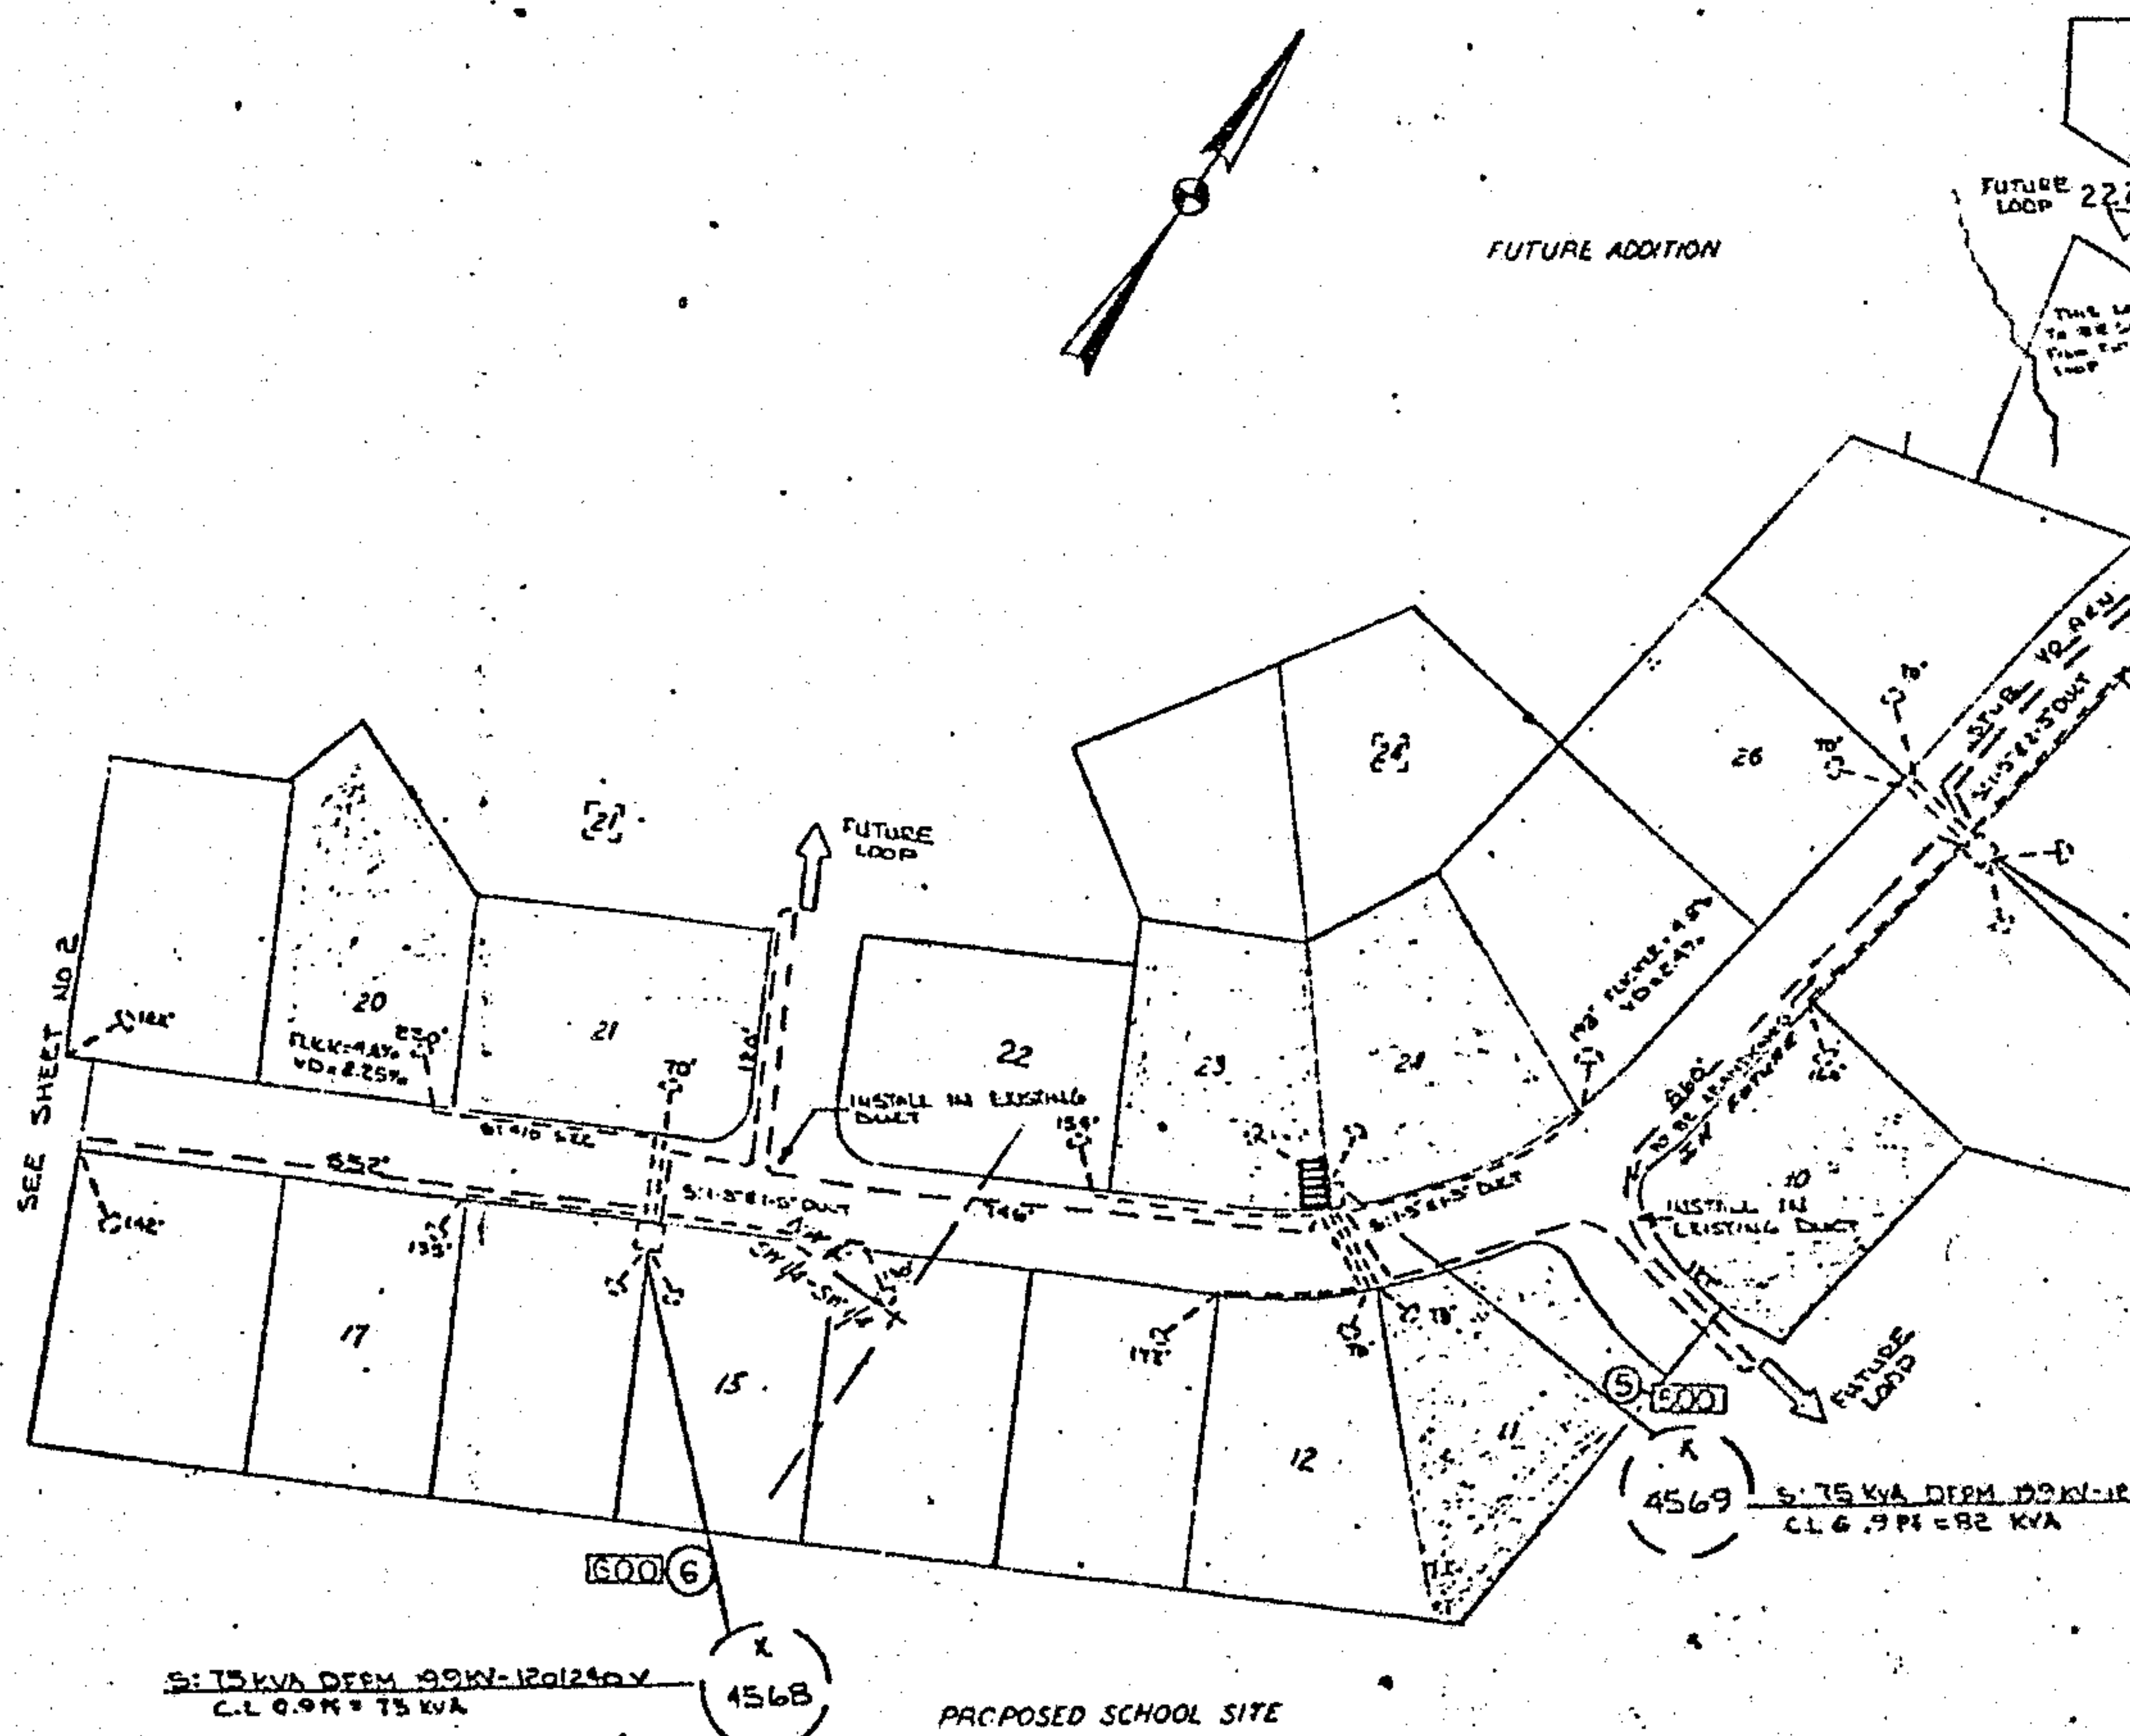

19780502000052260 4/5 \$.00
Shelby Cnty Judge of Probate, AL
05/02/1978 12:00:00AM FILED/CERT

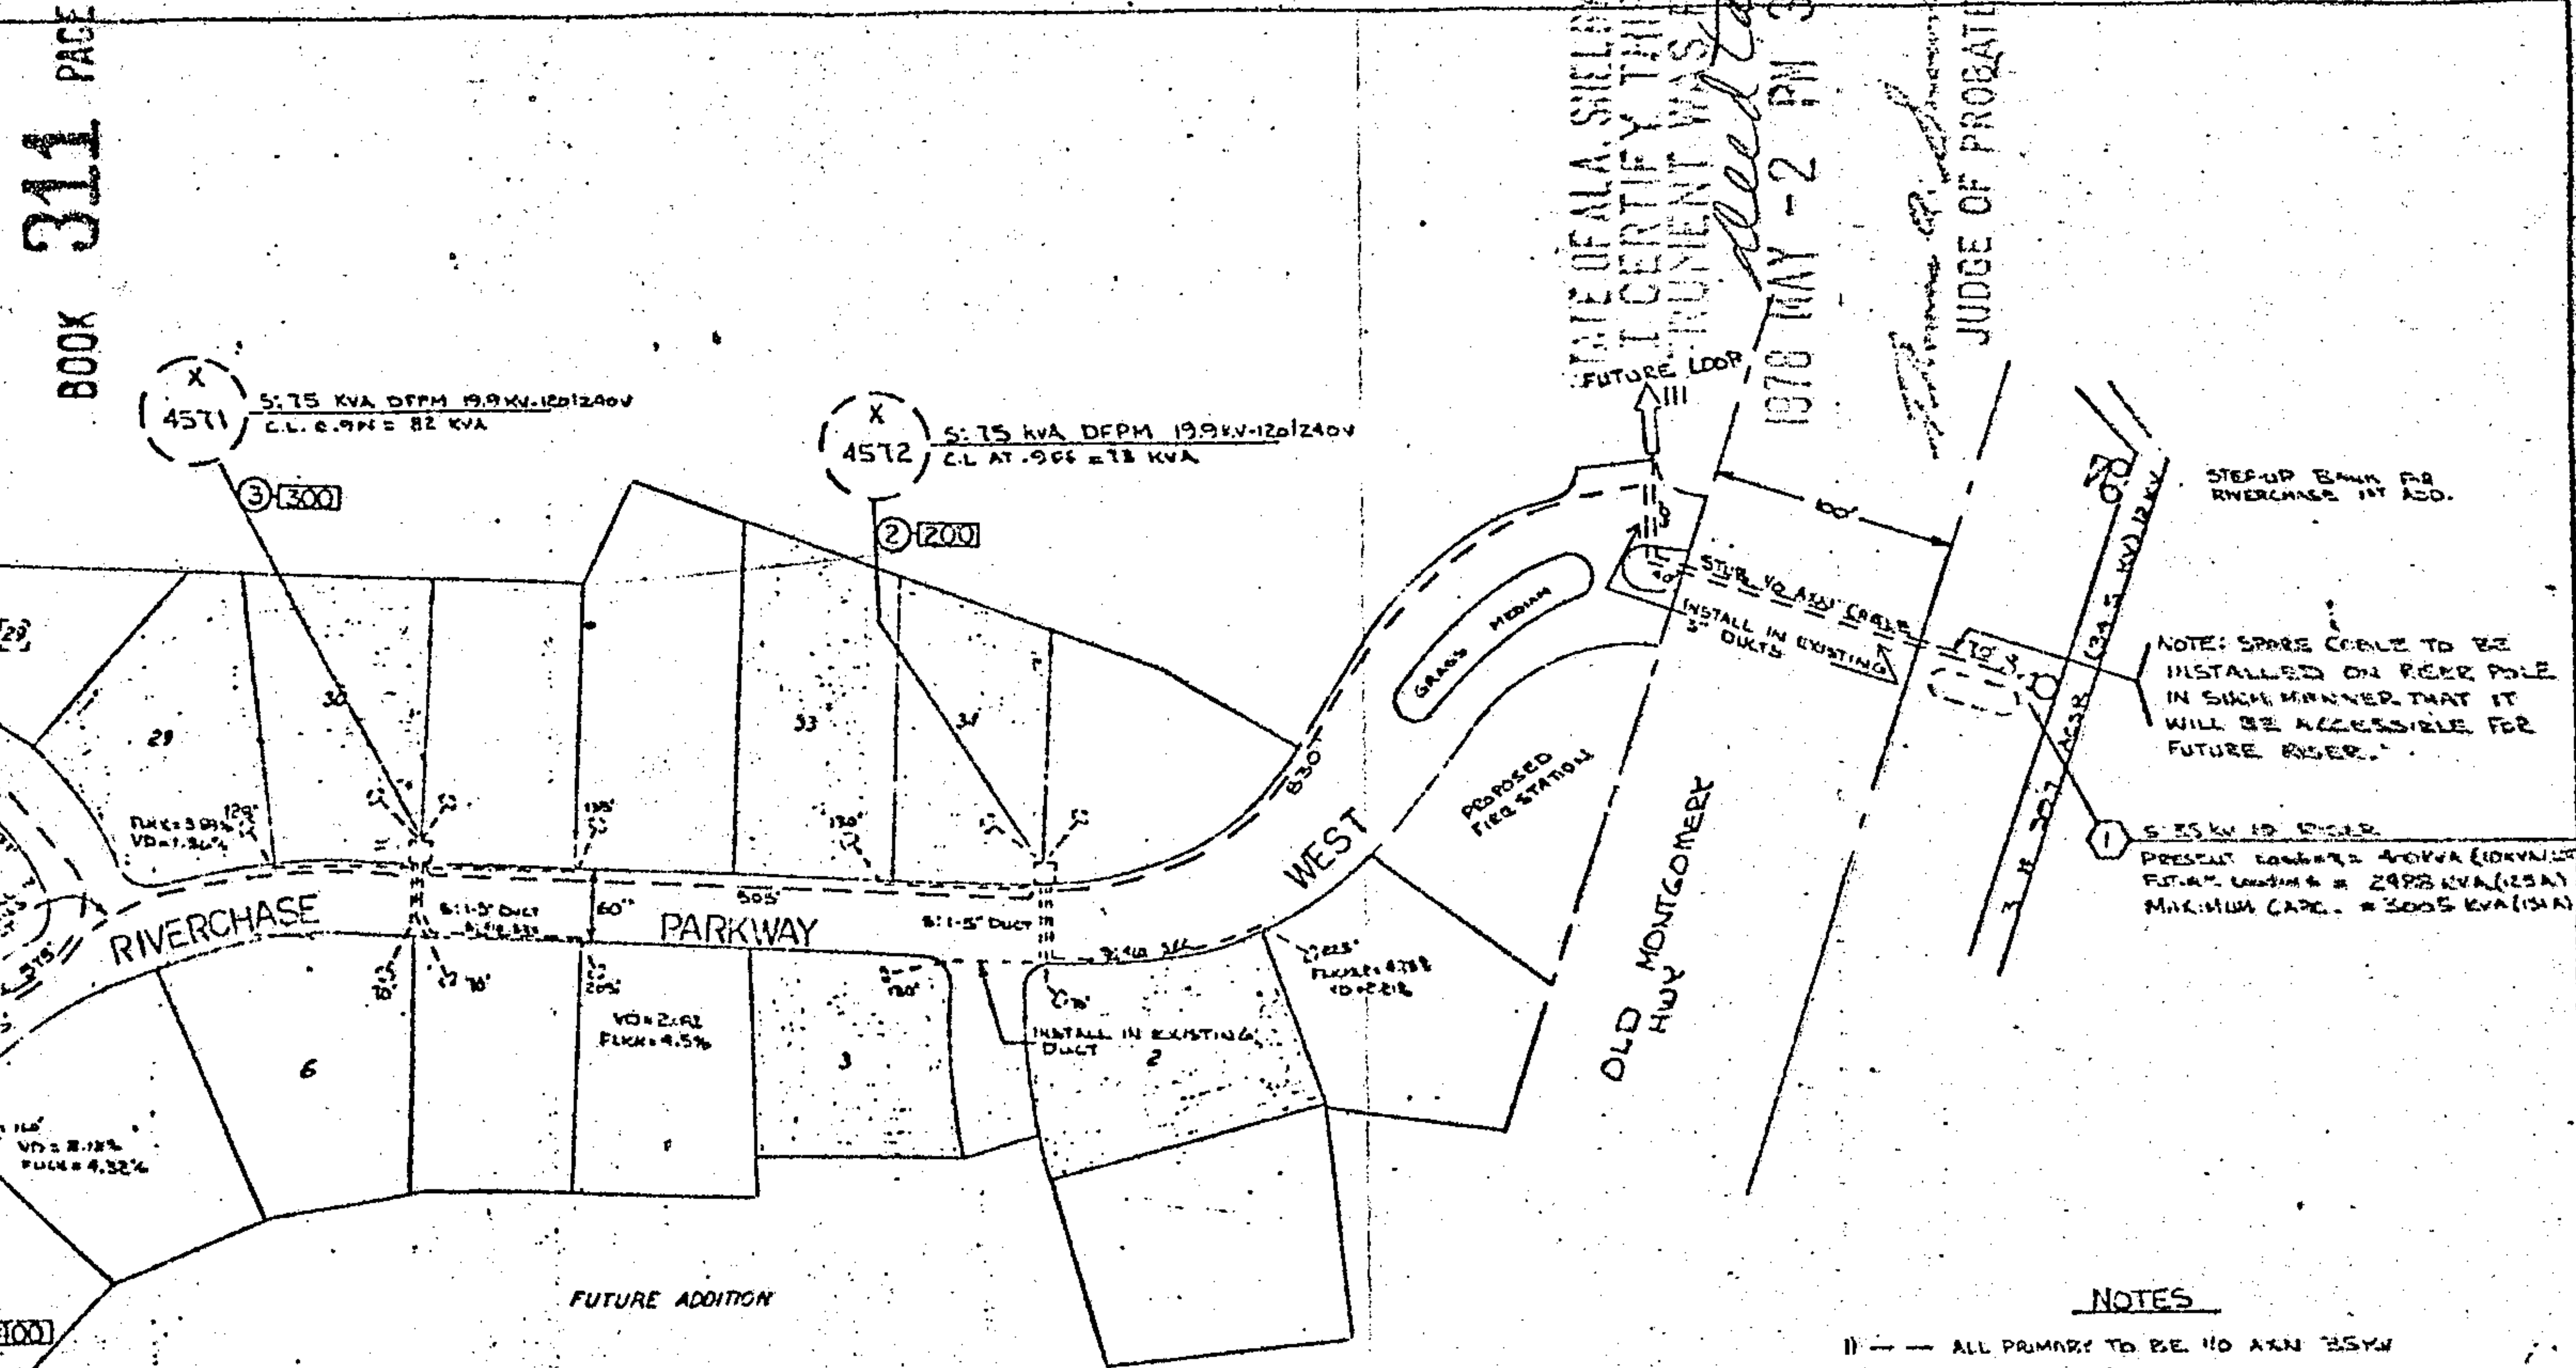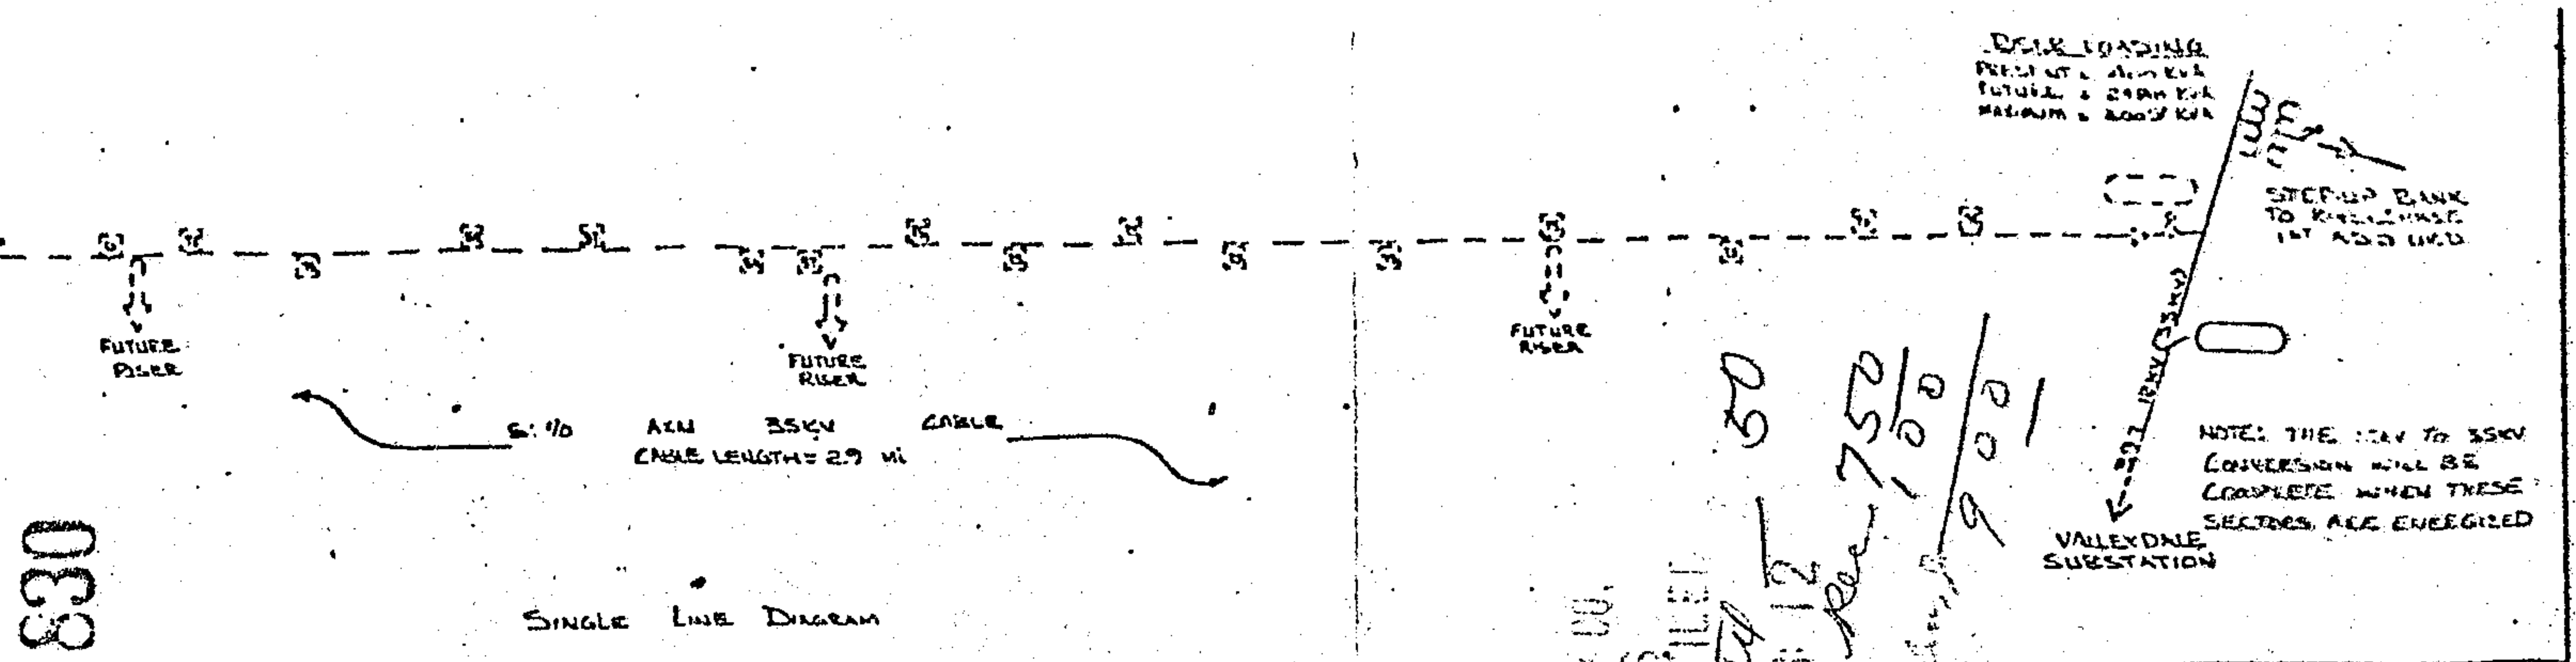

- LEGEND**
- ④ - TRANSFORMER LOCATION NO.
 - ③② - SECONDARY LOCATION NO.
- NOTE: ALL METERS, SERVICES, SECONDARY BILS, STREET CROSSINGS, CONDUIT AND "3" TRENCHING ARE RELATED TO THESE TYPICAL NUMBERS...
- NOTES**
- 1) -- ALL PRIMARY TO BE 110 ACN 35KV
 - 2) -- ALL SECONDARY 1070/2070/01V UNLESS NOTED
 - 3) TRANSFORMER LOADING BASED ON M.D. 0.75 MVA
 - 4) TUCKER SHOWN 16 FOR MAX. DISTANCE END ON 4" AC
 - 5) AVERAGE SERVICE LENGTH IS 100 FT.
 - 6) ALL SERVICES TO BE INSTALLED ON USED SERVICE BUT THAT DISTANCES SHOWN ARE ONE WAY
 - 8) STREET CROSSINGS AS PER SPEC. TO ENGR. DEPT
 - 9) 3" CONDUIT TO BE INSTALLED AT CROSS LOCATIONS REQUIRING 12" MIN. DEPTH (5" MIN. DEPTH)
 - 10) ROW REQUIRED
 - 11) SHADED LOTS ARE MARKETABLE AT PRESENT
 - 12) ALL CABLE FOR FUTURE USE TO BE SERVED AT ENDS
 - 13) EXISTING CONDUIT-3" PVC TYPE "DB" INSTALLED BY CUSTOMER
 - 14) CABLE THAT IS TO BE STIPPED FOR FUTURE USE WILL EXTEND TO END OF LOT
 - 15) STREET CROSSINGS TO UTILIZE 40" OF CONDUIT
 - 16) SECONDARY & JUMPER CABLE DISTANCES INCLUDE 5' AT TRANSFORMER AND LOT LINE

S-25 TIPS R3W	
ALABAMA POWER COMPANY	
JOB NO. 11111	
DETAIL 210	
SERVICE	
SCALE 1" = 50'	DATE 07/28/03
SHEET 1 OF 3 SHEETS	SUPPLEMENT
D-BD-12593	

MAP 71845

DRAWN L. AVERY	CHECKED	TRACED J. DWELL
APPROVED	DATE	
APPROVED	DATE	