

Southern Natural Gas Company
Post Office Box 2563
Birmingham AL 35202 2563
205 325 7410

526633

SOUTHERN NATURAL GAS

275

December 15, 1987

Alabama Power Company
P. O. Box 2641
Birmingham, Alabama 35291

Attn: Ms. Sara Parks
General Acquisition Agent

SUBJECT: APCO's underground power line (WE#61700-08-00577-00) crossing
8" Calera Branch and Loop Pipeline Right of Way; M.P. 24+,
Shelby County, Alabama (B'ham District)

BOOK
236
PAGE 966

Gentlemen:

This is to advise that Southern Natural Gas Company has no objection to the subject crossing installation in accordance with attached Dwg. No. A-61700--08-00577-00) provided that:

- (1) you contact our District Superintendent at the address given below at least three days before performing any work related to the subject crossing. The work shall be performed under his supervision and the right of way shall be restored to his satisfaction;
- (2) you maintain a minimum vertical clearance of 24 inches between the underground power line and our pipeline as uniformly as possible across the entire width of our right of way (being 65 feet wide, measuring 15' east and 50' west of our easternmost pipeline);
- (3) you install the proposed underground power line in PVC conduit across the entire width of our right of way;
- (4) you do not operate nor allow to be operated any excavating machinery upon, over or within five feet of each of our pipelines on either side thereof; and that
- (5) you install appropriate marking signs at each right of way line.

This instrument prepared in
the Corporate Real Estate
Dept. of Alabama Power Co.
Birmingham, Ala.

By P. C. Coggins

GRANTEE'S ADDRESS
ALABAMA POWER CO.
P. O. BOX 2641
BIRMINGHAM, AL 35281
ATT: CORP. REAL ESTATE


Southern Natural Gas Company

Alabama Power Company
Page Two
December 15, 1987

We wish to point out that our pipelines have impressed current cathodic protection systems supplied by rectifiers. There is the possibility that your power lines may be subjected to certain electrical interference currents from these cathodic protection systems, which currents could cause damage to your bare, tin-alloyed, copper neutral conductor.

By giving consent to the proposed installation of the underground power line across our subject pipeline rights of way, it is understood that we do not assume any additional responsibility for protecting our pipelines, nor will we incur any liability for damages to persons or property which may result from the proposed installation of the underground power line. Furthermore, all work performed in connection with the installation of the underground power line will be without expenses, risk or liability to Southern Natural Gas Company, or any of its directors, officers, agents, representatives or employees.

Yours very truly,

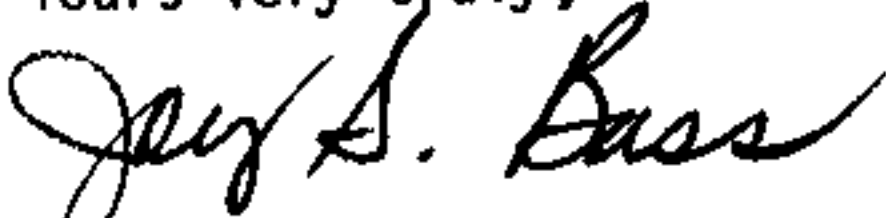

Jay S. Bass
Permit Agent
205/325-7404


JSB/b

Attachment


cc: Mr. S. Jackson
District Superintendent
Southern Natural Gas Company
P. O. Box 170070
Birmingham, AL 35217-0070
Tele: 205/325-7551

BOOK 236 PAGE 967

SOUTHERN NATURAL GAS PIPELINE CROSSING
SECTION 27 TNSP 20-5 RANGE 3W

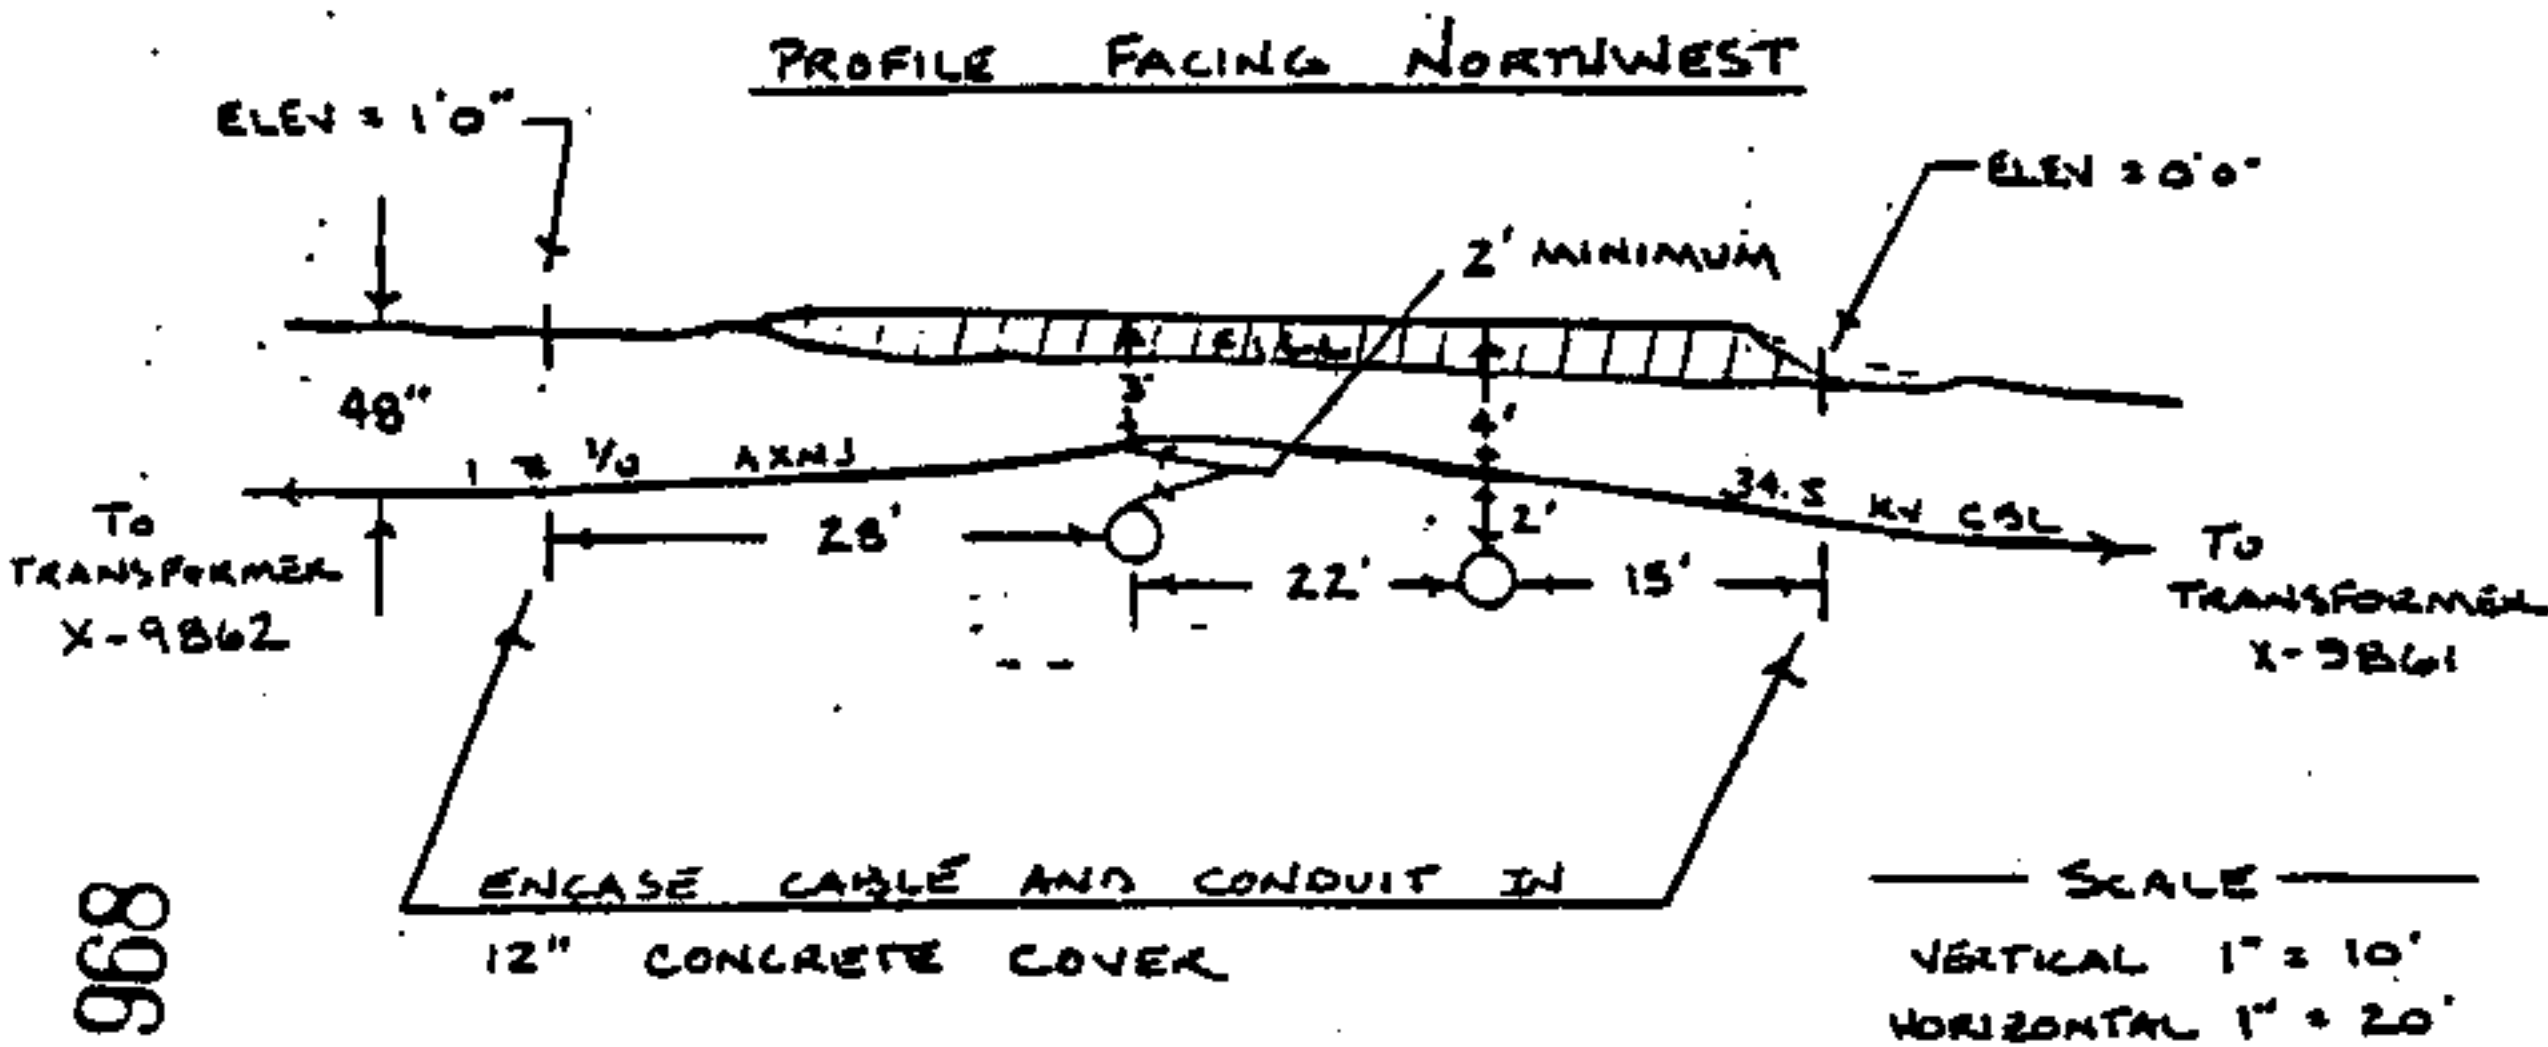

Crossing is approximately 400 feet south of MP 24

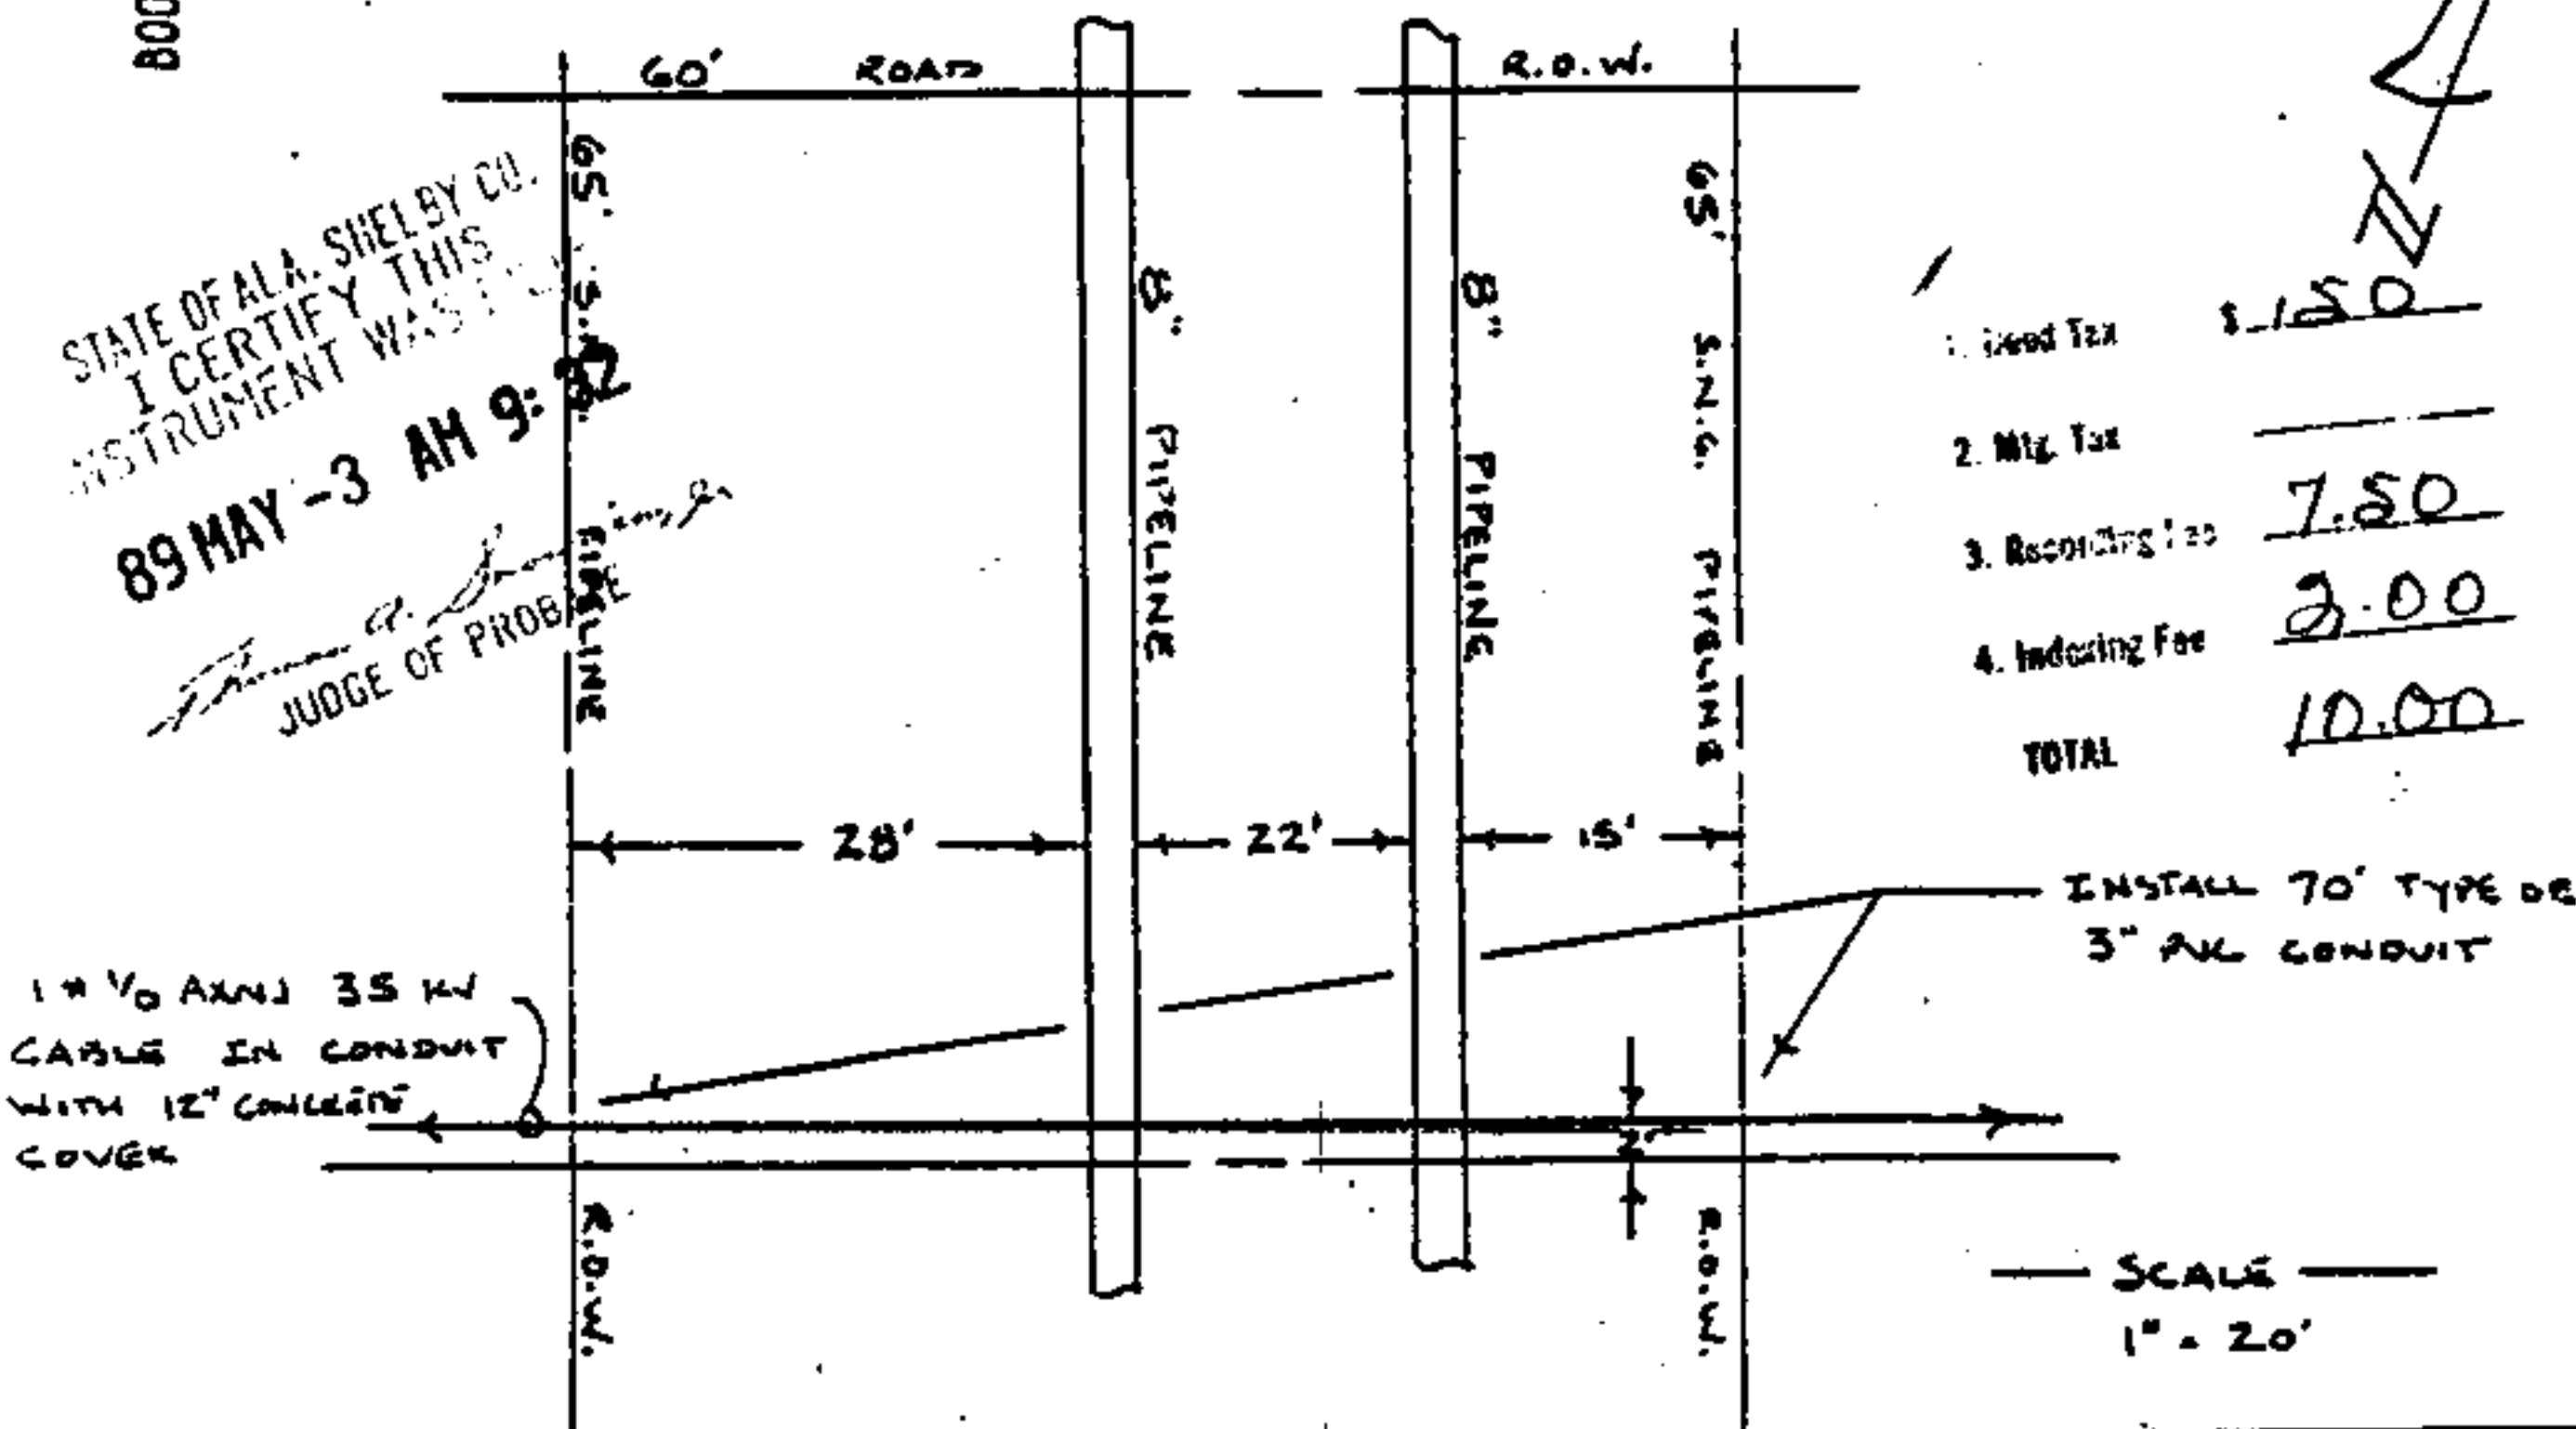

DR. J. SCHIFANO	NO.	DATE	REVISION	ALABAMA POWER COMPANY	
TR		2-10-87		SUBJECT NORTH SHELBY 34.5 KV DISTRIBUTION	
CK. LL				DETAIL UNDERGROUND SOUTHERN NATURAL GAS PIPELINE CROSSING	
APP					
DATE					
SUPERSEDES NONE				SCALE SHOWN ABOVE ON 1 OF 1 SHEETS	A-61700-08-00577-00