

\$175

**RESTRICTIVE COVENANTS and
GRANT OF LAND EASEMENT for
Underground Facilities in Subdivision**

DOCUMENT TO BE RECORDED

**(NOTE: DO NOT RECORD WITHOUT
ATTACHED PLAT OR DRAWING!)**

This instrument prepared by:

Larry D. Gantt

STATE OF ALABAMA }
COUNTY OF Shelby }

W.E. No. 61700-08-0091-400
Parcel No. 70151155

Alabama Power Company
Corporate Real Estate
P. O. Box 2641
Birmingham, Alabama 35291

KNOW ALL MEN BY THESE PRESENTS, THAT: WHEREAS, the "Grantor", (whether one or more) are owners of record of the following described real estate in Shelby County, Alabama, to wit: Old Ivy (the "Subdivision") as shown on the plat or drawing attached and incorporated herein by reference, which Grantor plans to record in the Office of the Judge of Probate, Shelby County, Alabama (the "Property") (South 1/2 ~~xx~~ of ~~-----~~ ~~xx~~ of Section 14, Township 22 S, Range 2 W) and,

WHEREAS, the said Grantor desires to grant to Alabama Power Company, (the "Company") an easement for underground electrical facilities and to establish and place the Subdivision under certain restrictive covenants to insure the use of the property for attractive residential purposes and thereby to secure to each lot owner the same advantages insured to other lot owners.

NOW, THEREFORE, The Grantor, for and in consideration of One and No/100 Dollars (\$1.00), and other good and valuable consideration, to Grantor in hand paid by the Company, the receipt of which is hereby acknowledged, does hereby grant to Company, its successors and assigns, the right to construct, install, operate, maintain and replace, along a route to be selected by the Company (generally shown on the attached drawing), its successors or assigns, all conduits, cables, trans closures and other appliances and facilities (above ground and below ground) useful or necessary in connection therewith, for the underground transmission and distribution of electric power and for underground communication service upon, under and across the Property.

Together with all the rights and privileges necessary or convenient for the full enjoyment or use thereof, including the right of ingress and egress to and from said facilities and the right to excavate for installation, replacement, repair and removal thereof; and also the right to cut and keep clear any and all obstructions or obstacles of whatever character on, under and above said facilities.

TO HAVE AND TO HOLD such easement to the Company, its successors and assigns, forever.

And, the undersigned Grantors further does hereby adopt the following conditions, restrictions, covenants and limitations which shall apply in their entirety to all lots in the said Subdivision and shall run with the title to said property, and which shall be included in any conveyance of title to any or all of said lots in said subdivision:

1. The owners of lots within the Subdivision will not erect or grant to any person, firm or corporation the right, license or privilege to erect or use or permit the use of overhead wires, poles or overhead facilities of any kind for electrical, telephone, or cable television service on said real estate (except such poles and overhead facilities as may be required at those places where distribution facilities enter and leave said subdivision, or existing and/or future overhead transmission or communication facilities on existing Alabama Power Company rights of way). Nothing herein shall be construed to prohibit overhead street lighting, or ornamental yard lighting, where serviced by underground wires or cables.

2. In order to beautify said Subdivision for the benefit of all lot owners and permit Alabama Power Company to install underground electric service to each house in said Subdivision for the mutual benefit of all lot owners therein, no owner of any lot within said Subdivision will commence construction of any house on any lot until such owner (1) notifies Alabama Power Company that such construction is proposed, (2) grants in writing to Alabama Power Company such rights and easements as Alabama Power Company deems necessary in connection with its construction, operation, maintenance, replacement and removal of underground service laterals of each lot, and (3) otherwise complies with the Rules and Regulations for Underground Residential Distribution on file with and approved by the Alabama Public Service Commission. Further, no plants, shrubs, fences, walls or other obstructions shall be placed in front of or within three (3) feet of any side of any pad-mounted equipment and Alabama Power Company shall not be liable for any damages to or destruction of any shrubs, trees, flowers, grass or other plants caused by the equipment or employees of the Company or its contractors engaged in the construction, operation, maintenance, replacement or removal of the Company's facilities. Appropriate meter locations must be obtained from Alabama Power Company prior to installing or relocating service entrance facilities and associated internal wiring. Owners must install meter sockets provided by Alabama Power Company to the Company's specifications, and shall provide and install conduit from the meter socket as specified by the Company.

3. Alabama Power Company, its successors and assigns, will retain title to all underground facilities installed by the Company or its contractors, including but not limited to the service lateral and outdoor metering socket serving each said house, and said service entrance facilities provided by Alabama Power Company will not in any way be considered a fixture or fixtures and thereby a part of said real estate, but will remain personal property belonging to Alabama Power Company, its successors and assigns, and will be subject to removal by Alabama Power Company, its successors and assigns, in accordance with applicable Rules and Regulations filed with and approved by the Alabama Public Service Commission.

4. These covenants and restrictions touch and concern and benefit the land and shall run with the land and shall be binding on Alabama Power Company, the undersigned, their respective heirs, successors and assigns. Invalidity of any one of the foregoing covenants and restrictions shall in no way affect any other provision contained herein.

Shelby County, AL 08/01/2005
State of Alabama

Deed Tax: \$.50

20050801000385590 1/3 \$17.50
Shelby Cnty Judge of Probate, AL
08/01/2005 12:07:08PM FILED/CERT

428520 Rev 7/01

IN WITNESS WHEREOF, this instrument has been executed this the 31st day of January, 2005.

WITNESS/ATTEST

Robyn S. Marshall

GRANTOR:

Edwards Specialties, Inc
Name of Individual/Company/Partnership/LLC

Pat Neal Vice President
Signature of Individual/Officer/Partner

=====

CORPORATE/PARTNERSHIP ACKNOWLEDGMENT

STATE OF ALABAMA }
County of Madison }


20050801000385590 2/3 \$17.50
Shelby Cnty Judge of Probate, AL
08/01/2005 12:07:08PM FILED/CERT

I, Joann Hall, a Notary Public, in and for said County in said State, hereby certify that, Patricia Neal whose name as Patricia Neal of Edwards Specialties, Inc., a corporation/partnership, is signed to the foregoing instrument, and who is known to me, acknowledged before me on this day that being informed of the contents of the instrument, he/she, as such officer/partner and with full authority, executed the same voluntarily for and as the act of said corporation/partnership.

Given under my hand and official seal, this the 19th day of January, 2005.

Joann Hall
Notary Public

My commission expires: 1/9/06

=====

INDIVIDUAL ACKNOWLEDGMENT


STATE OF ALABAMA }
County of _____ }

I, _____, a Notary Public in and for said County, in said State, hereby certify that _____, whose name(s) (is/are) signed to the foregoing instrument, and who (is/are) known to me, acknowledged before me on this date that, being informed of the contents of the agreement, (has/have) executed the same voluntarily on the day the same bears date.


Given under my hand and official seal, this the _____ day of _____, 20____.

Notary Public

My commission expires: _____




- 1 3-16 PRS DESK
PAGE 75A
- 2 7500A DPMU XDRP
CL=54 100A
- 3 7500A DPMU XDRP
CL=41 500A
BOX PAD
- 4 7500A DPMU XDRP
CL=8400A
- 5 7500A DPMU XDRP
CL=123 400A
! BOX PAD
- 6 7500A DPMU XDRP
CL=8400A
- 7 7500A DPMU XDRP
CL=87 800A
- 8 7500A DPMU XDRP
CL=54 100A
- 9 7500A DPMU XDRP
CL=172 900A
! BOX PAD
*PAGE NO **
- 10 7500A DPMU XDRP
CL=8400A
- 11 7500A DPMU XDRP
CL=63 200A
- 12 7500A DPMU XDRP
CL=63 200A
- 13 7500A DPMU XDRP
CL=63 300A
! BOX PAD
- 14 40/S
3-16 PMU BY DESK 7500A
3-16 PRS DESKS
PAGE 75A
- 15 3 82/0 1250 400A
3 82 400A 1000A
(5)
- 16 3-16 PRS DESK
- 17 7500A DPMU XDRP
CL=22 400A
! BOX PAD
- 18 7500A DPMU XDRP
CL=122 400A
! BOX PAD
- 19 7500A DPMU XDRP
CL=122 400A
! BOX PAD
*PAGE NO **
- 20 7500A DPMU XDRP
CL=123 400A
! BOX PAD
- 21 7500A DPMU XDRP
CL=103 400A
! BOX PAD
*PAGE NO **
- 22 7500A DPMU XDRP
CL=93 800A
- 23 7500A DPMU XDRP
CL=172 900A
! BOX PAD
- 24 7500A DPMU XDRP
CL=93 800A
- 25 7500A DPMU XDRP
CL=93 800A
- 26 7500A DPMU XDRP
CL=93 800A
- 27 7500A DPMU XDRP
CL=93 800A
- 28 7500A DPMU XDRP
CL=93 800A
- 29 7500A DPMU XDRP
CL=93 800A
- 30 7500A DPMU XDRP
CL=93 800A
- 31 7500A DPMU XDRP
CL=93 800A
- 32 7500A DPMU XDRP
CL=93 800A
- 33 7500A DPMU XDRP
CL=93 800A
- 34 7500A DPMU XDRP
CL=93 800A
- 35 7500A DPMU XDRP
CL=93 800A
- 36 7500A DPMU XDRP
CL=93 800A
- 37 7500A DPMU XDRP
CL=93 800A
- 38 7500A DPMU XDRP
CL=93 800A
- 39 7500A DPMU XDRP
CL=93 800A
- 40 7500A DPMU XDRP
CL=93 800A
- 41 7500A DPMU XDRP
CL=93 800A
- 42 7500A DPMU XDRP
CL=93 800A
- 43 7500A DPMU XDRP
CL=93 800A
- 44 7500A DPMU XDRP
CL=93 800A
- 45 7500A DPMU XDRP
CL=93 800A
- 46 7500A DPMU XDRP
CL=93 800A
- 47 7500A DPMU XDRP
CL=93 800A
- 48 7500A DPMU XDRP
CL=93 800A
- 49 7500A DPMU XDRP
CL=93 800A
- 50 7500A DPMU XDRP
CL=93 800A
- 51 7500A DPMU XDRP
CL=93 800A
- 52 7500A DPMU XDRP
CL=93 800A
- 53 7500A DPMU XDRP
CL=93 800A
- 54 7500A DPMU XDRP
CL=93 800A
- 55 7500A DPMU XDRP
CL=93 800A
- 56 7500A DPMU XDRP
CL=93 800A
- 57 7500A DPMU XDRP
CL=93 800A
- 58 7500A DPMU XDRP
CL=93 800A
- 59 7500A DPMU XDRP
CL=93 800A
- 60 7500A DPMU XDRP
CL=93 800A
- 61 7500A DPMU XDRP
CL=93 800A
- 62 7500A DPMU XDRP
CL=93 800A
- 63 7500A DPMU XDRP
CL=93 800A
- 64 7500A DPMU XDRP
CL=93 800A
- 65 7500A DPMU XDRP
CL=93 800A
- 66 7500A DPMU XDRP
CL=93 800A
- 67 7500A DPMU XDRP
CL=93 800A
- 68 7500A DPMU XDRP
CL=93 800A
- 69 7500A DPMU XDRP
CL=93 800A
- 70 7500A DPMU XDRP
CL=93 800A
- 71 7500A DPMU XDRP
CL=93 800A
- 72 7500A DPMU XDRP
CL=93 800A
- 73 7500A DPMU XDRP
CL=93 800A
- 74 7500A DPMU XDRP
CL=93 800A
- 75 7500A DPMU XDRP
CL=93 800A
- 76 7500A DPMU XDRP
CL=93 800A
- 77 7500A DPMU XDRP
CL=93 800A
- 78 7500A DPMU XDRP
CL=93 800A
- 79 7500A DPMU XDRP
CL=93 800A
- 80 7500A DPMU XDRP
CL=93 800A
- 81 7500A DPMU XDRP
CL=93 800A
- 82 7500A DPMU XDRP
CL=93 800A
- 83 7500A DPMU XDRP
CL=93 800A
- 84 7500A DPMU XDRP
CL=93 800A
- 85 7500A DPMU XDRP
CL=93 800A
- 86 7500A DPMU XDRP
CL=93 800A
- 87 7500A DPMU XDRP
CL=93 800A
- 88 7500A DPMU XDRP
CL=93 800A
- 89 7500A DPMU XDRP
CL=93 800A
- 90 7500A DPMU XDRP
CL=93 800A
- 91 7500A DPMU XDRP
CL=93 800A
- 92 7500A DPMU XDRP
CL=93 800A
- 93 7500A DPMU XDRP
CL=93 800A
- 94 7500A DPMU XDRP
CL=93 800A
- 95 7500A DPMU XDRP
CL=93 800A
- 96 7500A DPMU XDRP
CL=93 800A
- 97 7500A DPMU XDRP
CL=93 800A
- 98 7500A DPMU XDRP
CL=93 800A
- 99 7500A DPMU XDRP
CL=93 800A
- 100 7500A DPMU XDRP
CL=93 800A
- 101 7500A DPMU XDRP
CL=93 800A
- 102 7500A DPMU XDRP
CL=93 800A
- 103 7500A DPMU XDRP
CL=93 800A
- 104 7500A DPMU XDRP
CL=93 800A
- 105 7500A DPMU XDRP
CL=93 800A
- 106 7500A DPMU XDRP
CL=93 800A
- 107 7500A DPMU XDRP
CL=93 800A
- 108 7500A DPMU XDRP
CL=93 800A
- 109 7500A DPMU XDRP
CL=93 800A
- 110 7500A DPMU XDRP
CL=93 800A
- 111 7500A DPMU XDRP
CL=93 800A
- 112 7500A DPMU XDRP
CL=93 800A
- 113 7500A DPMU XDRP
CL=93 800A
- 114 7500A DPMU XDRP
CL=93 800A
- 115 7500A DPMU XDRP
CL=93 800A
- 116 7500A DPMU XDRP
CL=93 800A
- 117 7500A DPMU XDRP
CL=93 800A
- 118 7500A DPMU XDRP
CL=93 800A
- 119 7500A DPMU XDRP
CL=93 800A
- 120 7500A DPMU XDRP
CL=93 800A
- 121 7500A DPMU XDRP
CL=93 800A
- 122 7500A DPMU XDRP
CL=93 800A
- 123 7500A DPMU XDRP
CL=93 800A
- 124 7500A DPMU XDRP
CL=93 800A
- 125 7500A DPMU XDRP
CL=93 800A
- 126 7500A DPMU XDRP
CL=93 800A
- 127 7500A DPMU XDRP
CL=93 800A
- 128 7500A DPMU XDRP
CL=93 800A
- 129 7500A DPMU XDRP
CL=93 800A
- 130 7500A DPMU XDRP
CL=93 800A
- 131 7500A DPMU XDRP
CL=93 800A
- 132 7500A DPMU XDRP
CL=93 800A
- 133 7500A DPMU XDRP
CL=93 8

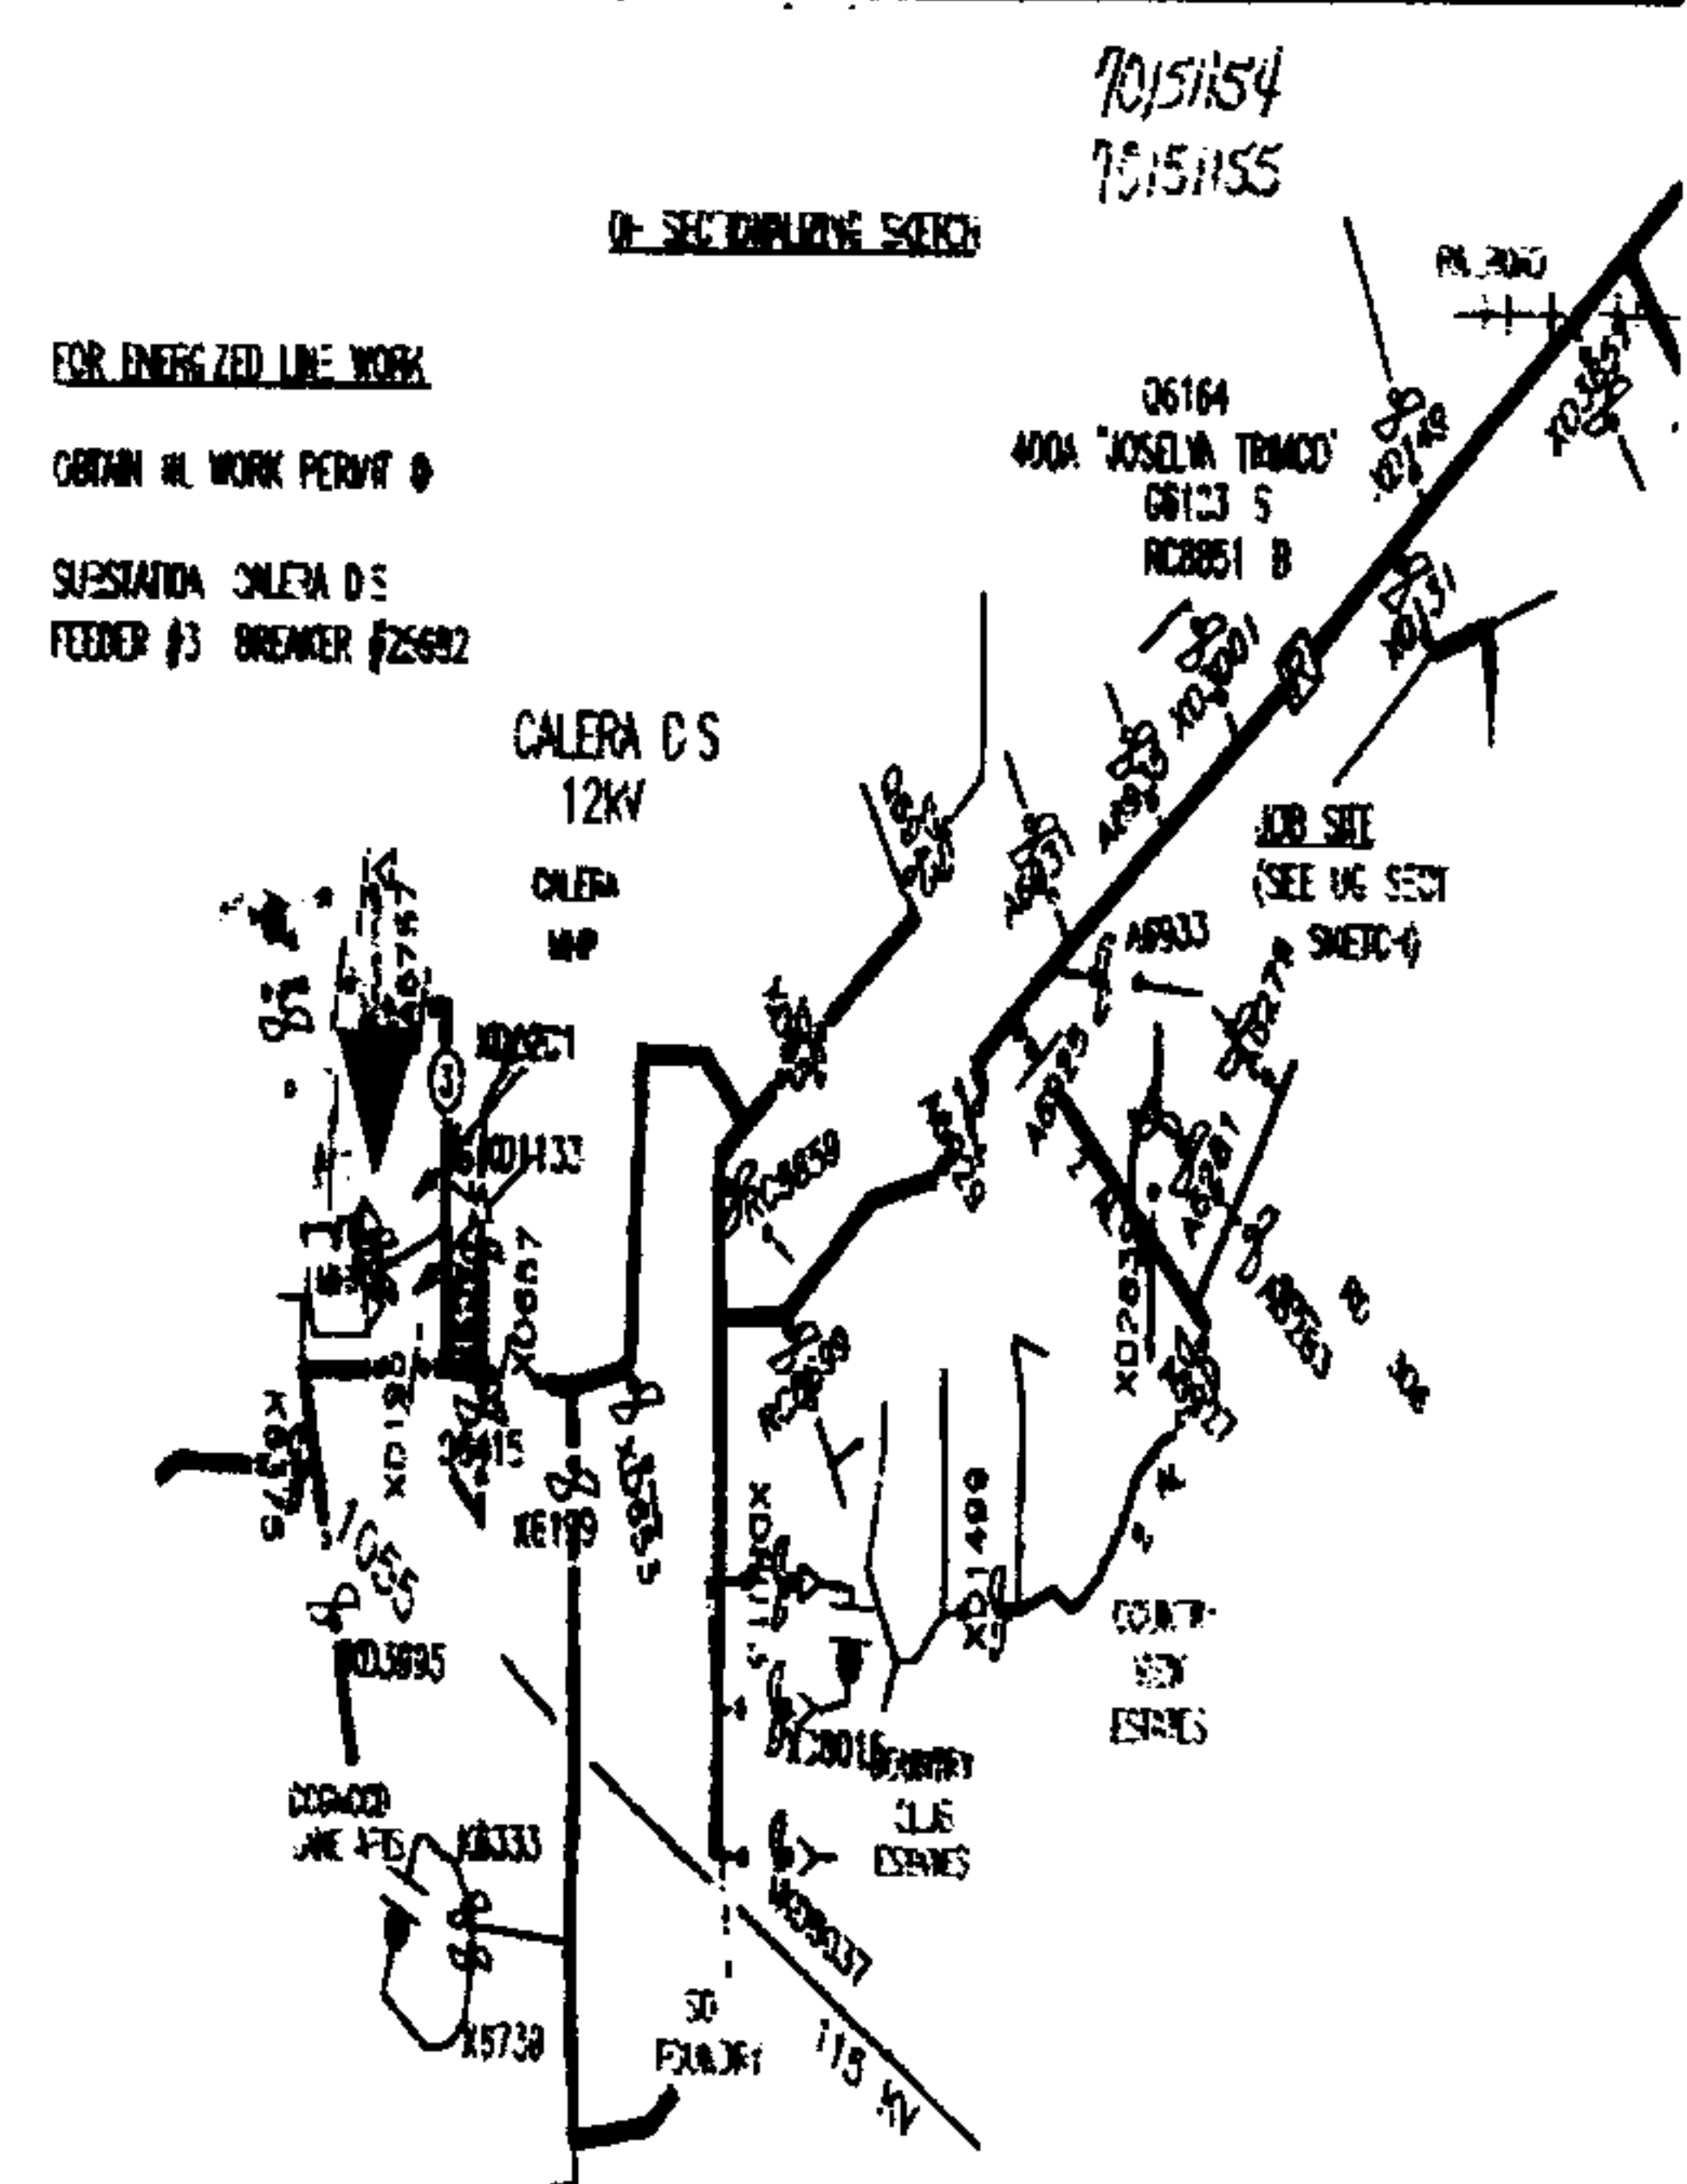

RISER LOADING


SWITCH #	PROPOSED	EMERGENCY
XD-9541	35.6 A	66.7 A
XD-9543	34.4 A	68.9 A
XD-9545	40 A	78.9 A
XD-9547	31.1 A	66.7 A
XD-9549	34.4 A	68.9 A
XD-9551	38.9 A	78.9 A

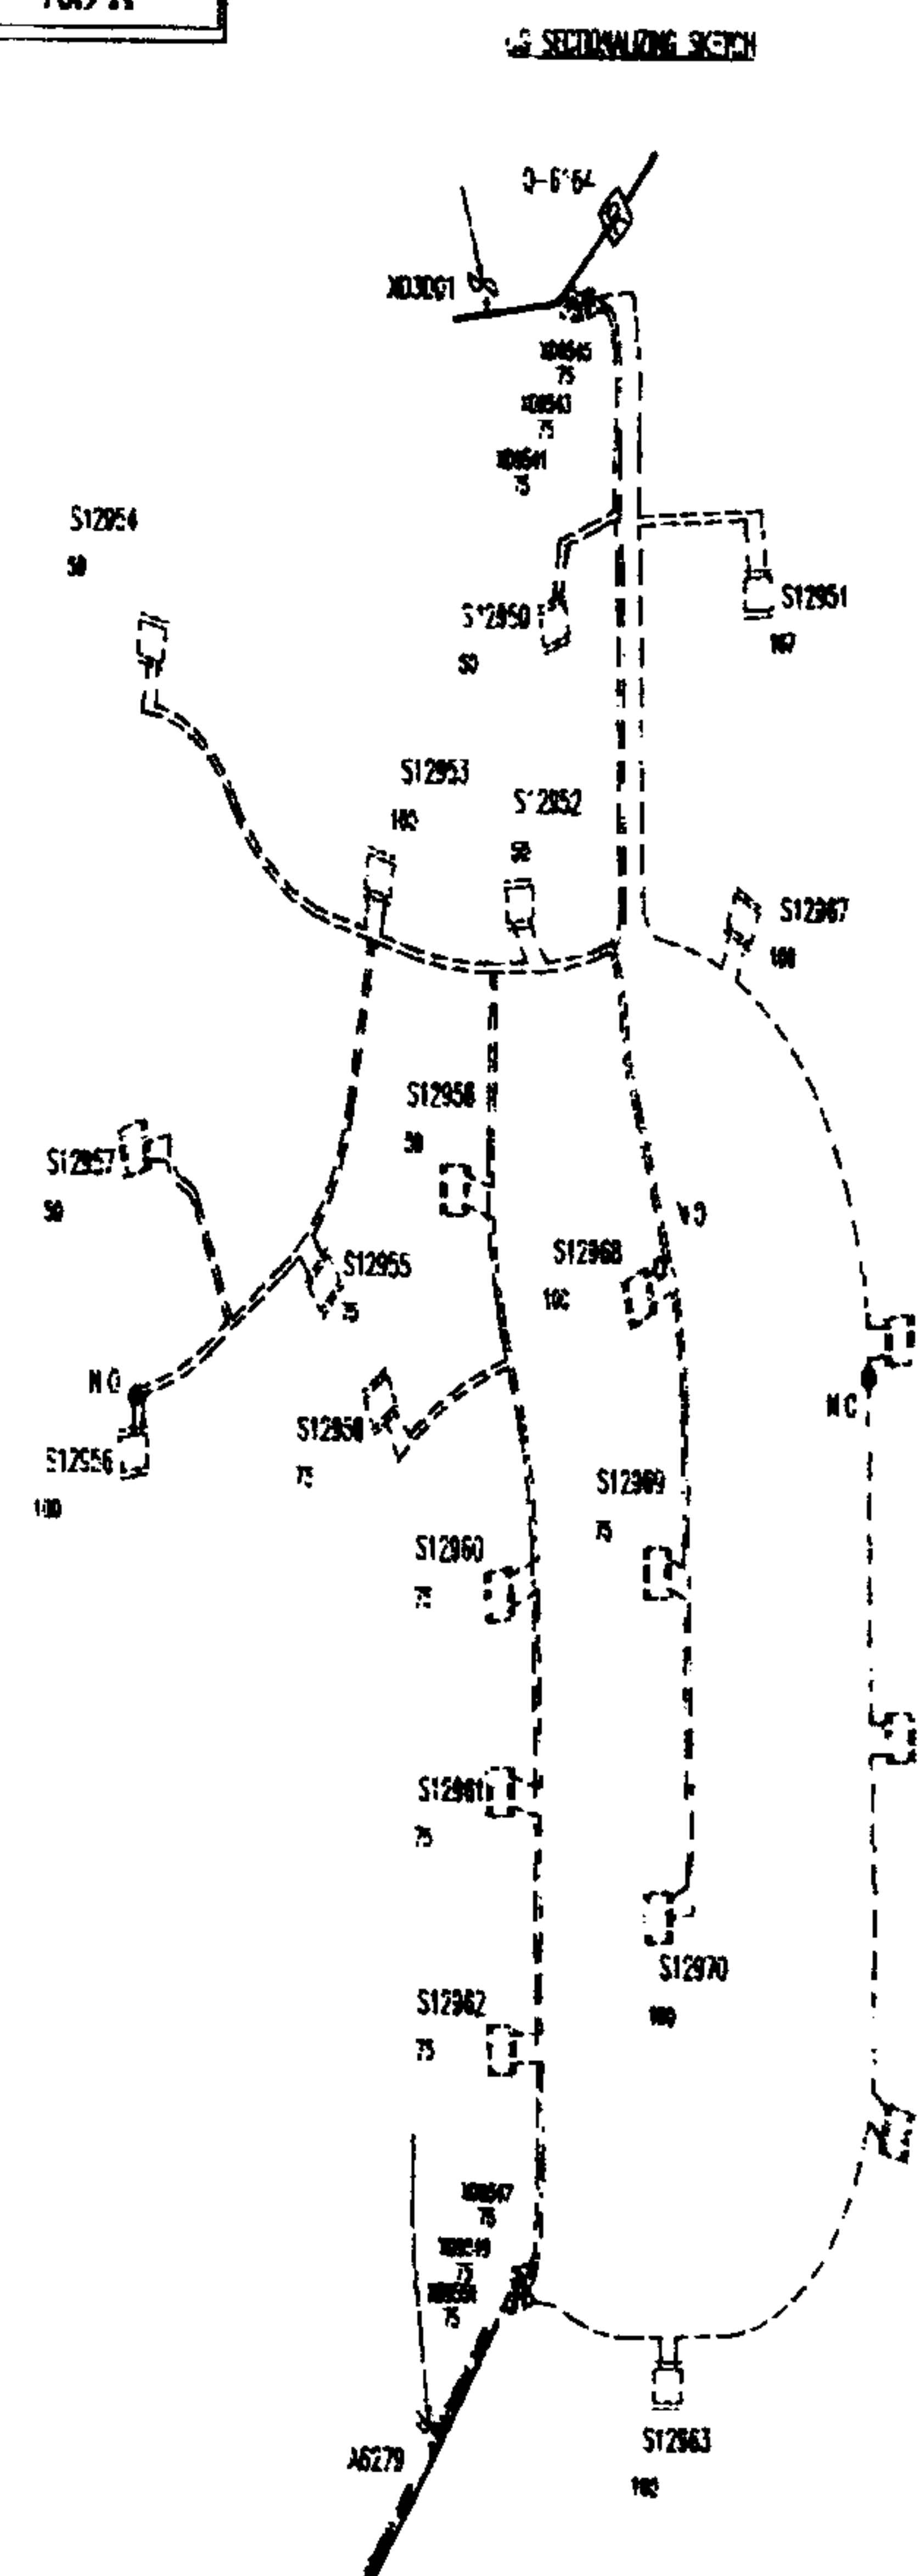

CONSTRUCTION COMPLETE

DATE _____

ANY CONSTRUCTION FIELD C
ARE SHOWN IN RED ON THIS

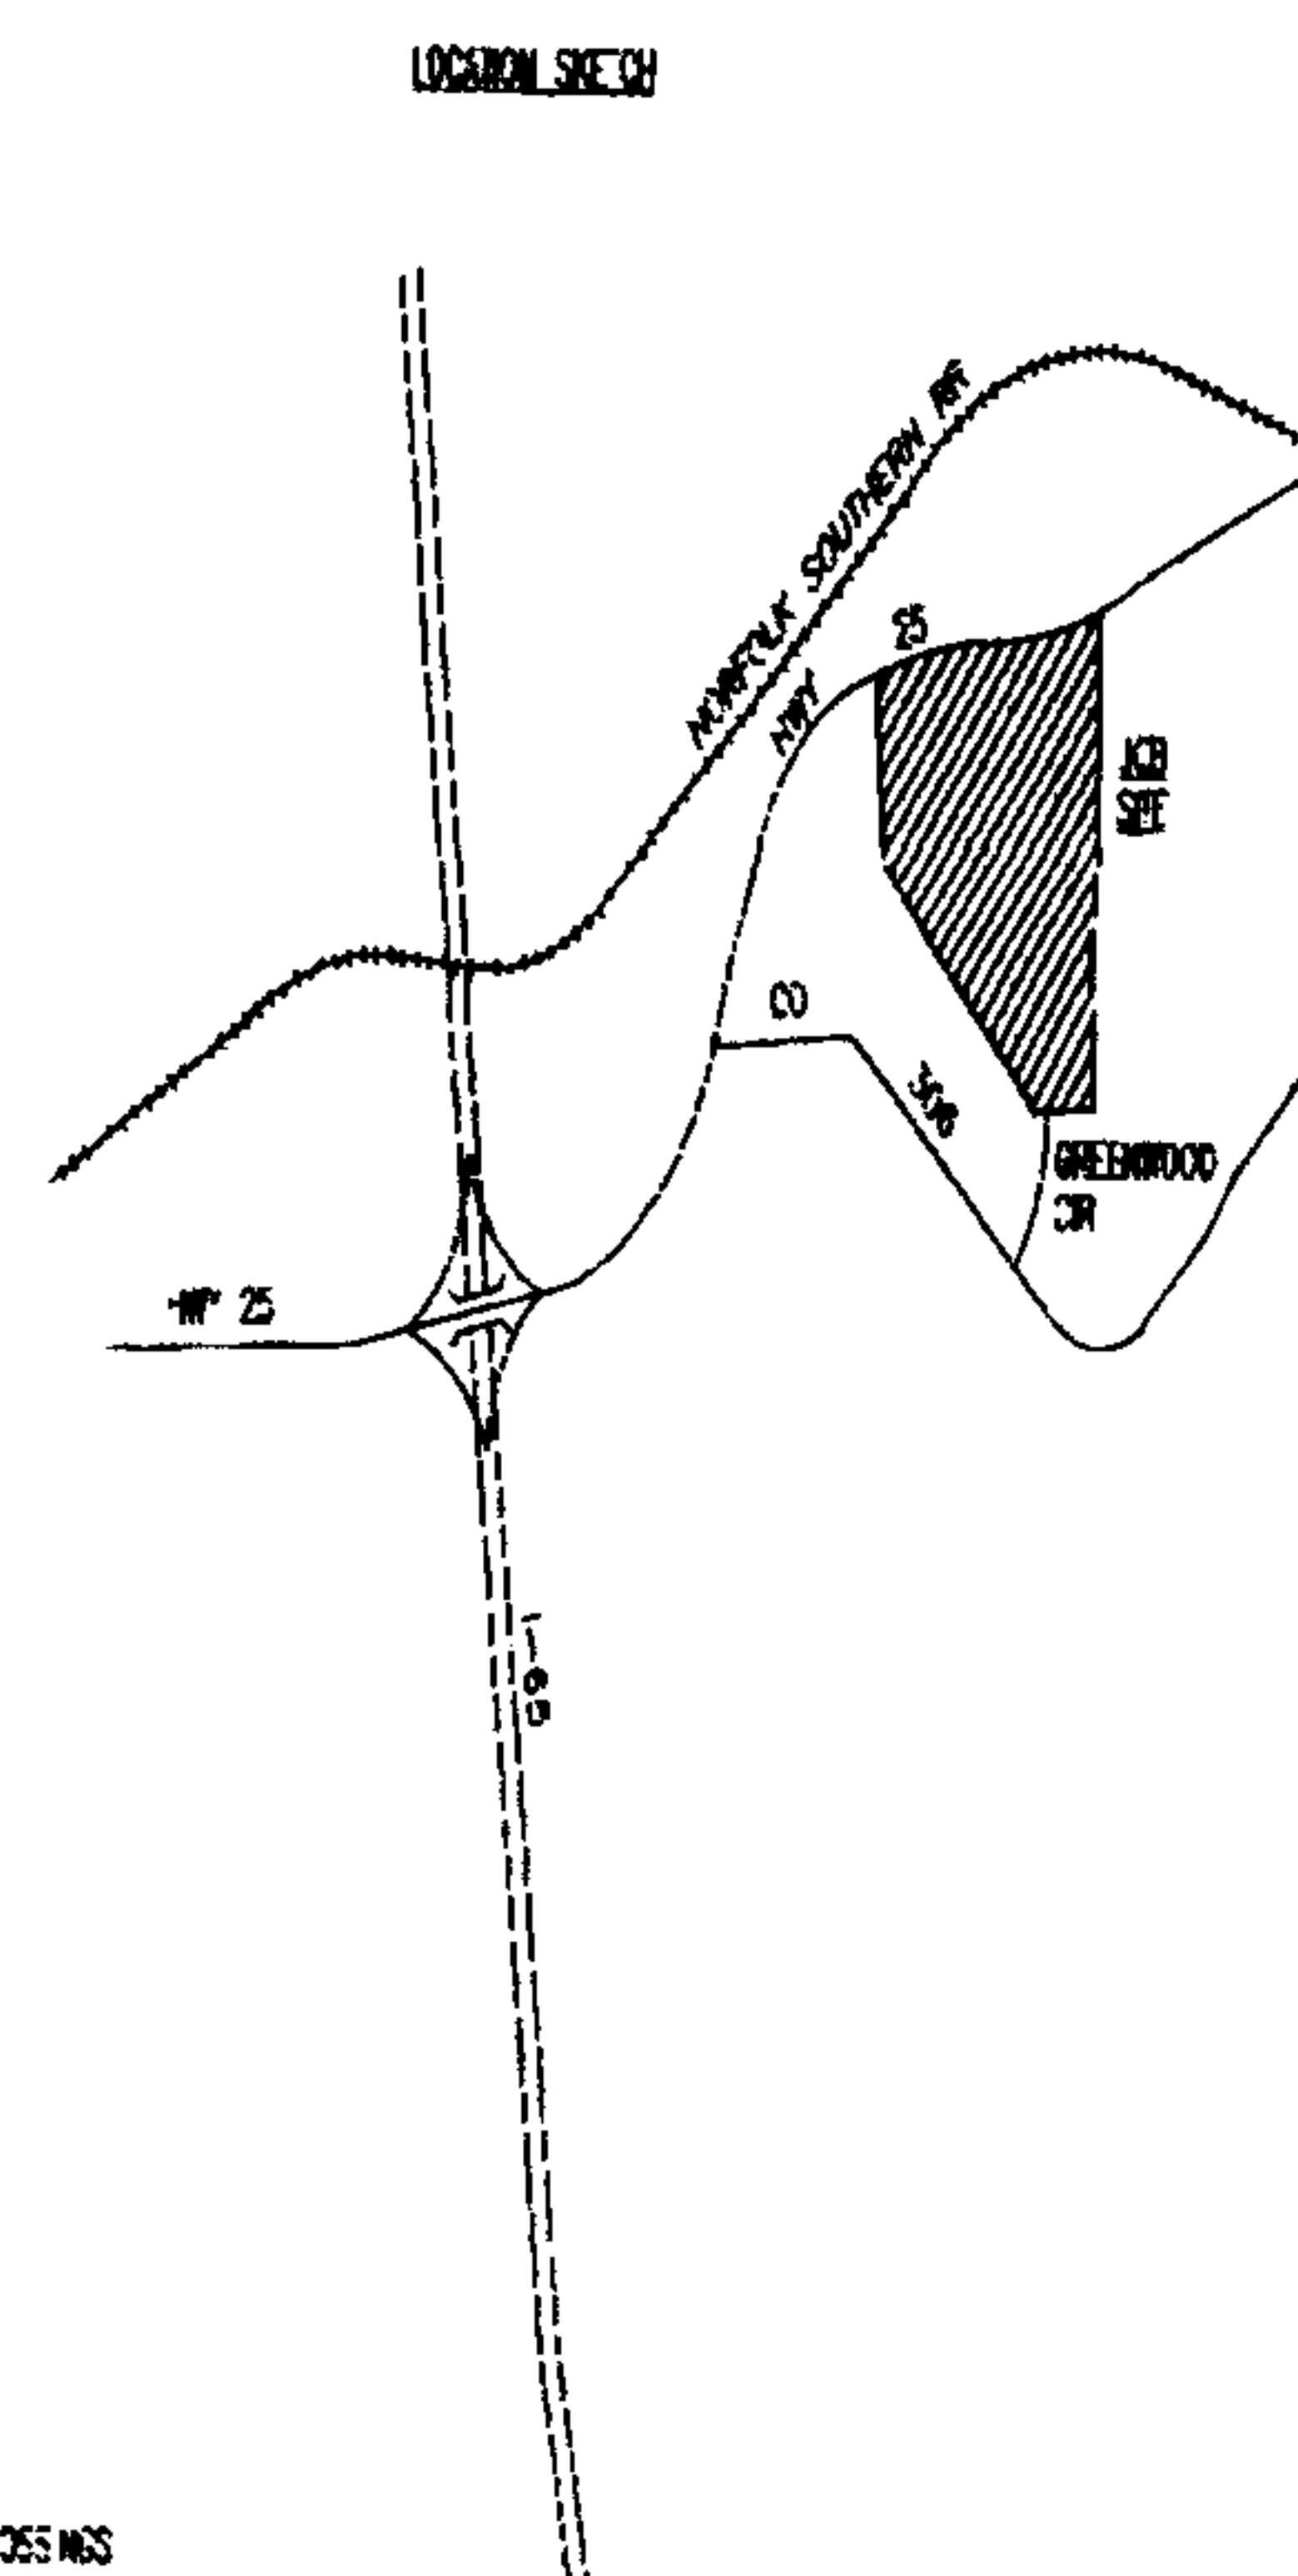

NOTES

1. JOB IS DIVIDED INTO 2 SECTIONS ONLY TO CLARIFY SEQUENCING OF ROAD CROSSINGS. SECTION 1 WILL BE COMPLETELY READY FOR CROSSINGS TO BE INSTALLED.
2. SECTION 2 WILL BE CURRENTLY FOR INSTALLATION OF CROSSINGS IN THE QUARTER OF 2005. INSTALLATION OF THE OTHER FACILITIES CAN BE DONE SIMULTANEOUSLY IN BOTH SECTIONS.
3. PRIMARY CABLE TO BE 1/8" ALUM. CABLE IN DIRECT BURIED AT 42" BELOW GROUND.
4. ALL ROAD CROSSINGS TO COMPLY WITH SLOTTED CABLE REQUIREMENTS.
5. ALL SECONDARY FROM TRANSFORMERS TO SECONDARY PEDESTALS TO BE 2 # 20G & 1 # 3/8" AL. NIP. BROWN CABLE (DIRECT BURIED).
6. ALL OTHER SECONDARY TO BE 2 # 4/0 & 1 # 1/2" AL. AL. BROWN CABLE (DIRECT BURIED).
7. ALL SECONDARY CABLE TO BE BURIED AT 30" BELOW GROUND.
8. REBAR LEADING IS BASED ON AREA PER LOT.
9. TRANSFORMER LEADING BASED ON L, R, W, D, & 30 FT.
10. MAXIMUM VOLUME (BOTH CALCULATED) AT LOT 41 IS A 77X.
11. MAXIMUM VOLUME (BOTH CALCULATED) AT LOT 108 IS A 358X.



20050801000385590 3/3 \$17.50
Shelby Cnty Judge of Probate, AL
08/01/2005 12:07:08PM FILED/CERT

APC Distribution Division

0 100 200
PLAN SCALE

TOWN CALERA COUNTY SHELBY

ALABAMA POWER
JOB POWER DELIVERY - ENG
OLD CAL. POWER CO.