


**GRANT OF LAND EASEMENT and
RESTRICTIVE COVENANTS for
Underground Facilities in Subdivision**

DOCUMENT TO BE RECORDED

**(NOTE: DO NOT RECORD WITHOUT
ATTACHED PLAT OR DRAWING!)**

This instrument prepared by:

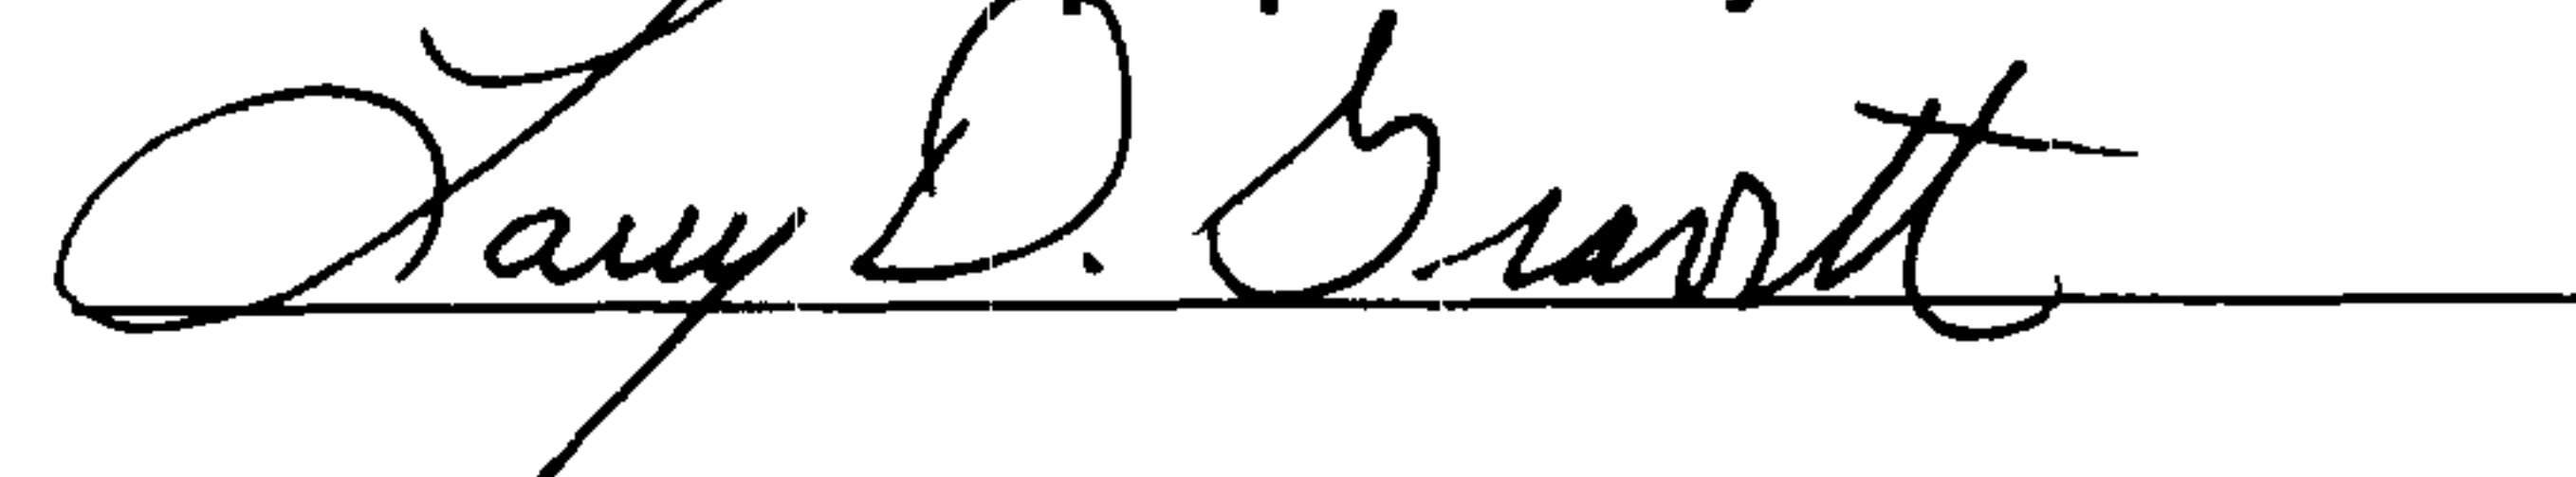

Alabama Power Company
Corporate Real Estate
P. O. Box 2641
Birmingham, Alabama 35291

STATE OF ALABAMA }
COUNTY OF Shelby }

W.E. No. 61700-08-0093-500
Parcel No. 70162948

KNOW ALL MEN BY THESE PRESENTS, THAT: WHEREAS, the "Grantor", (whether one or more) are owners of record of the following described real estate in Shelby County, Alabama, to wit: Old Cahaba-Phase V Sector 2 (the "Subdivision") as shown on the plat or drawing attached and incorporated herein by reference, which Grantor plans to record in the Office of the Judge of Probate, Shelby County, Alabama (the "Property") (SE $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 19 30, Township 20S, Range 3W) and,

WHEREAS, the said Grantor desires to grant to Alabama Power Company, (the "Company") an easement for underground electrical facilities and to establish and place the Subdivision under certain restrictive covenants to insure the use of the property for attractive residential purposes and thereby to secure to each lot owner the same advantages insured to other lot owners.

NOW, THEREFORE, The Grantor, for and in consideration of *One and No/100 Dollars (\$1.00)*, and other good and valuable consideration, to Grantor in hand paid by the Company, the receipt of which is hereby acknowledged, does hereby grant to Company, its successors and assigns, the right to construct, install, operate, maintain and replace, along a route to be selected by the Company (generally shown on the attached drawing), its successors or assigns, all conduits, cables, transformers, and other appliances and facilities (above ground and below ground) useful or necessary in connection therewith, for the underground transmission and distribution of electric power upon, under and across the Property.

Together with all the rights and privileges necessary or convenient for the full enjoyment or use thereof, including the right of ingress and egress to and from said facilities and the right to excavate for installation, replacement, repair and removal thereof; and also the right to cut and keep clear any and all obstructions or obstacles of whatever character on, under and above said facilities.

TO HAVE AND TO HOLD such easement to the Company, its successors and assigns, forever.

And, the undersigned Grantor further does hereby adopt the following conditions, restrictions, covenants and limitations which shall apply in their entirety to all lots in the said Subdivision and shall run with the title to said property, and which shall be included in any conveyance of title to any or all of said lots in said subdivision:

1. The owners of lots within the Subdivision will not erect or grant to any person, firm or corporation the right, license or privilege to erect or use or permit the use of overhead wires, poles or overhead facilities of any kind for electrical, telephone, or cable television service on said real estate (except such poles and overhead facilities as may be required at those places where distribution facilities enter and leave said subdivision, or existing and/or future overhead transmission or communication facilities on existing or future Alabama Power Company rights of way). Nothing herein shall be construed to prohibit overhead street lighting, or ornamental yard lighting, where serviced by underground wires or cables.

2. In order to beautify said Subdivision for the benefit of all lot owners and permit Alabama Power Company to install underground electric service to each house in said Subdivision for the mutual benefit of all lot owners therein, no owner of any lot within said Subdivision will commence construction of any house on any lot until such owner (1) notifies Alabama Power Company that such construction is proposed, (2) grants in writing to Alabama Power Company such rights and easements as Alabama Power Company deems necessary in connection with its construction, operation, maintenance, replacement and removal of underground service laterals of each lot, and (3) otherwise complies with the Rules and Regulations for Underground Residential Distribution on file with and approved by the Alabama Public Service Commission. Further, no plants, shrubs, fences, walls or other obstructions shall be placed in front of or within three (3) feet of any side of any pad-mounted equipment and Alabama Power Company shall not be liable for any damages to or destruction of any shrubs, trees, flowers, grass or other plants caused by the equipment or employees of the Company or its contractors engaged in the construction, operation, maintenance, replacement or removal of the Company's facilities. Appropriate meter locations must be obtained from Alabama Power Company prior to installing or relocating service entrance facilities and associated internal wiring. Owners must install meter sockets and service risers in accordance with the Company's specifications.

3. Alabama Power Company, its successors and assigns, will retain title to all underground facilities installed by the Company or its contractors, including but not limited to the service lateral serving each said house, and said service entrance facilities provided by Alabama Power Company will not in any way be considered a fixture or fixtures and thereby a part of said real estate, but will remain personal property belonging to Alabama Power Company, its successors and assigns, and will be subject to removal by Alabama Power Company, its successors and assigns, in accordance with applicable Rules and Regulations filed with and approved by the Alabama Public Service Commission.

4. These covenants and restrictions touch and concern and benefit the land and shall run with the land and shall be binding on Alabama Power Company, the undersigned, their respective heirs, successors and assigns. Invalidity of any one of the foregoing covenants and restrictions shall in no way affect any other provision contained herein.

All facilities on Grantor: _____

Station to Station: _____

IN WITNESS WHEREOF, this instrument has been executed this the 7th day of November, 2005.

WITNESS/ATTEST

Patricia Dowling

GRANTOR:

Homes + Land Corp
American Investments LLC
Name of Individual/Company/Partnership/LLC
Darryl W. Thomas Pres.
Signature of Individual/Officer/Partner

CORPORATE/PARTNERSHIP ACKNOWLEDGMENT

STATE OF ALABAMA }

County of Shelby }

I, Patricia Dowling, a Notary Public, in and for said County in said State, hereby certify that, Darryl W. Thomas whose name as Pres. of American Homes + Land, a corporation/partnership, is signed to the foregoing instrument, and who is known to me, acknowledged before me on this day that being informed of the contents of the instrument, he/she, as such officer/partner and with full authority, executed the same voluntarily for and as the act of said corporation/partnership.

Given under my hand and official seal, this the 7 day of November, 2005.

Patricia Dowling
Notary Public

My commission expires: 5/23/05

INDIVIDUAL ACKNOWLEDGMENT

STATE OF ALABAMA }


County of _____ }

I, _____, a Notary Public in and for said County, in said State, hereby certify that _____, whose name(s) (is/are) signed to the foregoing instrument, and who (is/are) known to me, acknowledged before me on this date that, being informed of the contents of the agreement, (has/have) executed the same voluntarily on the day the same bears date.

Given under my hand and official seal, this the _____ day of _____, 20____.

Notary Public

My commission expires: _____

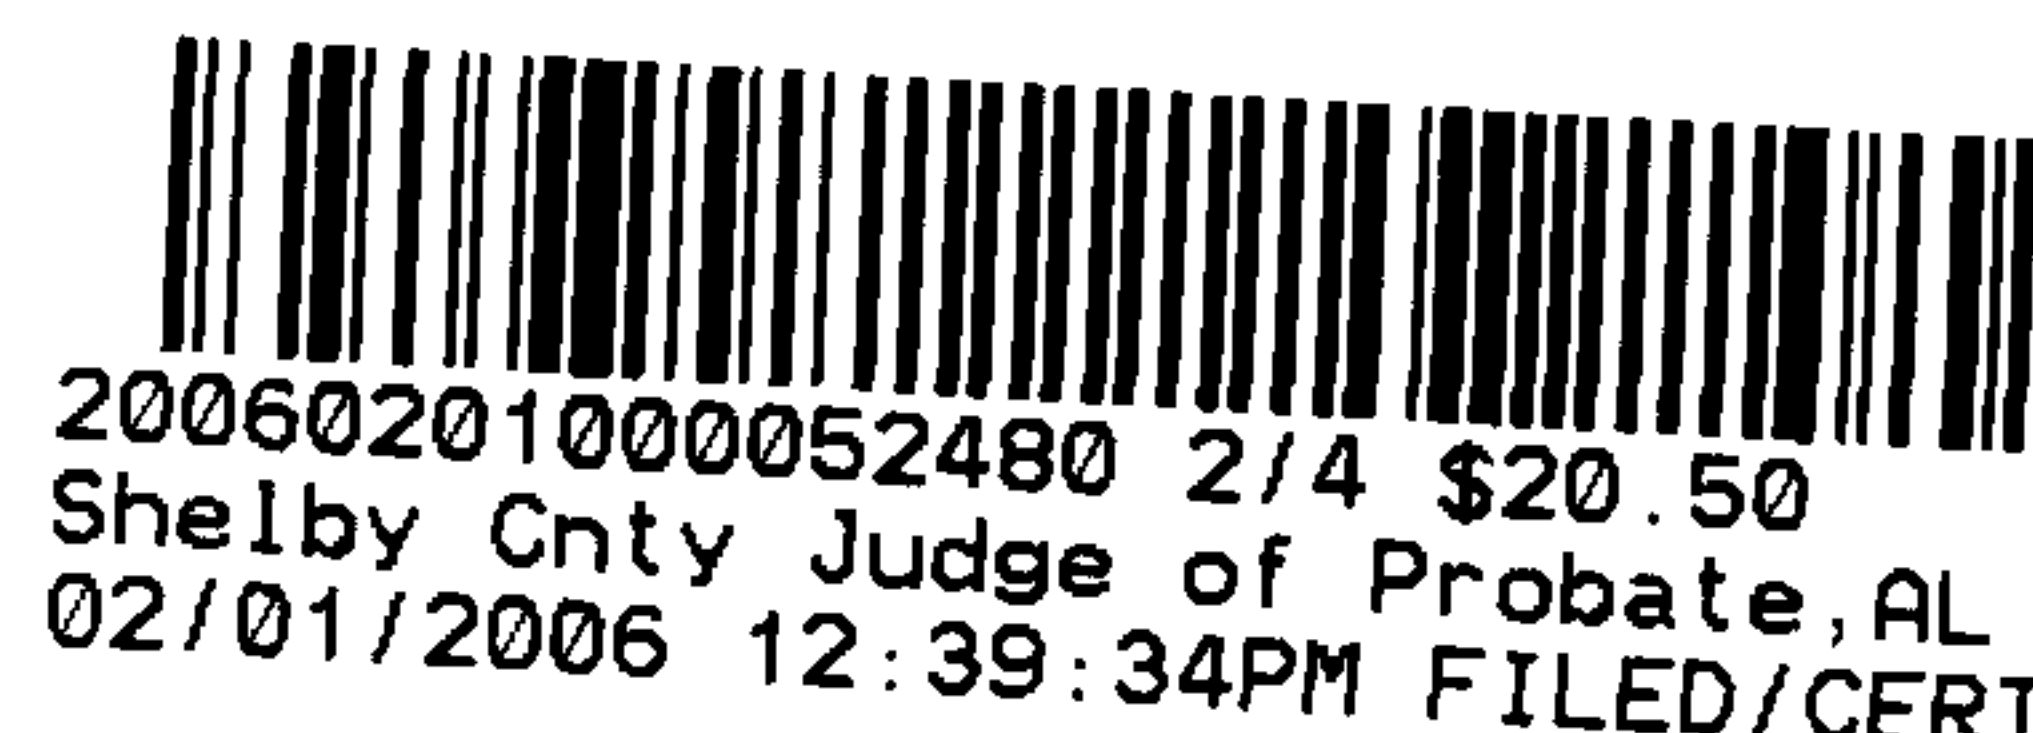

7062948A

1 20 10 17 18
10 20 21 22 23
1 SECONDARY PEDESTAL

1 167KVA 19.9KV POINT XFMR
PROP LOAD = 191.2
1 BOX PAD

1 37.5KVA XFMR
1 167KVA 19.9KV POINT XFMR
PROP LOAD = 156.6KVA

1 30 DE VERT ON EXISTING POLE
1 10TH 17R (2) 3/8"STR
(15' MIN LEAD)

1 45/4 POLE
1 30 VERT
1 10TH 17R (2) 3/8"STR
(15' MIN LEAD)

1 45/4 POLE
1 30 VERT
1 10TH 17R (2) 3/8"STR
(15' MIN LEAD)

1 167KVA 19.9KV POINT XFMR
PROP LOAD = 172.6
1 BOX PAD

1 167KVA 19.9KV POINT
SWITCHABLE XFMR
PROP LOAD = 154KVA
1 BOX PAD


1 45/4 POLE
1 30 VERT

1 45/4 POLE
1 30 PRI TANG ON PTP, 20 BKT
1 30 RISER (FUSE @ 50A)

1 45/4 POLE
1 30 PRI TANG ON PTP, 20 BKT
1 30 RISER (FUSE @ 50A)

1 45/4 POLE
1 30 PRI TANG ON PTP, 20 BKT
1 (3) 10 RISERS (FUSE @ 50A)

- NOTES
- 1 RISER LOADING BASED ON BINA PER LOT
 - 2 TRANSFORMER LOADING BASED ON L, F, R, J, WH, ZT & JT A/C
 - 3 FLICKER CALCULATED ON A JT A/C
 - 4 ALL ROAD CROSSINGS WILL COMPLY WITH SHELBY COUNTY'S REQ
 - 5 ALL SECONDARY FROM TRANSFORMER TO SECONDARY PEDESTAL TO BE 1 #3/0 & 2 #250 AL XLPE 60KV CABLE
 - 6 MAXIMUM VOLTAGE DROP CALCULATED AT LOT 1899 IS 4.44%
 - 7 MAXIMUM FLICKER CALCULATED AT LOT 1899 IS 1.90%
 - 8 APCO CONTRACTOR TO PERFORM ALL DITCHING, INSTALL ALL THE (CONDUITS, TRANSFORMER PADS AND GROUND RODS
 - 9 FUSE ALL RISERS 50A
 - 10 PRIMARY CABLE TO BE #1/0 ALUM 35KV CABLE DIRECT BURIED 42 GRADE, EXCEPT WHERE NOTED

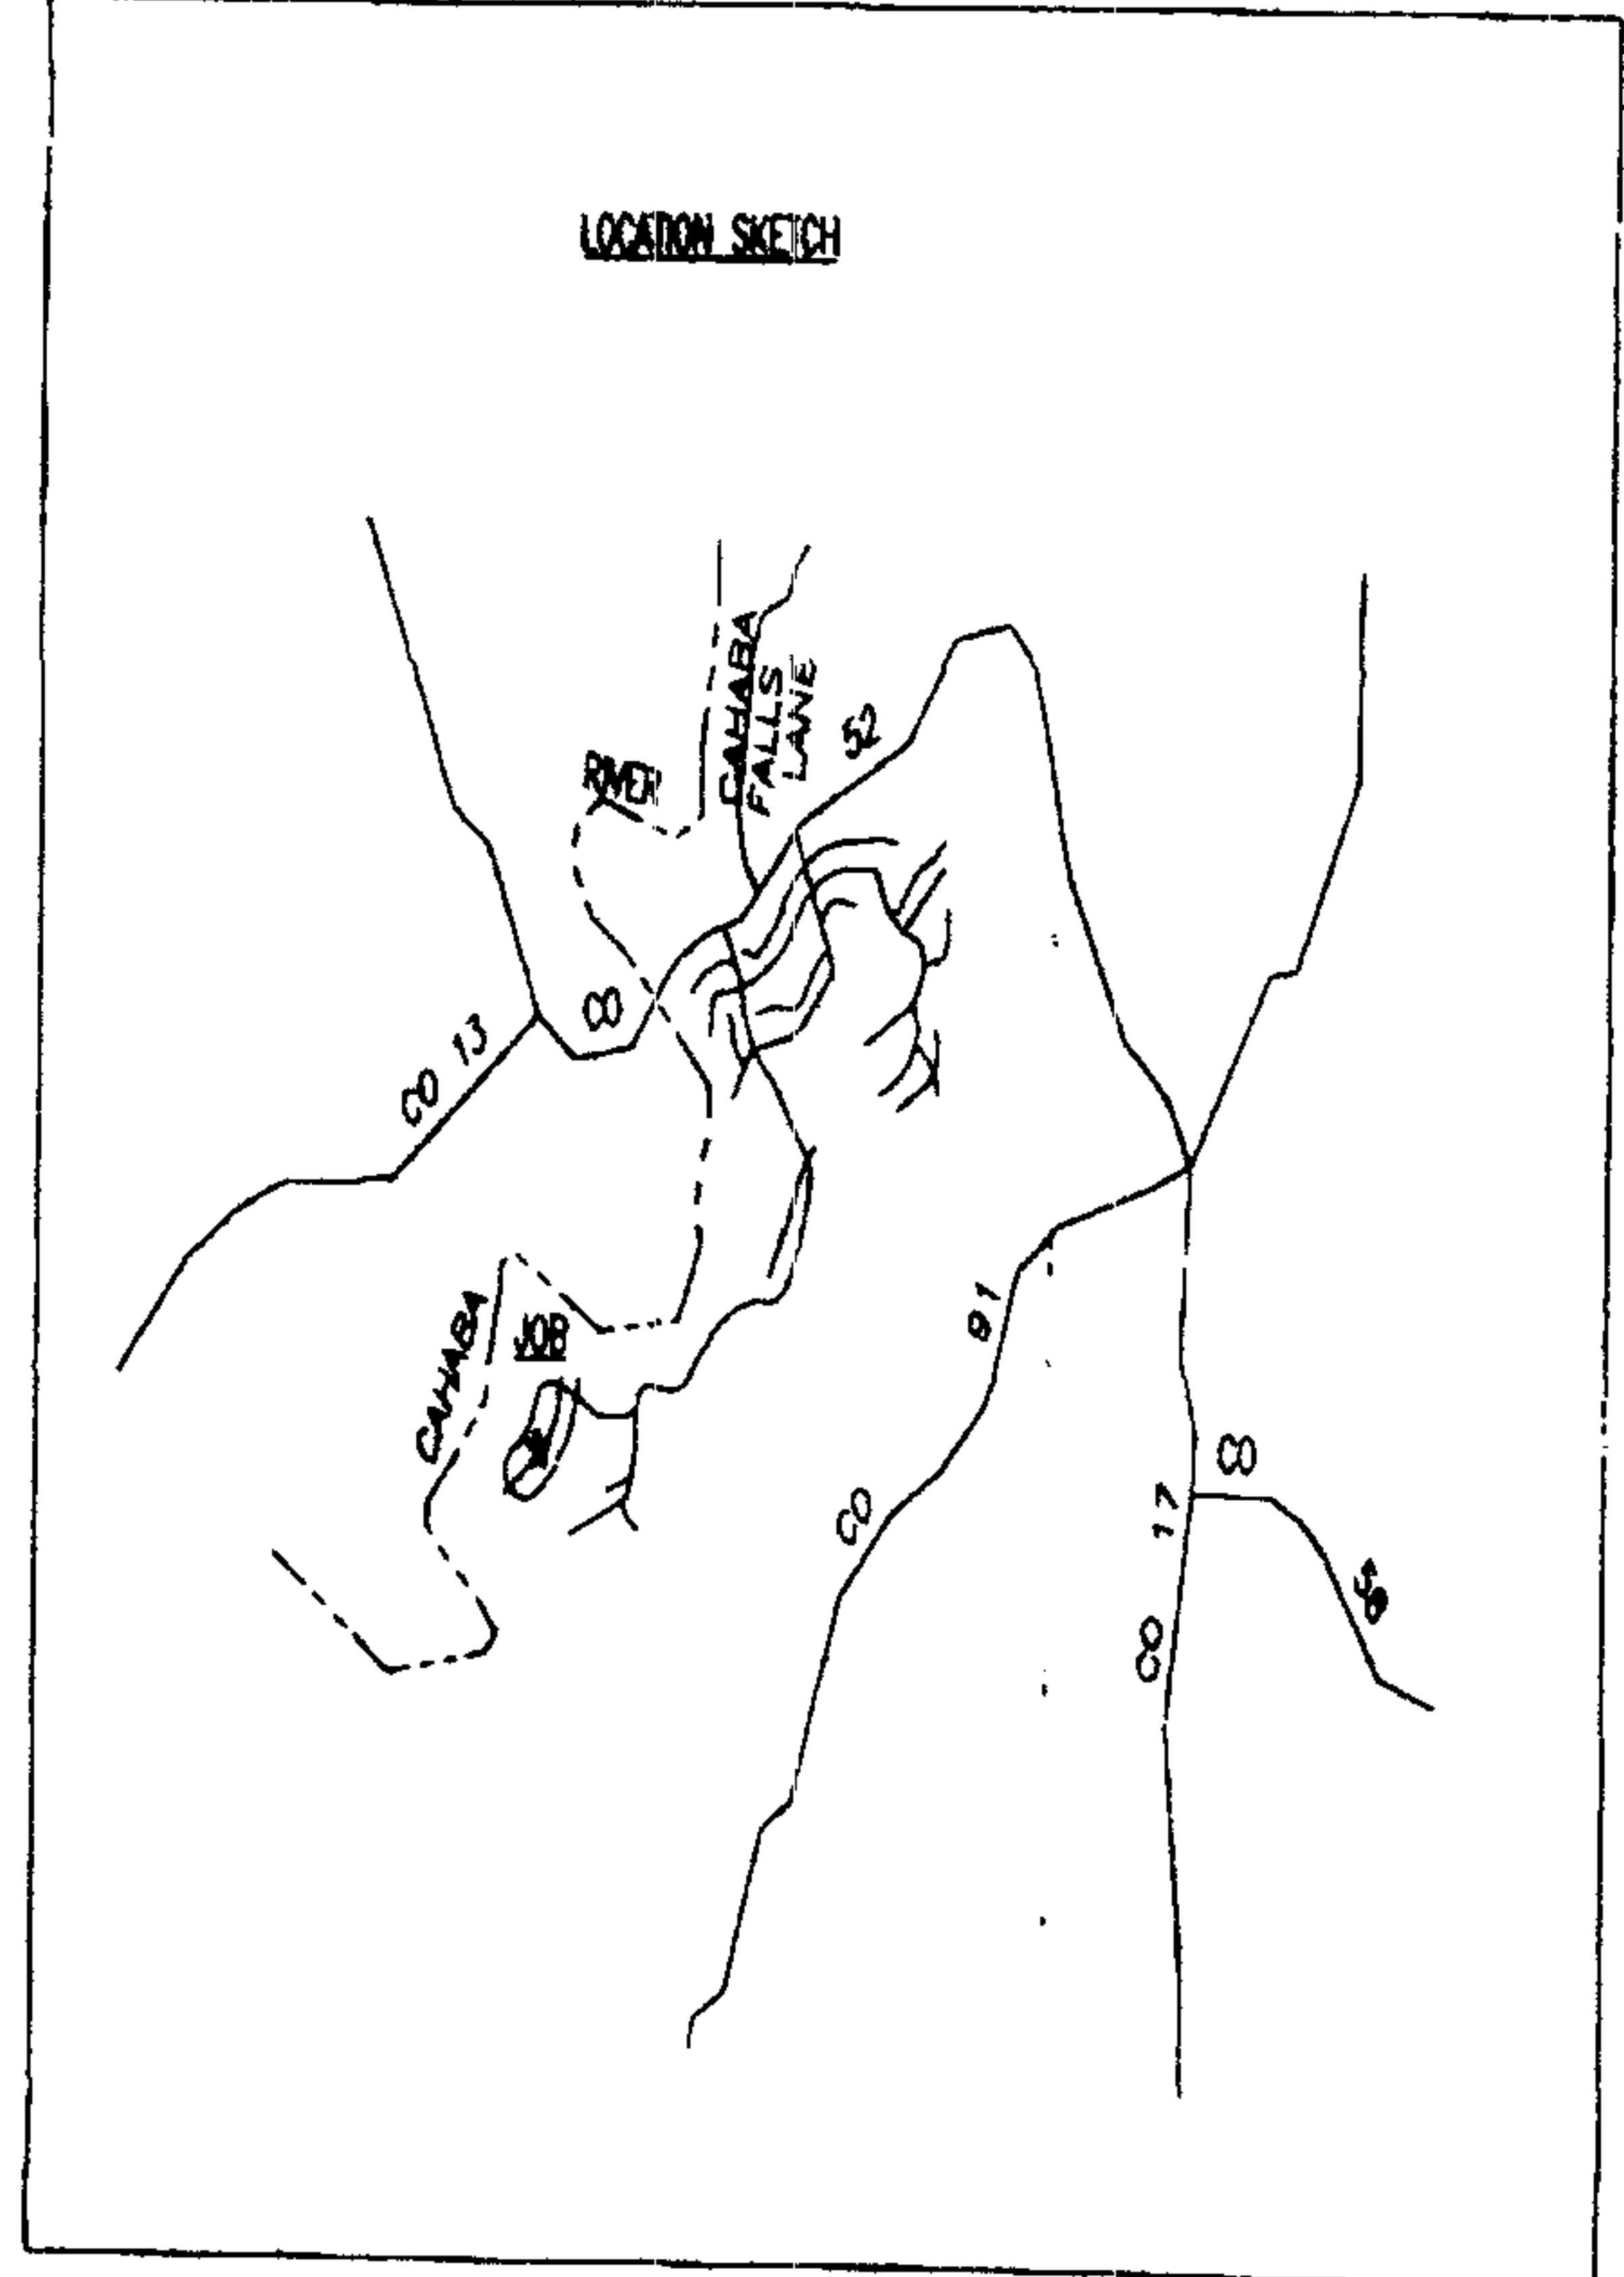


CONSTRUCTION

DATE: _____

ANY CONSTRUCTION FIELD
ARE SHOWN IN RED ON T

- DEVELOPER CONTRACTOR TO PROVIDE
- 1 COMPACTED GRAVEL ACCESS ROAD
 - 2 CONCRETE PAD FOR 30 SEWAGE PUMP STATION
 - 3 SECONDARY CONDUCTORS TO PUMP

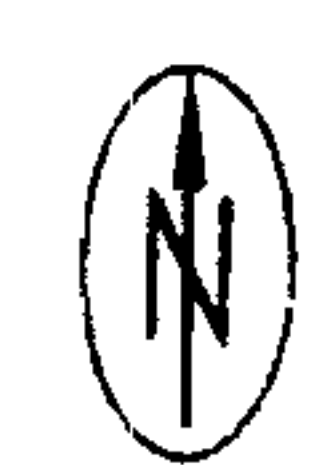


0 100 200
PLAN SCALE

AUTOMATED DRAWING - MAKE NO 4

ALABAMA POWER (

TOWN.	COUNTY.	JOB	POWER DELIVERY - BIRM
MAP REF 3W-20-20,21	SEC-20,21(TP-20S.R-3W)	DETAIL	OLD CANAHA SUBDIVISION PHASE V SECTION 7


CHANGE LOCATIONS 11, 12, 15, & 20 (CONDUIT CABLE)
TO W.E.S. 6700-00-0000

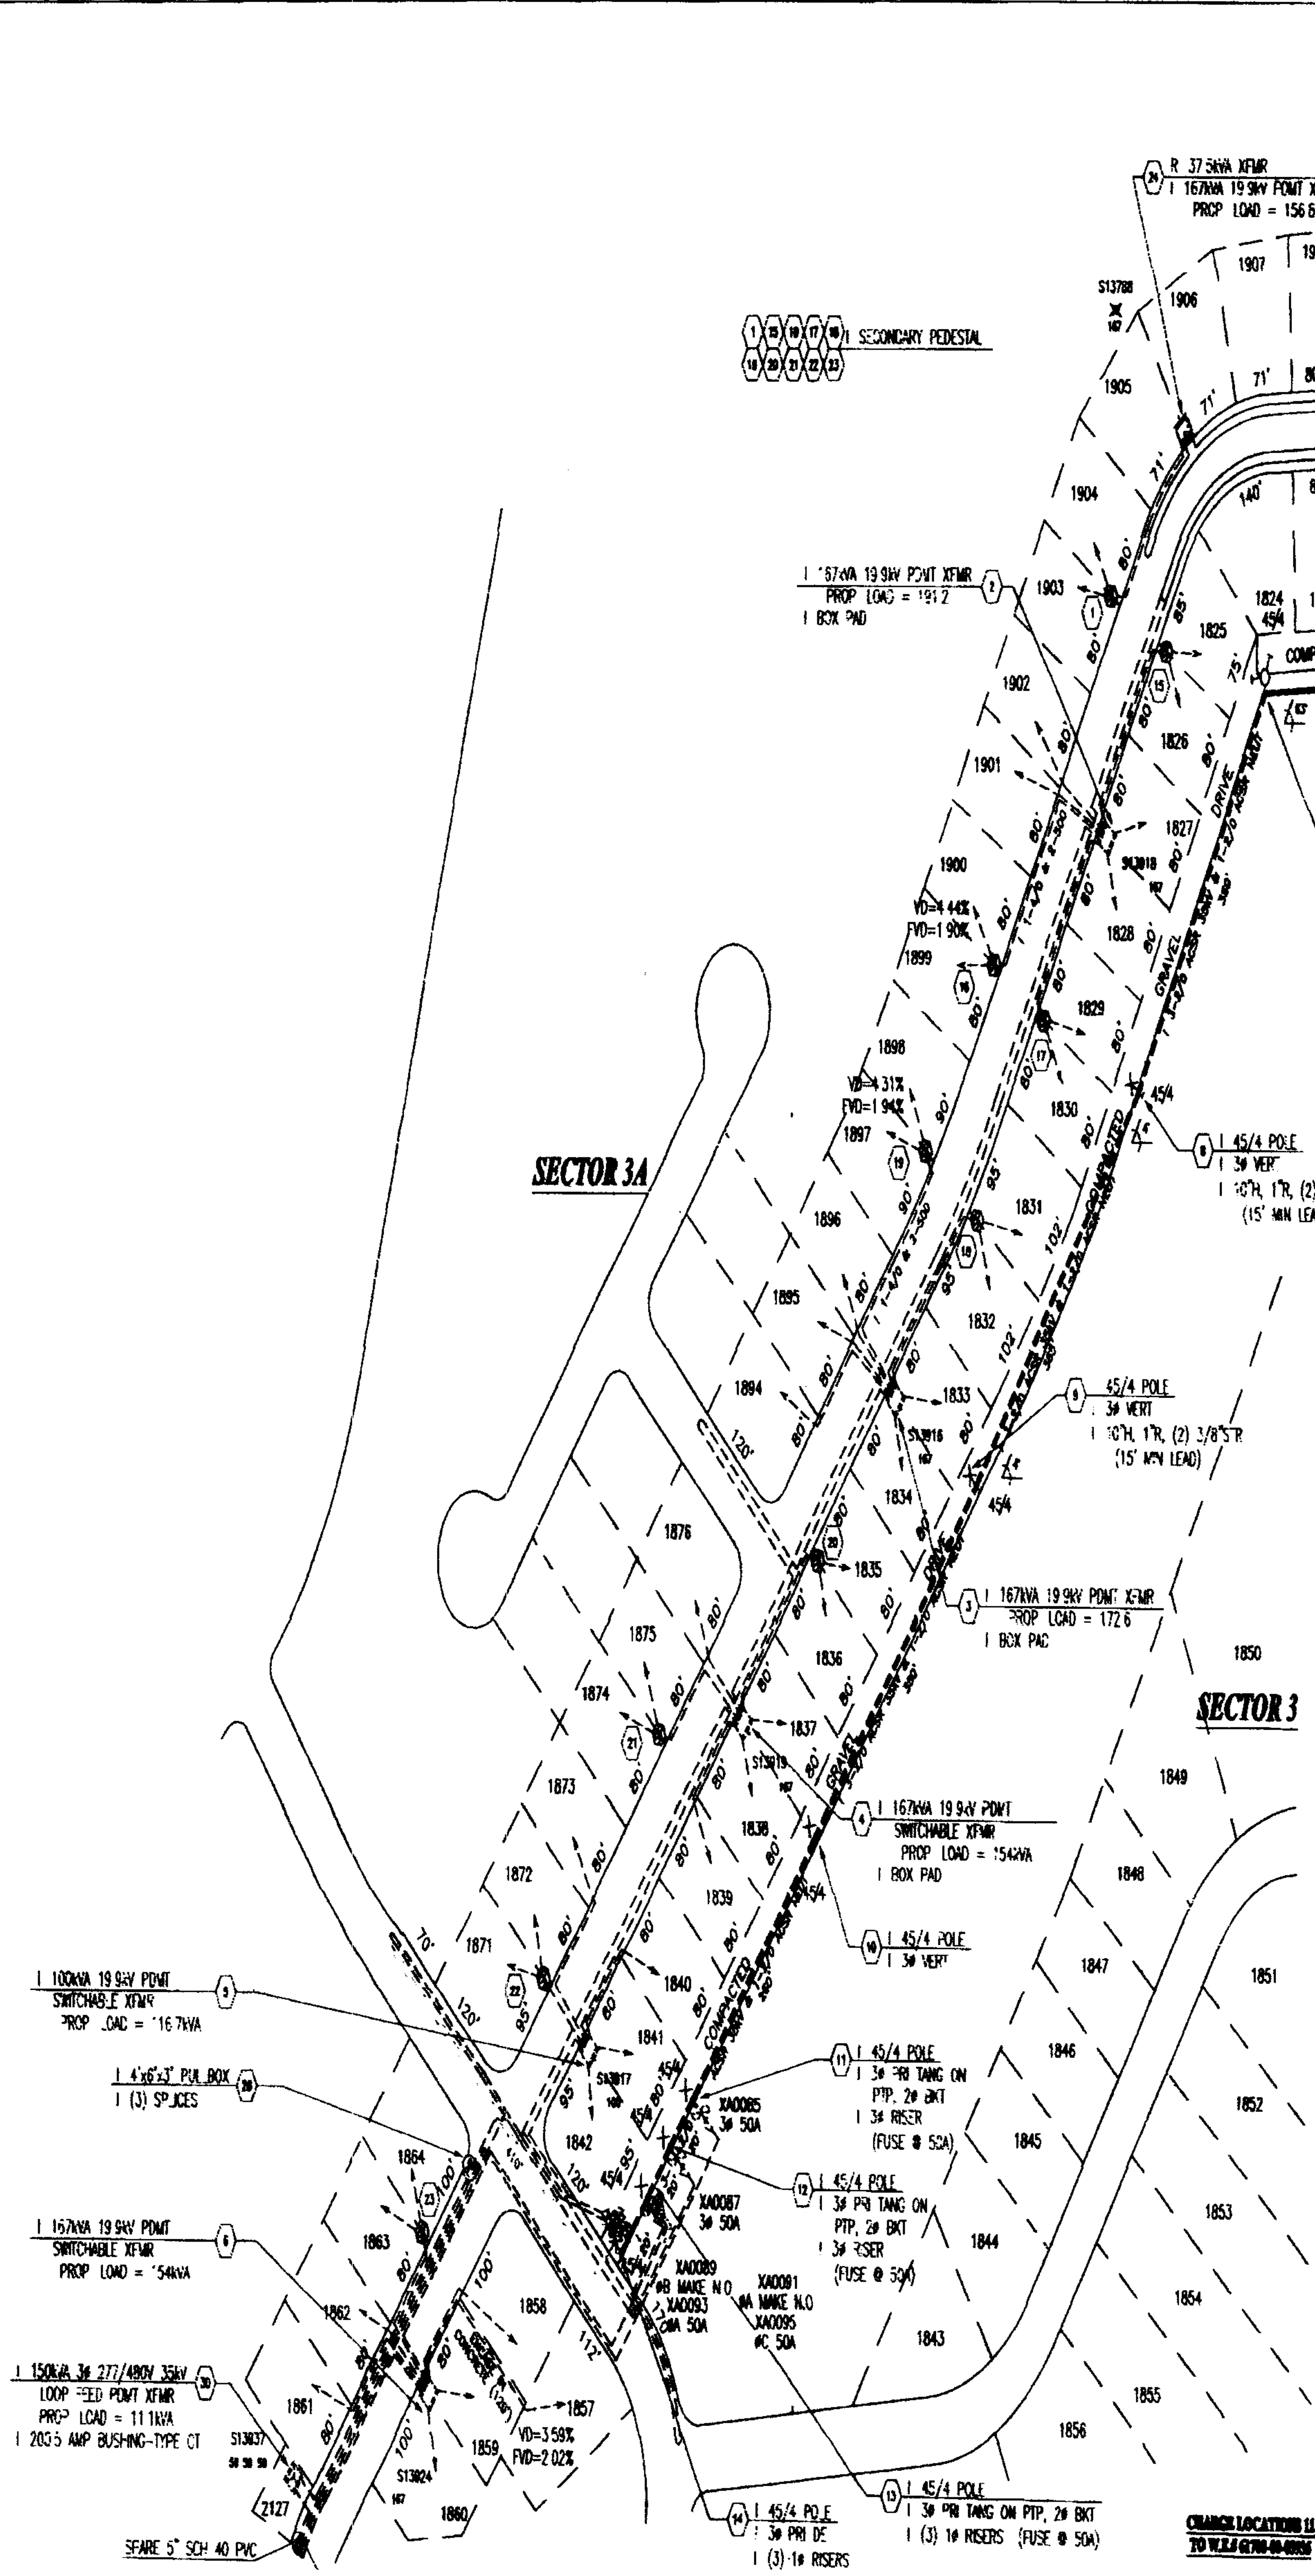

7/26/2006




20060201000052480 4/4 \$20.50
Shelby Cnty Judge of Probate, AL
02/01/2006 12:39:34PM FILED/CERT

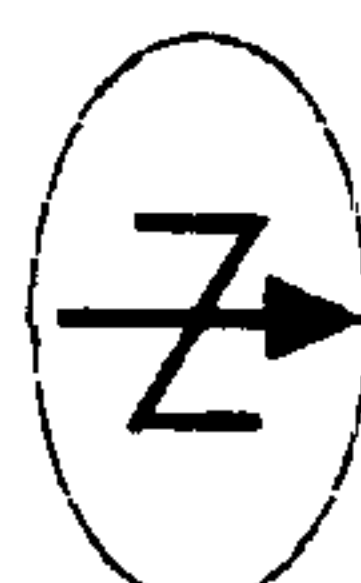

SECTIONALIZING SHEET
SUBSTATION: HELENA D.S. #2
BREAKER #30524
SHORT CIRCUIT VALUES
LL=5128
LL=44

ABR LOADING

EXISTING:
XA-0089 TO S-12503 = 8A EMERGENCY = 18A
S-11280 TO XA-3503 = 9A EMERGENCY = 18A
XA-0067 TO S-12517 = 25A EMERGENCY = 25A
S-12516 TO XA-8117 = 25A EMERGENCY = 25A
XA-0073 TO XA-0089 = 11A EMERGENCY = 11A
XA-0071 TO XA-0095 = 7A EMERGENCY = 7A
XA-0093 TO XA-0091 = 3A EMERGENCY = 3A

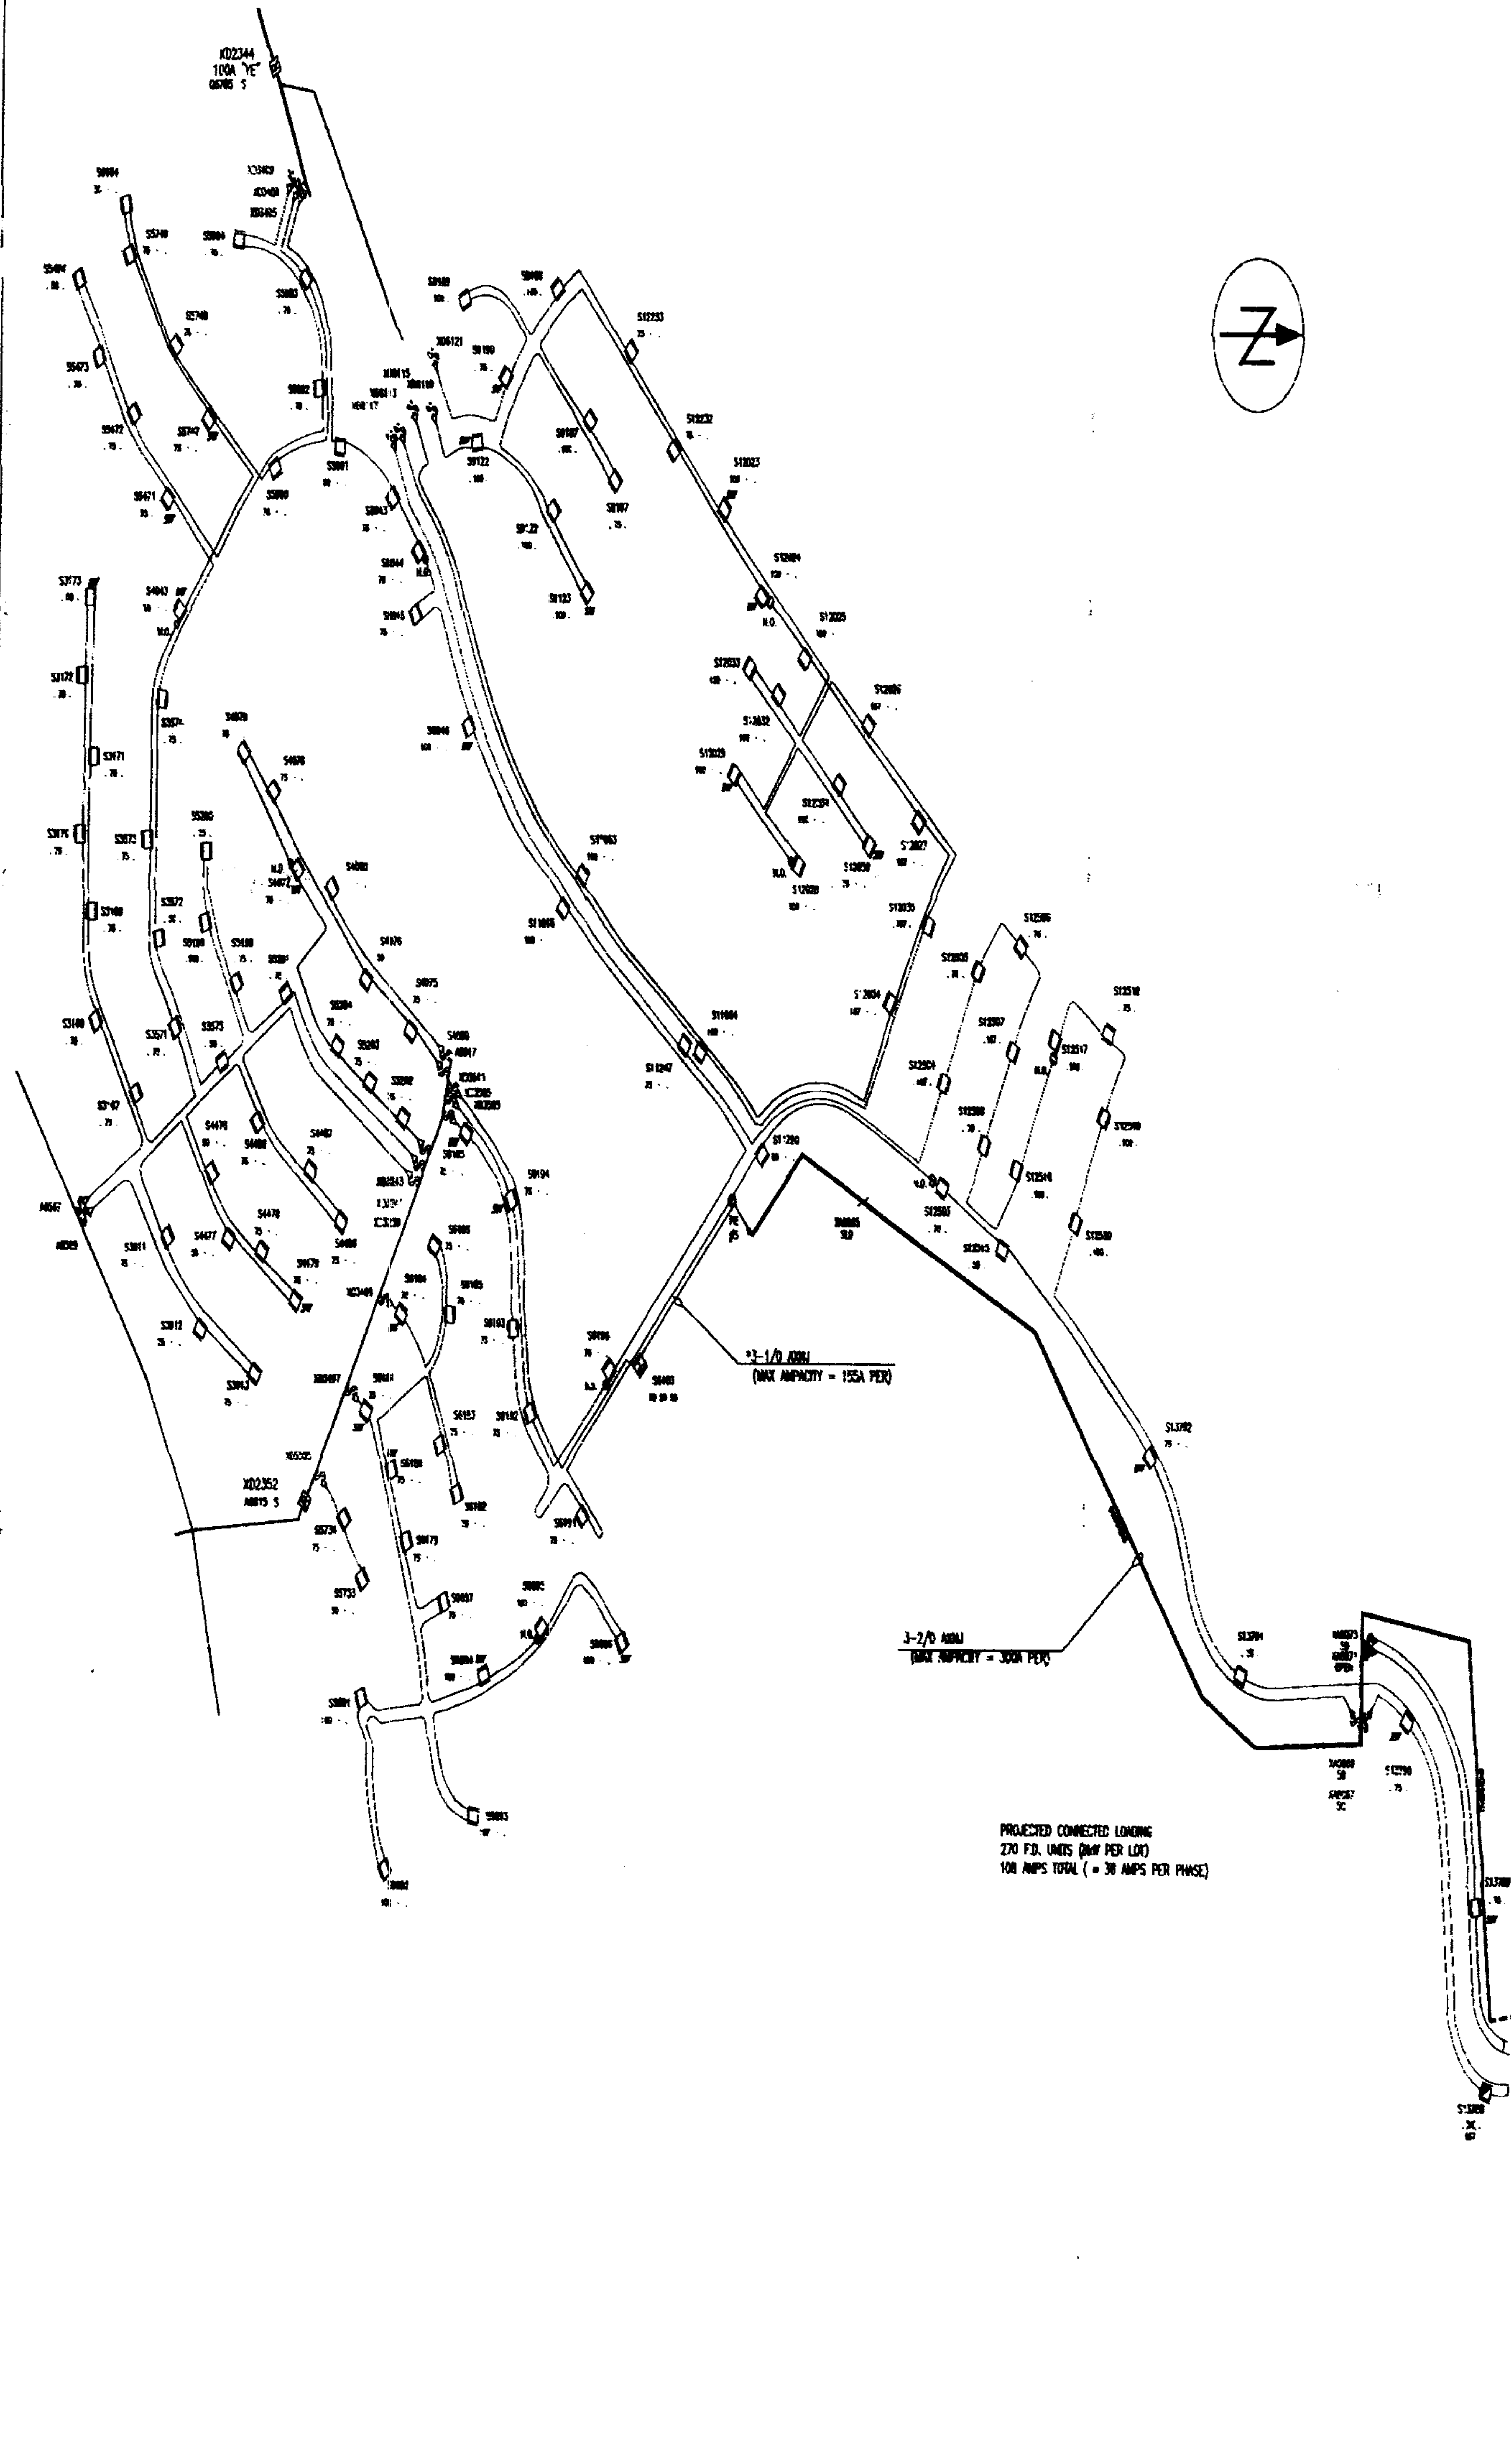

3-1/2 ABRU
(MAX AMPCITY = 155A PER)

PROJECTED CONNECTED LOADING
270 F.D. UNITS (MAX PER LCU)
100 AMPS TOTAL (= 30 AMPS PER PHASE)

