

EAST Pelham-Double OAK Mountain 115 KV TL
STA 89+21.91
(A-407186)

PLANTATION PIPE LINE COMPANY

\$14.50

SERVING THE SOUTHEAST SINCE 1940

In SE 1/4 of SW 1/4 of Section 14,
And in the NE 1/4 of NW 1/4 of Section 23,
both in Township 20 South,
Range 2 West,
Shelby County, ALABAMA

File Ref No.: 10.2.2.3.8

R/W Section 5A

Plot# 253.1 & 254.1

June 1, 2006

70177682
(TL-27-3-6)

Mr. Jerry D. Roberson
Alabama Power Company
600 North 18th Street
Post Office Box 2641
Birmingham, AL 35291



20061212000600880 1/2 \$14.50
Shelby Cnty Judge of Probate, AL
12/12/2006 10:27:20AM FILED/CERT

**RE: To construct two aerial electrical distribution lines across the right of way
at East Pelham-Double Oak Mt. 115 Kv TL in Shelby County, Alabama.**

Dear Mr. Roberson:

Plantation Pipe Line Company has inspected the area located in the SE 1/4 of the SW 1/4 in Section 14, Township 20 South, Range 2 West, and in the NE 1/4 of the NW 1/4 in Section 23, Township 20 South, Range 2 West, Shelby County, Alabama, along with referenced drawings pertaining to this crossing. After inspecting the area and reviewing the drawings, we find them to be in compliance with our crossing specifications. Therefore, please consider this letter as authorization to construct, operate, and maintain the above referenced distribution line.

Please note Plantation requires **48 hours advance notice** prior to the actual work being performed. This is necessary so that a Plantation representative may be present while the work is in progress.

Plantation Pipe Line appreciates your cooperation and if you have any questions, please contact Ross Williams at 663-8844 or John Adams at 663-8848.

Sincerely,

W.R. Williams

W.R. Williams
O & M Supervisor

Shelby County, AL 12/12/2006
State of Alabama

Deed Tax: \$.50



P.O. BOX 489, Helena, AL 35080
900 Shelby Co. Hwy. 52 East, Helena, AL 35080

Dig Safely

SHELBY COUNTY
T-20-S, R-2-W
SECTIONS 23, 14

70177682
(72-27-3-6)

STR. #12
125/H105
BLP

STR. #11
150
BLP

735' SPAN
TO STR. #13



813' SPAN
TO STR. #10

LEGEND

- X NEW STRUCTURE
- EXISTING STRUCTURE

SPECIFICATIONS

MINIMUM CLEARANCE SHOWN @
212°F FINAL
LINE DESIGNED FOR MEDIUM
LOADING (1/4" ICE, 4# WIND, 15°F)

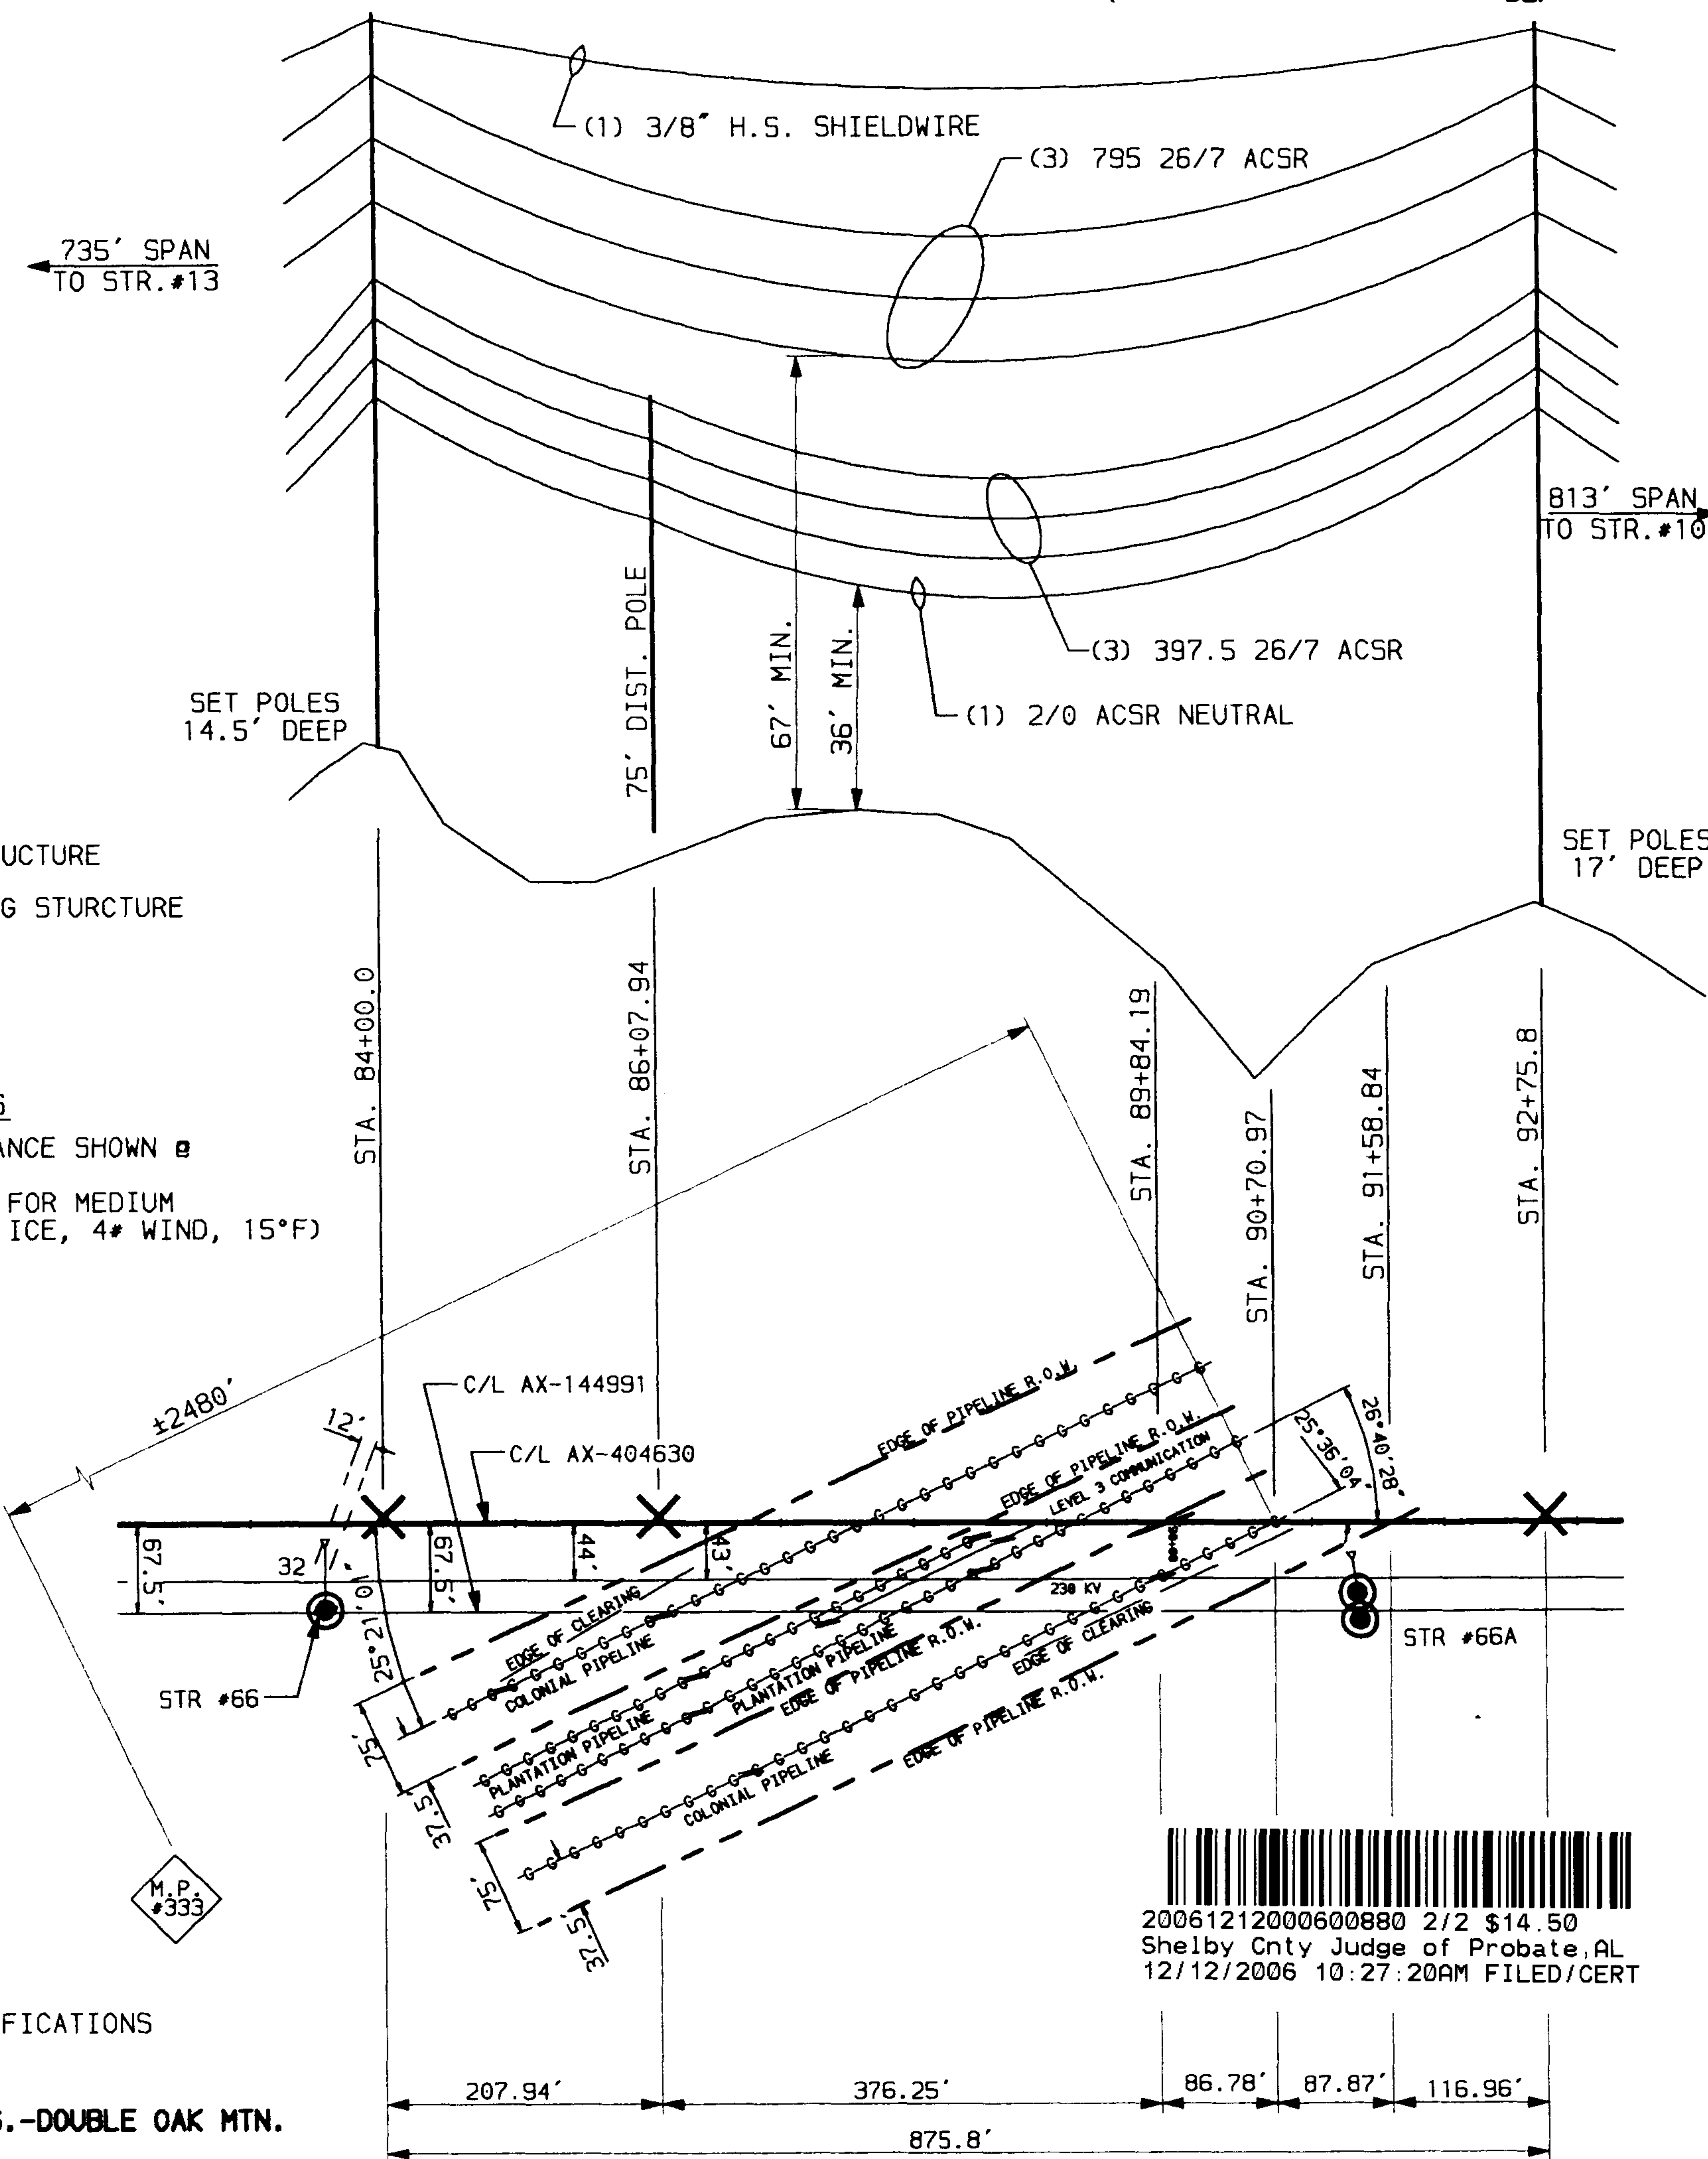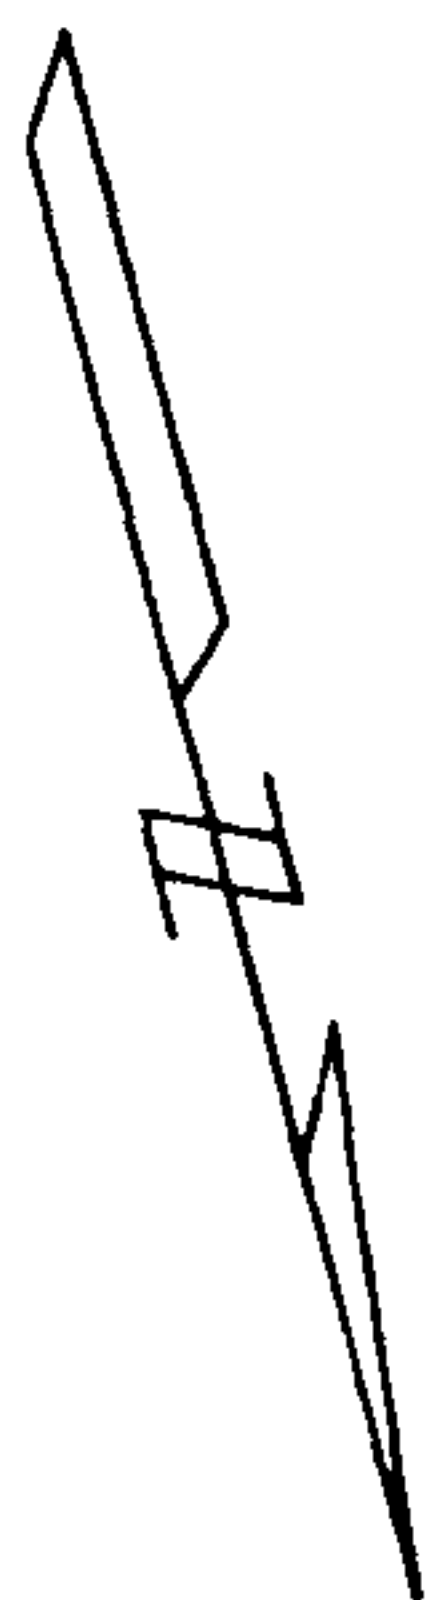

REFERENCES:

A-405738 SPECIFICATIONS

DIV. LINE NAME,
EAST PELHAM T.S.-DOUBLE OAK MTN.
D.S. 115KV
DIV. LINE #, 123080

ACC LINE NAME, DOUBLE OAK MTN - EAST PELHAM 115KVTL
ACC LINE #, 695



20061212000600880 2/2 \$14.50
Shelby Cnty Judge of Probate, AL
12/12/2006 10:27:20AM FILED/CERT

COMPUTER PREPARED DRAWING. MAKE
NO MANUAL CHANGES. RETURN TO
POWER DELIVERY TRANSMISSION

CAD

CV
MEDUSA

DR	NO.	DATE	REVISION
CBW	-	-	-
DA 5/06			
CK TM			

APP REW
DATE 5/06

SUPERSEDES

ALABAMA POWER COMPANY

SUBJECT EAST PELHAM - DOUBLE OAK MOUNTAIN 115KV T.L.
DETAIL GAS LINE CROSSING AT STA. 90+70.97