

20.50

**GRANT OF LAND EASEMENT and
RESTRICTIVE COVENANTS for
Underground Facilities in Subdivision**

DOCUMENT TO BE RECORDED

**(NOTE: DO NOT RECORD WITHOUT
ATTACHED PLAT OR DRAWING!)**

STATE OF ALABAMA }

COUNTY OF Shelby }

W.E. No. 61700-08-00467

Parcel No. 70194419

This instrument prepared by:

Matt Fields

Alabama Power Company
Corporate Real Estate
P. O. Box 2641
Birmingham, Alabama 35291

07 JUN 12 PM 4:16

Sta. 1+00 to 5+00

KNOW ALL MEN BY THESE PRESENTS, THAT: WHEREAS, the "Grantor", (whether one or more) are owners of record of the following described real estate in Shelby County, Alabama, to wit: Ballantyne Glenberry (Phase 2) the "Subdivision" as shown on the plat or drawing attached and incorporated herein by reference, which Grantor plans to record in the Office of the Judge of Probate, Shelby County, Alabama (the "Property") (SW $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 28, Township 20, Range 2) and,

WHEREAS, the said Grantor desires to grant to Alabama Power Company, (the "Company") an easement for underground electrical facilities and to establish and place the Subdivision under certain restrictive covenants to insure the use of the property for attractive residential purposes and thereby to secure to each lot owner the same advantages insured to other lot owners.

NOW, THEREFORE, The Grantor, for and in consideration of *One and No/100 Dollars (\$1.00)*, and other good and valuable consideration, to Grantor in hand paid by the Company, the receipt of which is hereby acknowledged, does hereby grant to Company, its successors and assigns, the right to construct, install, operate, maintain and replace, along a route to be selected by the Company (generally shown on the attached drawing), its successors or assigns, all conduits, cables, transformers, and other appliances and facilities (above ground and below ground) useful or necessary in connection therewith, for the underground transmission and distribution of electric power upon, under and across the Property.

Together with all the rights and privileges necessary or convenient for the full enjoyment or use thereof, including the right of ingress and egress to and from said facilities and the right to excavate for installation, replacement, repair and removal thereof; and also the right to cut and keep clear any and all obstructions or obstacles of whatever character on, under and above said facilities.

TO HAVE AND TO HOLD such easement to the Company, its successors and assigns, forever.

And, the undersigned Grantor further does hereby adopt the following conditions, restrictions, covenants and limitations which shall apply in their entirety to all lots in the said Subdivision and shall run with the title to said property, and which shall be included in any conveyance of title to any or all of said lots in said subdivision:

1. The owners of lots within the Subdivision will not erect or grant to any person, firm or corporation the right, license or privilege to erect or use or permit the use of overhead wires, poles or overhead facilities of any kind for electrical, telephone, or cable television service on said real estate (except such poles and overhead facilities as may be required at those places where distribution facilities enter and leave said subdivision, or existing and/or future overhead transmission or communication facilities on existing or future Alabama Power Company rights of way). Nothing herein shall be construed to prohibit overhead street lighting, or ornamental yard lighting, where serviced by underground wires or cables.

2. In order to beautify said Subdivision for the benefit of all lot owners and permit Alabama Power Company to install underground electric service to each house in said Subdivision for the mutual benefit of all lot owners therein, no owner of any lot within said Subdivision will commence construction of any house on any lot until such owner (1) notifies Alabama Power Company that such construction is proposed, (2) grants in writing to Alabama Power Company such rights and easements as Alabama Power Company deems necessary in connection with its construction, operation, maintenance, replacement and removal of underground service laterals of each lot, and (3) otherwise complies with the Rules and Regulations for Underground Residential Distribution on file with and approved by the Alabama Public Service Commission. Further, no plants, shrubs, fences, walls or other obstructions shall be placed in front of or within three (3) feet of any side of any pad-mounted equipment and Alabama Power Company shall not be liable for any damages to or destruction of any shrubs, trees, flowers, grass or other plants caused by the equipment or employees of the Company or its contractors engaged in the construction, operation, maintenance, replacement or removal of the Company's facilities. Appropriate meter locations must be obtained from Alabama Power Company prior to installing or relocating service entrance facilities and associated internal wiring. Owners must install meter sockets and service risers in accordance with the Company's specifications.

3. Alabama Power Company, its successors and assigns, will retain title to all underground facilities installed by the Company or its contractors, including but not limited to the service lateral serving each said house, and said service entrance facilities provided by Alabama Power Company will not in any way be considered a fixture or fixtures and thereby a part of said real estate, but will remain personal property belonging to Alabama Power Company, its successors and assigns, and will be subject to removal by Alabama Power Company, its successors and assigns, in accordance with applicable Rules and Regulations filed with and approved by the Alabama Public Service Commission.

4. These covenants and restrictions touch and concern and benefit the land and shall run with the land and shall be binding on Alabama Power Company, the undersigned, their respective heirs, successors and assigns. Invalidity of any one of the foregoing covenants and restrictions shall in no way affect any other provision contained herein.

All facilities on Grantor: _____

Station to Station: _____

IN WITNESS WHEREOF, this instrument has been executed this the 1st day of June, 2007.

WITNESS/ATTEST

GRANTOR: Mobley Development, Inc.

By: J. Steven Mobley, President
Name of Individual/Company/Partnership/LLC

J. Steven Mobley
Signature of Individual/Officer/Partner

=====

CORPORATE/PARTNERSHIP ACKNOWLEDGMENT

STATE OF ALABAMA }

County of Jefferson }

I, Linda W. Roberts, a Notary Public, in and for said County in said State, hereby certify that, J. Steven Mobley whose name as President of Mobley Development, Inc., a corporation/partnership, is signed to the foregoing instrument, and who is known to me, acknowledged before me on this day that being informed of the contents of the instrument, he/she, as such officer/partner and with full authority, executed the same voluntarily for and as the act of said corporation/partnership.

Given under my hand and official seal, this the 1st day of June, 2007.

Linda W. Roberts
Notary Public

My commission expires: 3/29/09

=====

INDIVIDUAL ACKNOWLEDGMENT

STATE OF ALABAMA }

County of _____ }

I, _____, a Notary Public in and for said County, in said State, hereby certify that _____, whose name(s) (is/are) signed to the foregoing instrument, and who (is/are) known to me, acknowledged before me on this date that, being informed of the contents of the agreement, (has/have) executed the same voluntarily on the day the same bears date.

Given under my hand and official seal, this the _____ day of _____, 20____.


Shelby County, AL 11/14/2007
State of Alabama

Deed Tax: \$.50

20071114000522090 2/4 \$20.50
Shelby Cnty Judge of Probate, AL
11/14/2007 10:45:44AM FILED/CERT

Notary Public

My commission expires: _____

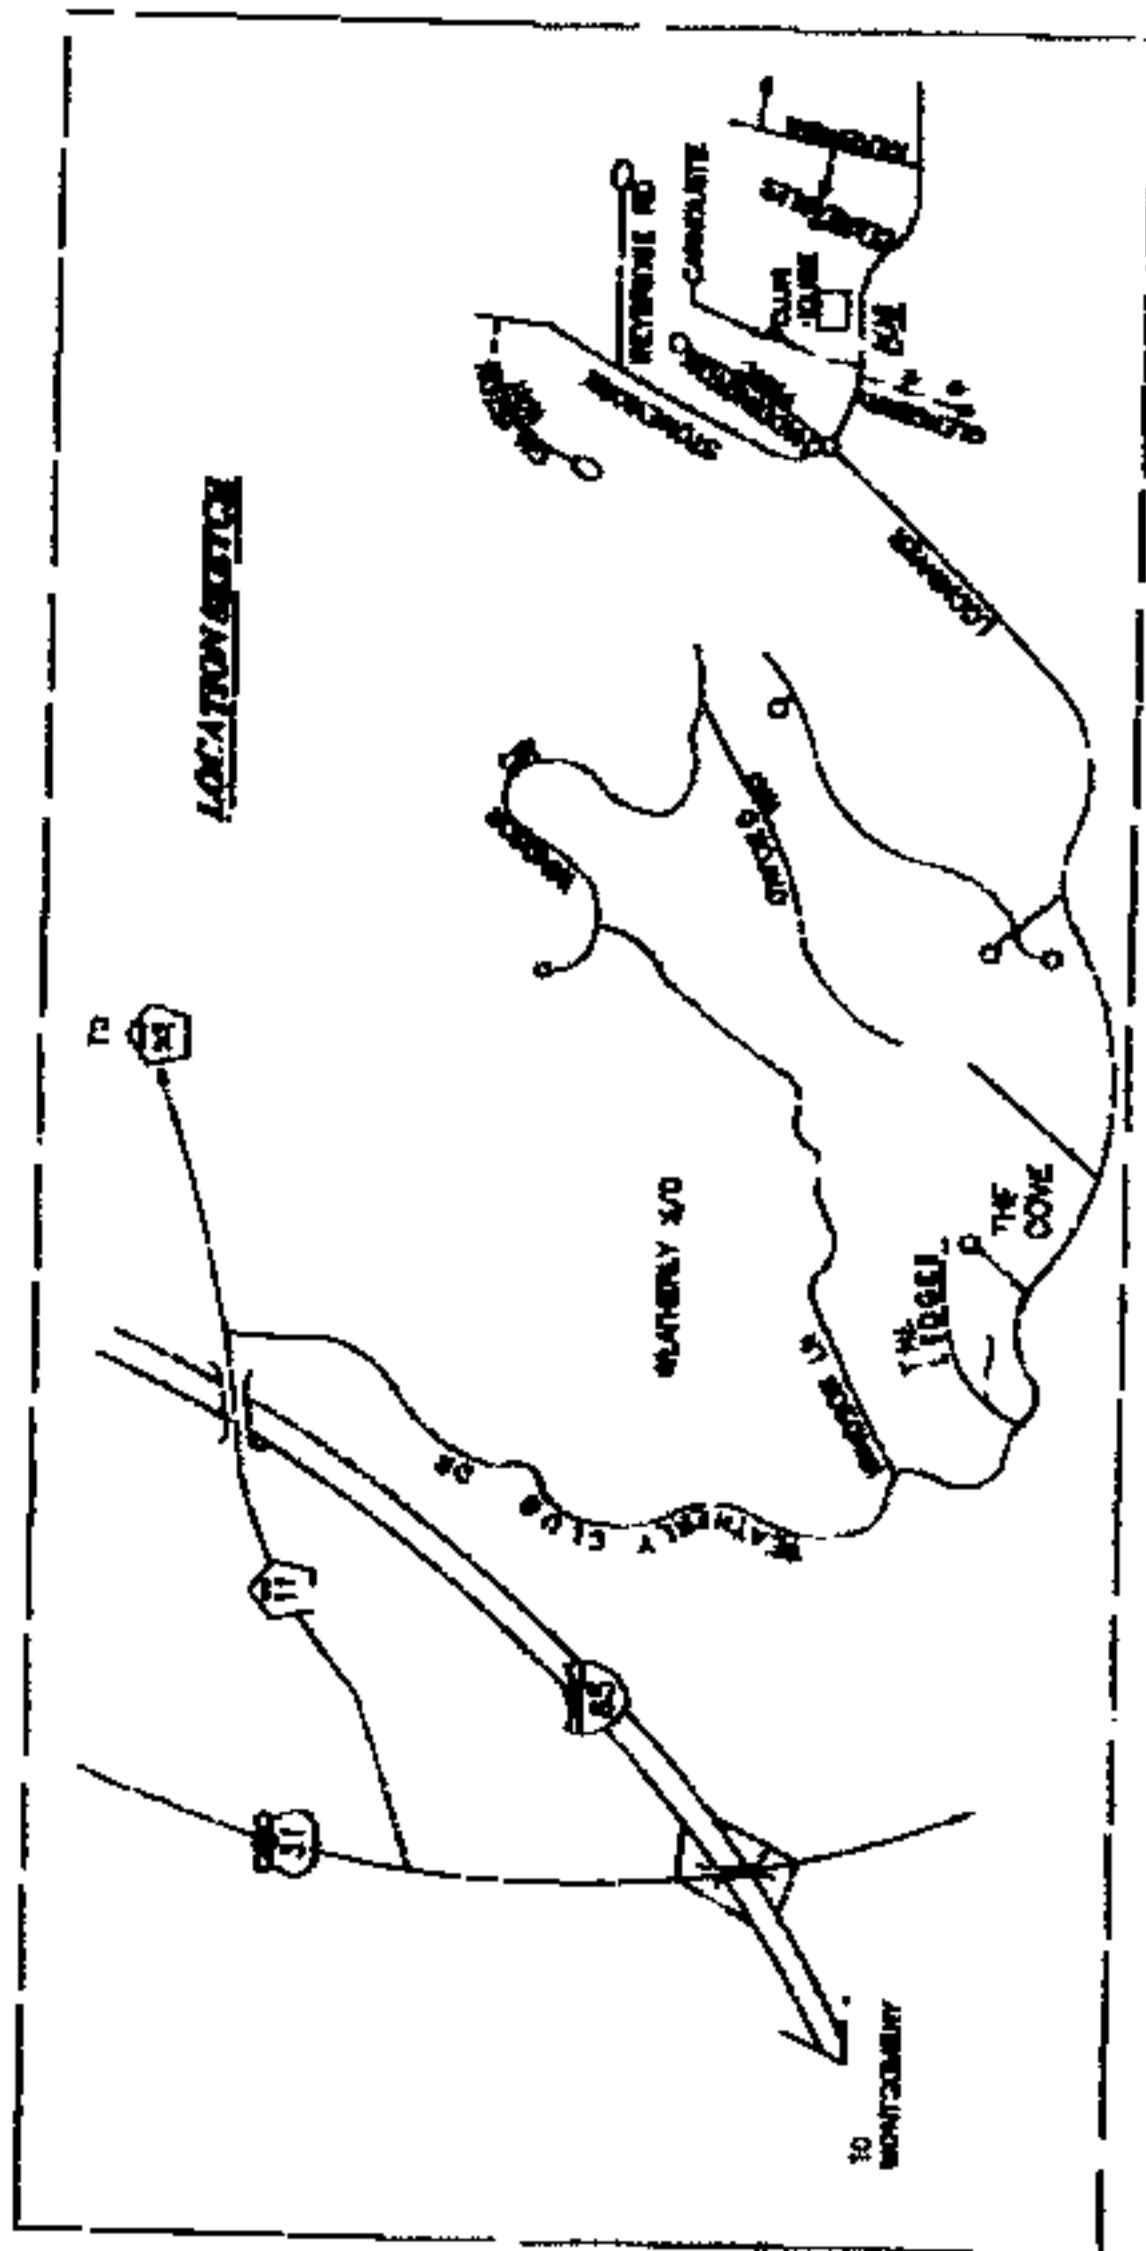

1. (REFR. LOADING BASED ON DATA PER LOT)
2. MAXIMUM LOADING BASED ON 2400 LB. 3200 SQA. 1141 PLYM/GRS. 1141 COOLING.
3. 1/2" MAX. CRACK TO BE 1/4" ON 10"
4. 1/4" MAX. CRACK TO BE 1/4" ON 10"
5. ALL ROAD CROSSINGS MUST COMPLY WITH FOLLOWING:
6. ALL SECONDARY FROM CONCRETE TO 2' W/ 1/2" X 1/2" X 1/2" ALLOW DMPF
7. ALL SECONDARY TO 2' W/ 1/2" X 1/2" X 1/2" ALLOW DMPF
8. MAXIMUM VOLUME CRACKS TO BE 1/4" ON 10"
9. MAXIMUM CRACKS TO BE 1/4" ON 10"
10. MAXIMUM CRACKS TO BE 1/4" ON 10"
11. MAXIMUM CRACKS TO BE 1/4" ON 10"
12. MAXIMUM CRACKS TO BE 1/4" ON 10"
13. MAXIMUM CRACKS TO BE 1/4" ON 10"
14. MAXIMUM CRACKS TO BE 1/4" ON 10"
15. MAXIMUM CRACKS TO BE 1/4" ON 10"
16. MAXIMUM CRACKS TO BE 1/4" ON 10"
17. MAXIMUM CRACKS TO BE 1/4" ON 10"
18. MAXIMUM CRACKS TO BE 1/4" ON 10"
19. MAXIMUM CRACKS TO BE 1/4" ON 10"
20. MAXIMUM CRACKS TO BE 1/4" ON 10"
21. MAXIMUM CRACKS TO BE 1/4" ON 10"
22. MAXIMUM CRACKS TO BE 1/4" ON 10"
23. MAXIMUM CRACKS TO BE 1/4" ON 10"
24. MAXIMUM CRACKS TO BE 1/4" ON 10"
25. MAXIMUM CRACKS TO BE 1/4" ON 10"
26. MAXIMUM CRACKS TO BE 1/4" ON 10"
27. MAXIMUM CRACKS TO BE 1/4" ON 10"
28. MAXIMUM CRACKS TO BE 1/4" ON 10"
29. MAXIMUM CRACKS TO BE 1/4" ON 10"
30. MAXIMUM CRACKS TO BE 1/4" ON 10"
31. MAXIMUM CRACKS TO BE 1/4" ON 10"
32. MAXIMUM CRACKS TO BE 1/4" ON 10"
33. MAXIMUM CRACKS TO BE 1/4" ON 10"
34. MAXIMUM CRACKS TO BE 1/4" ON 10"
35. MAXIMUM CRACKS TO BE 1/4" ON 10"
36. MAXIMUM CRACKS TO BE 1/4" ON 10"
37. MAXIMUM CRACKS TO BE 1/4" ON 10"
38. MAXIMUM CRACKS TO BE 1/4" ON 10"
39. MAXIMUM CRACKS TO BE 1/4" ON 10"
40. MAXIMUM CRACKS TO BE 1/4" ON 10"
41. MAXIMUM CRACKS TO BE 1/4" ON 10"
42. MAXIMUM CRACKS TO BE 1/4" ON 10"
43. MAXIMUM CRACKS TO BE 1/4" ON 10"
44. MAXIMUM CRACKS TO BE 1/4" ON 10"
45. MAXIMUM CRACKS TO BE 1/4" ON 10"
46. MAXIMUM CRACKS TO BE 1/4" ON 10"
47. MAXIMUM CRACKS TO BE 1/4" ON 10"
48. MAXIMUM CRACKS TO BE 1/4" ON 10"
49. MAXIMUM CRACKS TO BE 1/4" ON 10"
50. MAXIMUM CRACKS TO BE 1/4" ON 10"
51. MAXIMUM CRACKS TO BE 1/4" ON 10"
52. MAXIMUM CRACKS TO BE 1/4" ON 10"
53. MAXIMUM CRACKS TO BE 1/4" ON 10"
54. MAXIMUM CRACKS TO BE 1/4" ON 10"
55. MAXIMUM CRACKS TO BE 1/4" ON 10"
56. MAXIMUM CRACKS TO BE 1/4" ON 10"
57. MAXIMUM CRACKS TO BE 1/4" ON 10"
58. MAXIMUM CRACKS TO BE 1/4" ON 10"
59. MAXIMUM CRACKS TO BE 1/4" ON 10"
60. MAXIMUM CRACKS TO BE 1/4" ON 10"
61. MAXIMUM CRACKS TO BE 1/4" ON 10"
62. MAXIMUM CRACKS TO BE 1/4" ON 10"
63. MAXIMUM CRACKS TO BE 1/4" ON 10"
64. MAXIMUM CRACKS TO BE 1/4" ON 10"
65. MAXIMUM CRACKS TO BE 1/4" ON 10"
66. MAXIMUM CRACKS TO BE 1/4" ON 10"
67. MAXIMUM CRACKS TO BE 1/4" ON 10"
68. MAXIMUM CRACKS TO BE 1/4" ON 10"
69. MAXIMUM CRACKS TO BE 1/4" ON 10"
70. MAXIMUM CRACKS TO BE 1/4" ON 10"
71. MAXIMUM CRACKS TO BE 1/4" ON 10"
72. MAXIMUM CRACKS TO BE 1/4" ON 10"
73. MAXIMUM CRACKS TO BE 1/4" ON 10"
74. MAXIMUM CRACKS TO BE 1/4" ON 10"
75. MAXIMUM CRACKS TO BE 1/4" ON 10"
76. MAXIMUM CRACKS TO BE 1/4" ON 10"
77. MAXIMUM CRACKS TO BE 1/4" ON 10"
78. MAXIMUM CRACKS TO BE 1/4" ON 10"
79. MAXIMUM CRACKS TO BE 1/4" ON 10"
80. MAXIMUM CRACKS TO BE 1/4" ON 10"
81. MAXIMUM CRACKS TO BE 1/4" ON 10"
82. MAXIMUM CRACKS TO BE 1/4" ON 10"
83. MAXIMUM CRACKS TO BE 1/4" ON 10"
84. MAXIMUM CRACKS TO BE 1/4" ON 10"
85. MAXIMUM CRACKS TO BE 1/4" ON 10"
86. MAXIMUM CRACKS TO BE 1/4" ON 10"
87. MAXIMUM CRACKS TO BE 1/4" ON 10"
88. MAXIMUM CRACKS TO BE 1/4" ON 10"
89. MAXIMUM CRACKS TO BE 1/4" ON 10"
90. MAXIMUM CRACKS TO BE 1/4" ON 10"
91. MAXIMUM CRACKS TO BE 1/4" ON 10"
92. MAXIMUM CRACKS TO BE 1/4" ON 10"
93. MAXIMUM CRACKS TO BE 1/4" ON 10"
94. MAXIMUM CRACKS TO BE 1/4" ON 10"
95. MAXIMUM CRACKS TO BE 1/4" ON 10"
96. MAXIMUM CRACKS TO BE 1/4" ON 10"
97. MAXIMUM CRACKS TO BE 1/4" ON 10"
98. MAXIMUM CRACKS TO BE 1/4" ON 10"
99. MAXIMUM CRACKS TO BE 1/4" ON 10"
100. MAXIMUM CRACKS TO BE 1/4" ON 10"

CONSTRUCTION COMPLETE:

DATE:

ANY CONSTRUCTION FIELD CHANGES
ARE SHOWN IN RED ON THIS PRINT.

AUTOMATED DRAWING - MAKE NO MANUAL REVISIONS
 ALABAMA POWER COMPANY
 JOB POWER DELIVERY - BIRMINGHAM SOUTH
 DETAIL BULLY RACE - CLENGERRY
 PHASE 2
 SCALE 1" = 100' PLOTTED 03-21-07
 SHEET 1 OF 2 SHEETS
 SUPERVISOR C-61700-08-00487


0	200	PLAN SCALE
TOWN: PELHAM	COUNTY: SHELBY	
MAP REF: 2W-20-28-4	SEC: 28 1P-20S, R-2W	
DRAWN: SLH	ENGR: G. BELCHER	DATE: 05/18/07
APPROVED	DATE	
APPROVED	DATE	

ENGINEER: GEOFF BELCHER
RADIO #11066



20071114000522090 3/4 \$20.50
Shelby Cnty Judge of Probate,AL
11/14/2007 10:45:44AM FILED/CERT

SECTIONALIZING SKETCH

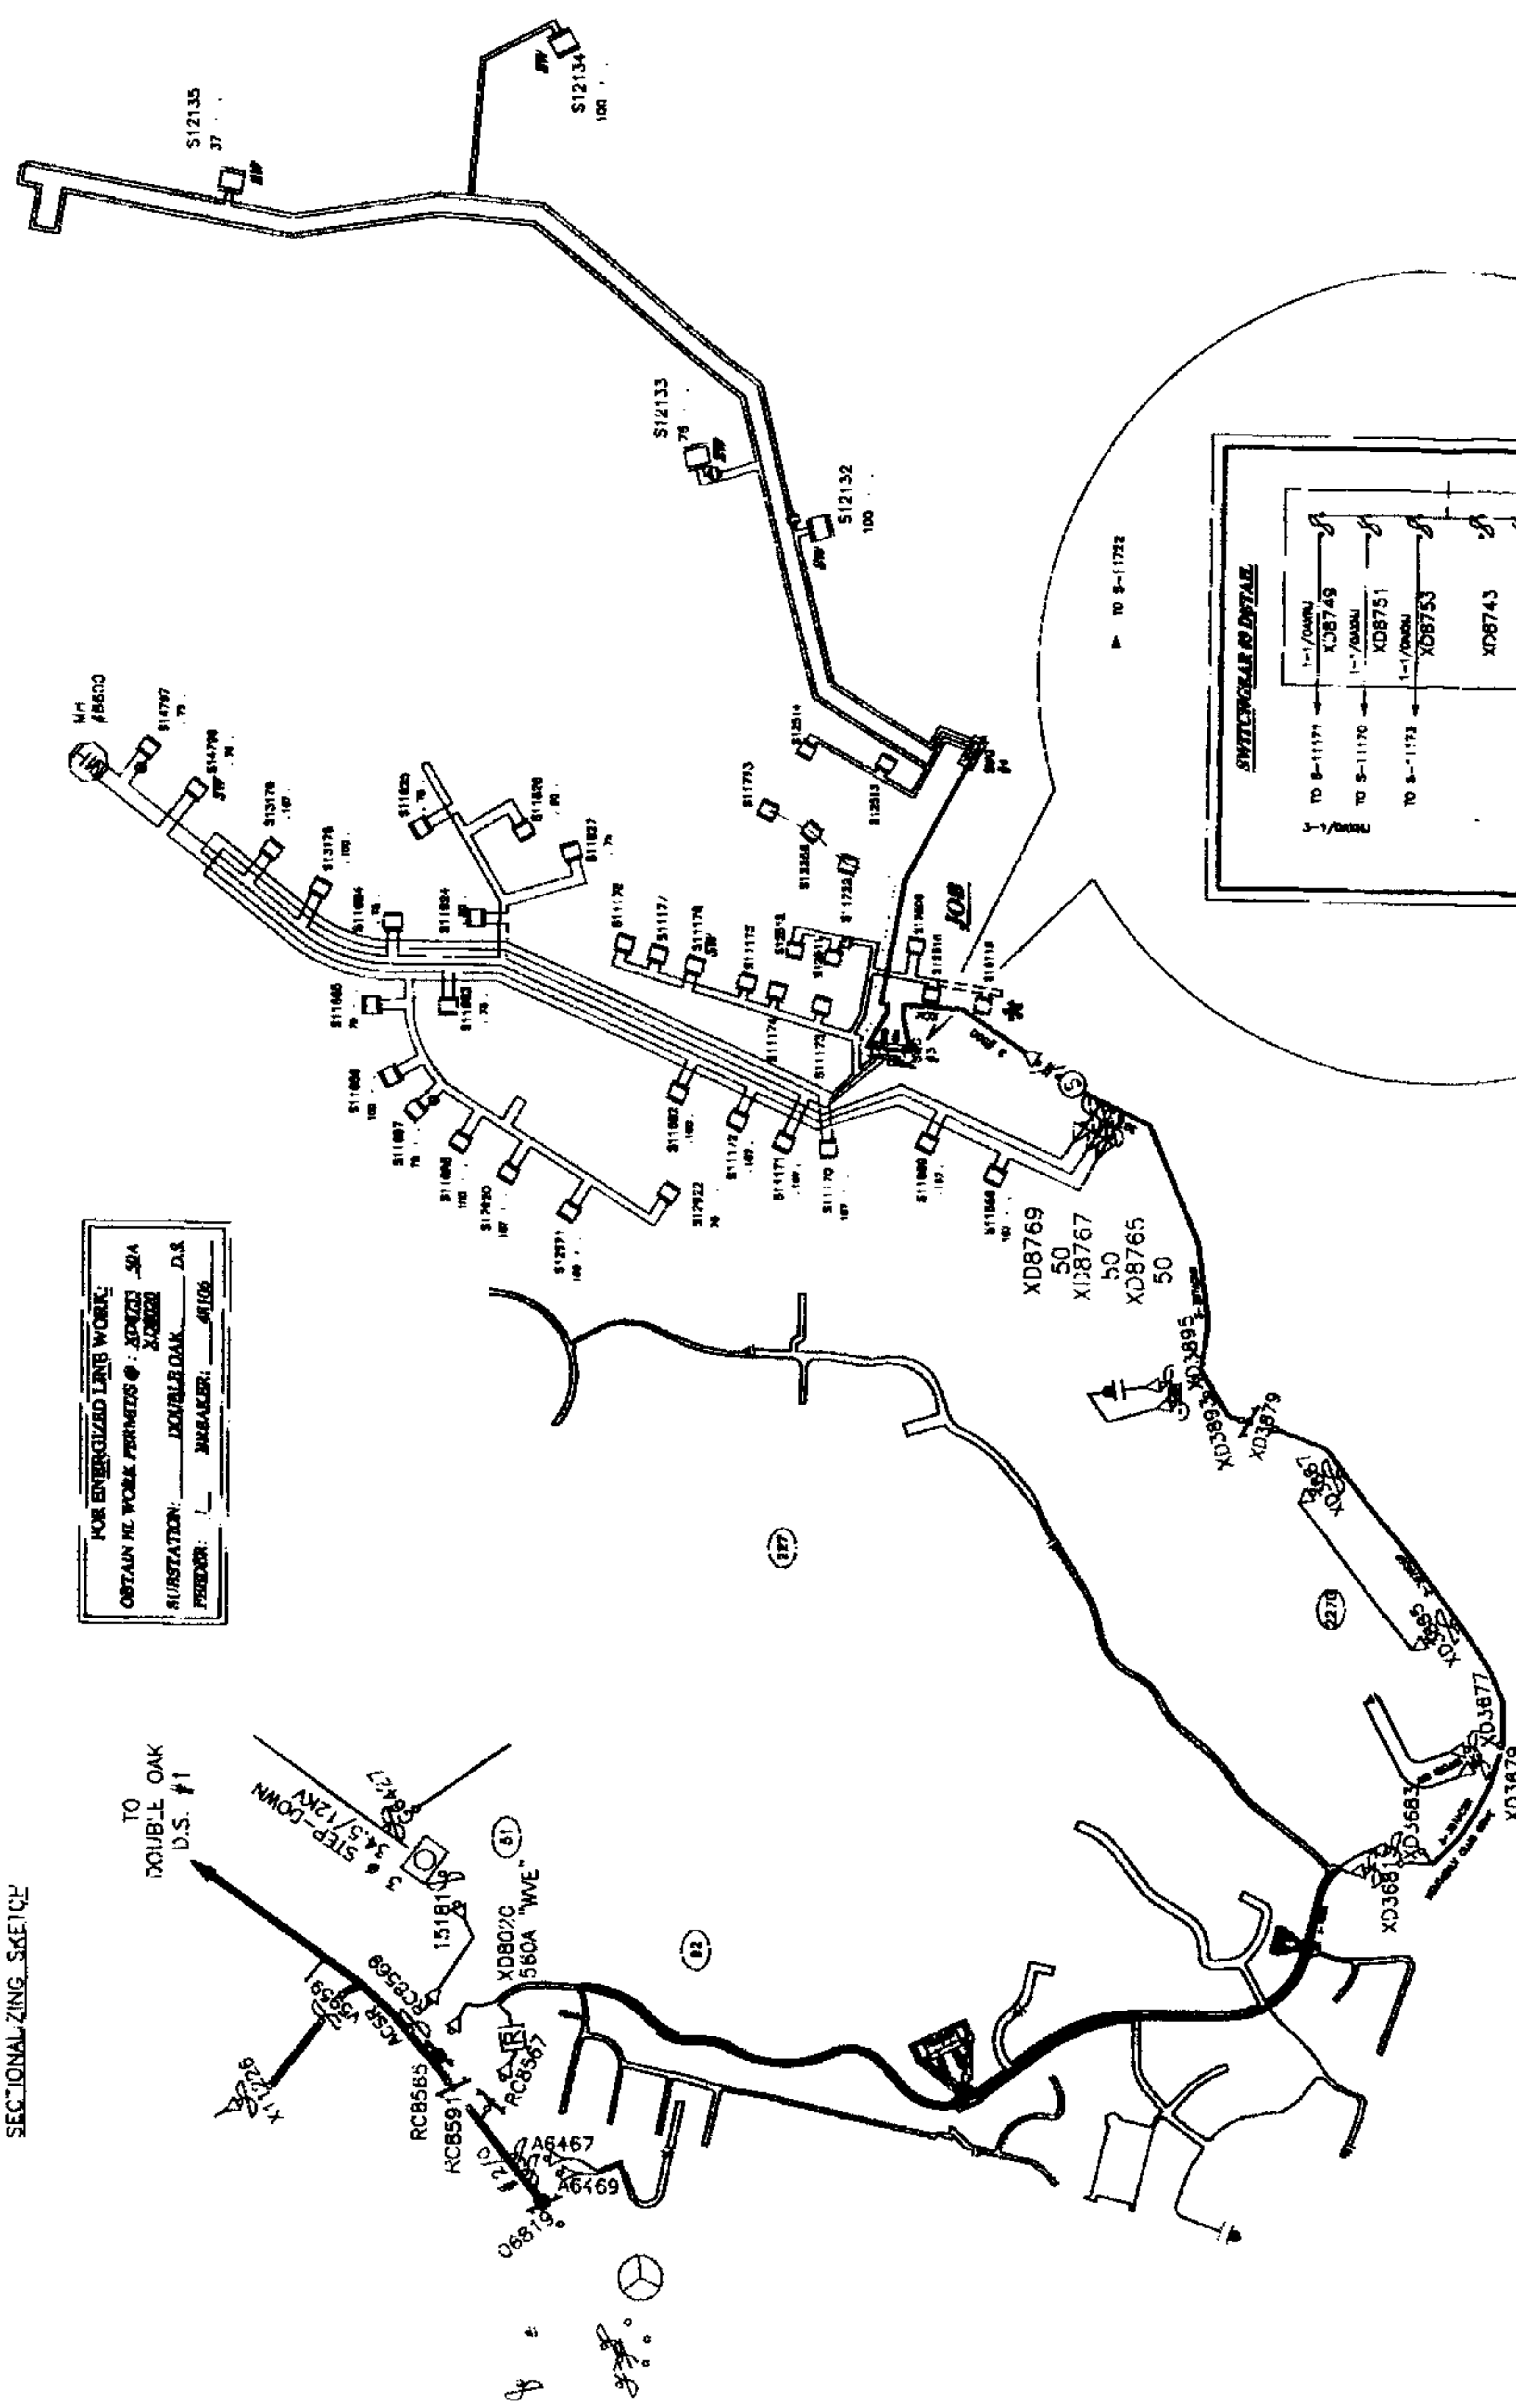


SECTIONALIZING SKETCH

FOR ENERGIZED LINE WORK:

OBTAIN HL WORK PERMITS @ : ADCO SA
2-10000

SUBSTATION: POWELL DAK D.S.

FEEDER: 1 WREACKER: 44106

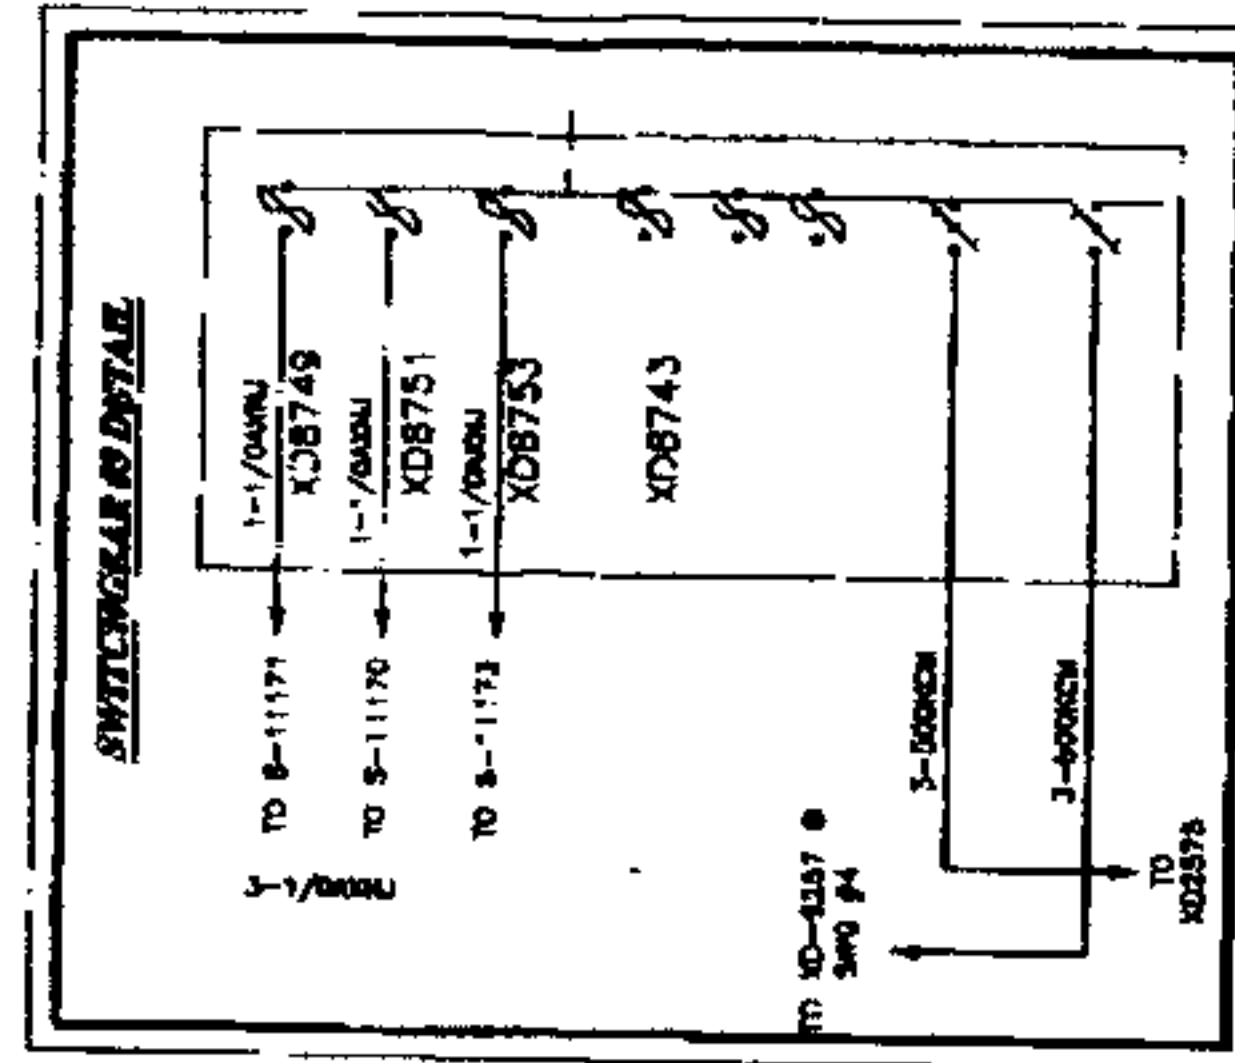

ENGINEER: GEOFF BELCHER
RADIO #11866

CONSTRUCTION COMPLETE:

DATE:

ANY CONSTRUCTION FIELD CHANGES
ARE SHOWN IN RED ON THIS PRINT.

0 100 200
FEET

AUTOMATED DRAWING - MAKE NO MANUAL REVISIONS
ALABAMA POWER COMPANY

JOE POWER DELIVERY - BIRMINGHAM SOUTH
DETAIL BALLANTRAE - GLENGERRY

SCALE 1" = 100' PLOTTED 05-21-07

SHEET 2 OF 2 SILENTS
C-61700-08-00467
SLIPENBES

SWGR/ISIR	SWITCH #	1st XPMR OFF SWGR/ISIR	EXISTING	PROPOSED	TOTAL	EMERGENCY
SWG #3	XD-8753	S-12510	15.7	4.0	19.7	45
RISIR	XD-8769	S-11175	25.3	---	25.3	45

20071114000522090 4/4 \$20.50
Shelby Cnty Judge of Probate, AL
11/14/2007 10:45:44AM FILED/CERT