


W.E. No. A6170-08-AV19
Parcel No. 72250875-001

In the W ½ of the NW ¼ of Section 21,
Township 20 South, Range 3 West,
Shelby County, Alabama

STATE OF ALABAMA
COUNTY OF SHELBY

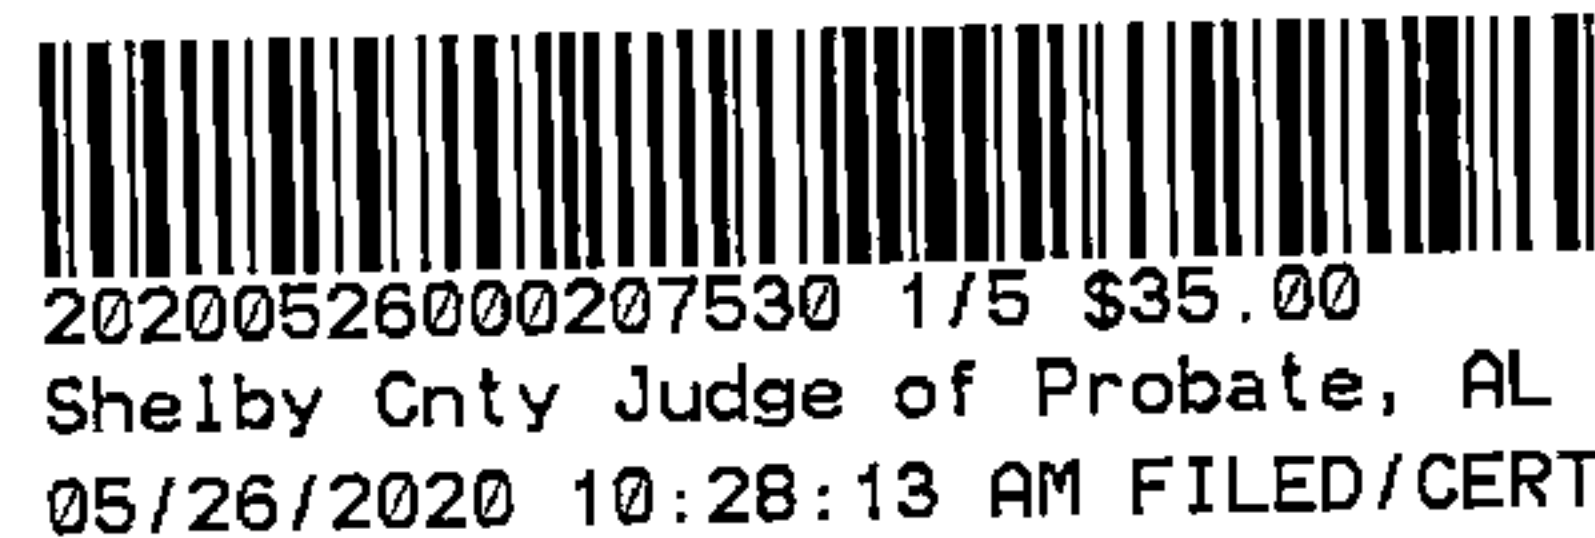

THIS SUPPLEMENTAL AGREEMENT made this 24th day of January, 2020, between Alabama Power Company, an Alabama corporation, hereinafter called the Power Company and Southern Natural Gas Company, L.L.C., a Delaware limited liability company, hereinafter called the Gas Company;


WITNESSETH:

WHEREAS, there is in effect between the parties hereto, a certain agreement dated the 4th day of October, 1930, by which the Power Company has the right to construct, operate, and maintain electric power lines over, under, and across the rights of way and easements of the Gas Company; WHEREAS, the Power Company desires the right to construct, operate, and maintain a power line over, under, and across the rights of way of the Gas Company at the following location(s):


At a point near Lat 33° 17' 6.6012" N and Long -86° 51' 44.2722" W in the West Half of the Northwest Quarter of Section 21, Township 20 South, Range 3 West, Shelby County, Alabama, as shown on the Power Company's plan profile and work sketch drawings that are attached hereto and made a part hereof as Exhibits "A-1," "A-2" and "A-3," respectively.

NOW THEREFORE, in consideration of the premises and of their mutual covenants and agreements, the parties hereto have mutually covenanted and agreed as follows: The Gas Company hereby grants to the Power Company, insofar as the Gas Company has any right or title to make such grant, the right to construct, operate, and maintain the power line crossing as shown on the prints hereto attached and marked Exhibits "A-1," "A-2" and "A-3" but subject, however, to all the terms and conditions of the aforesaid agreement dated October 4, 1930, and the parties agree that all and singular provisions of said agreement shall apply to the transmission and distribution line crossing herein described, in the same manner and to the same extent as though such crossing had been included in the said agreement.

IN WITNESS WHEREOF, the parties hereto have caused this agreement to be executed the day and year first above written.

WITNESS: 

ALABAMA POWER COMPANY

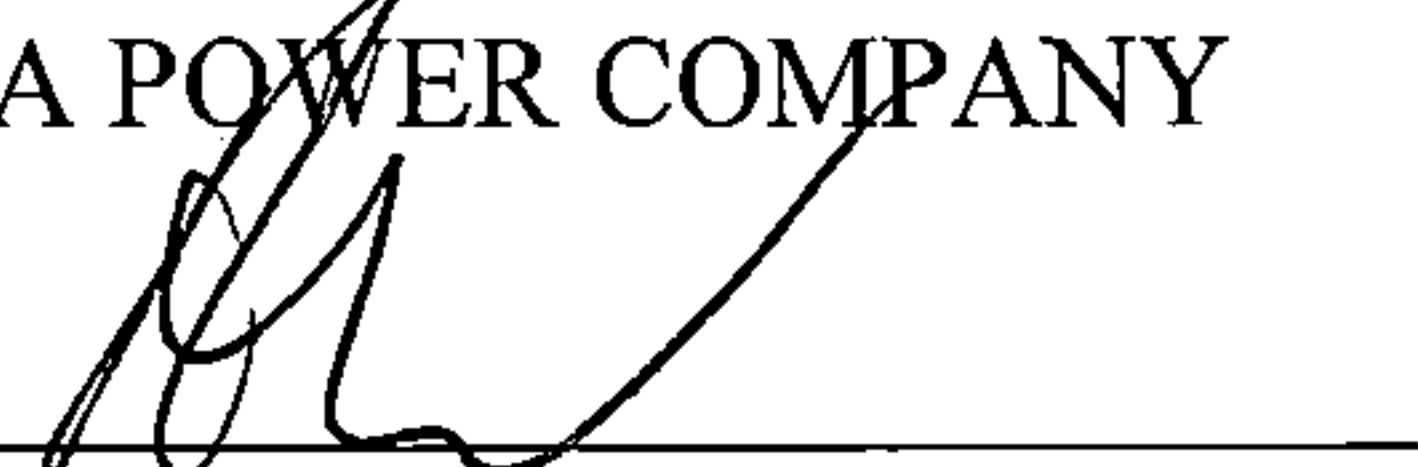By: 
Andy Wade

Its: Land Supervisor — Land Acquisition — Legal

SOUTHERN NATURAL GAS COMPANY, L.L.C.

WITNESS: 

By: 
Its: Daniel G. Gredvig, Attorney-in-Fact

STATE OF ALABAMA

COUNTY OF JEFFERSON


I, Kristen E. Stricklin, a Notary Public in and for said County and in said State, hereby certify that Andy Wade, whose named as Land Supervisor — Land Acquisition — Legal of Alabama Power Company, an Alabama corporation, is signed to the foregoing instrument, and who is known to me, acknowledged before me on this day that, being informed on the contents of the instrument, he, as such officer, and with full authority, executed the same voluntarily for and as the act of said corporation.

Given under my hand and official seal this the 24th day of January, 2020.

Kristen E. Stricklin
Notary Public State at Large

My commission expires: 10/13/2021

[seal]

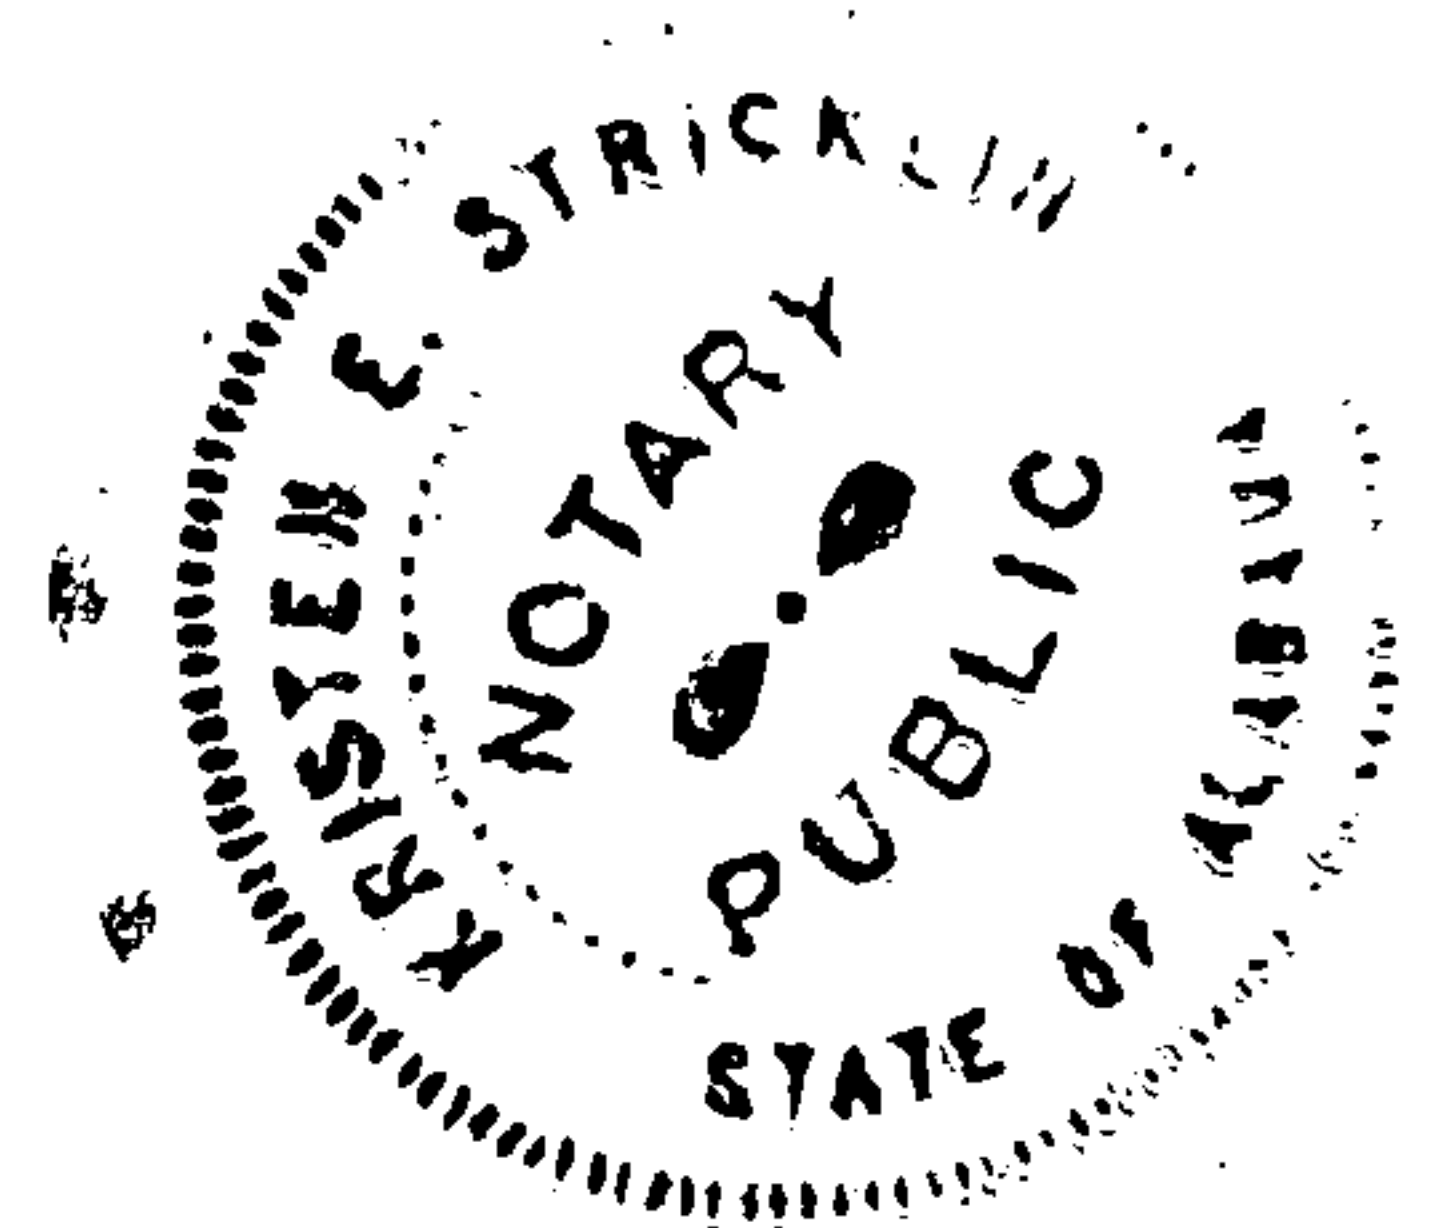

STATE OF Texas


COUNTY OF Harris

I, Shanetra V. Randle, a Notary Public in and for said County and in said State, hereby certify that Daniel G. Gredvig whose named as Attorney-in-Fact of Southern Natural Gas Company, L.L.C., a Delaware limited liability company, is signed to the foregoing instrument, and who is known to me, acknowledged before me on this day that, being informed on the contents of the instrument, he/she, as such officer and with full authority, executed the same voluntarily for and as the act of said limited liability company.

Given under my hand and official seal this the 15th day of January, 2020.


Shanetra V. Randle
Notary Public

My commission expires: 3-26-2021

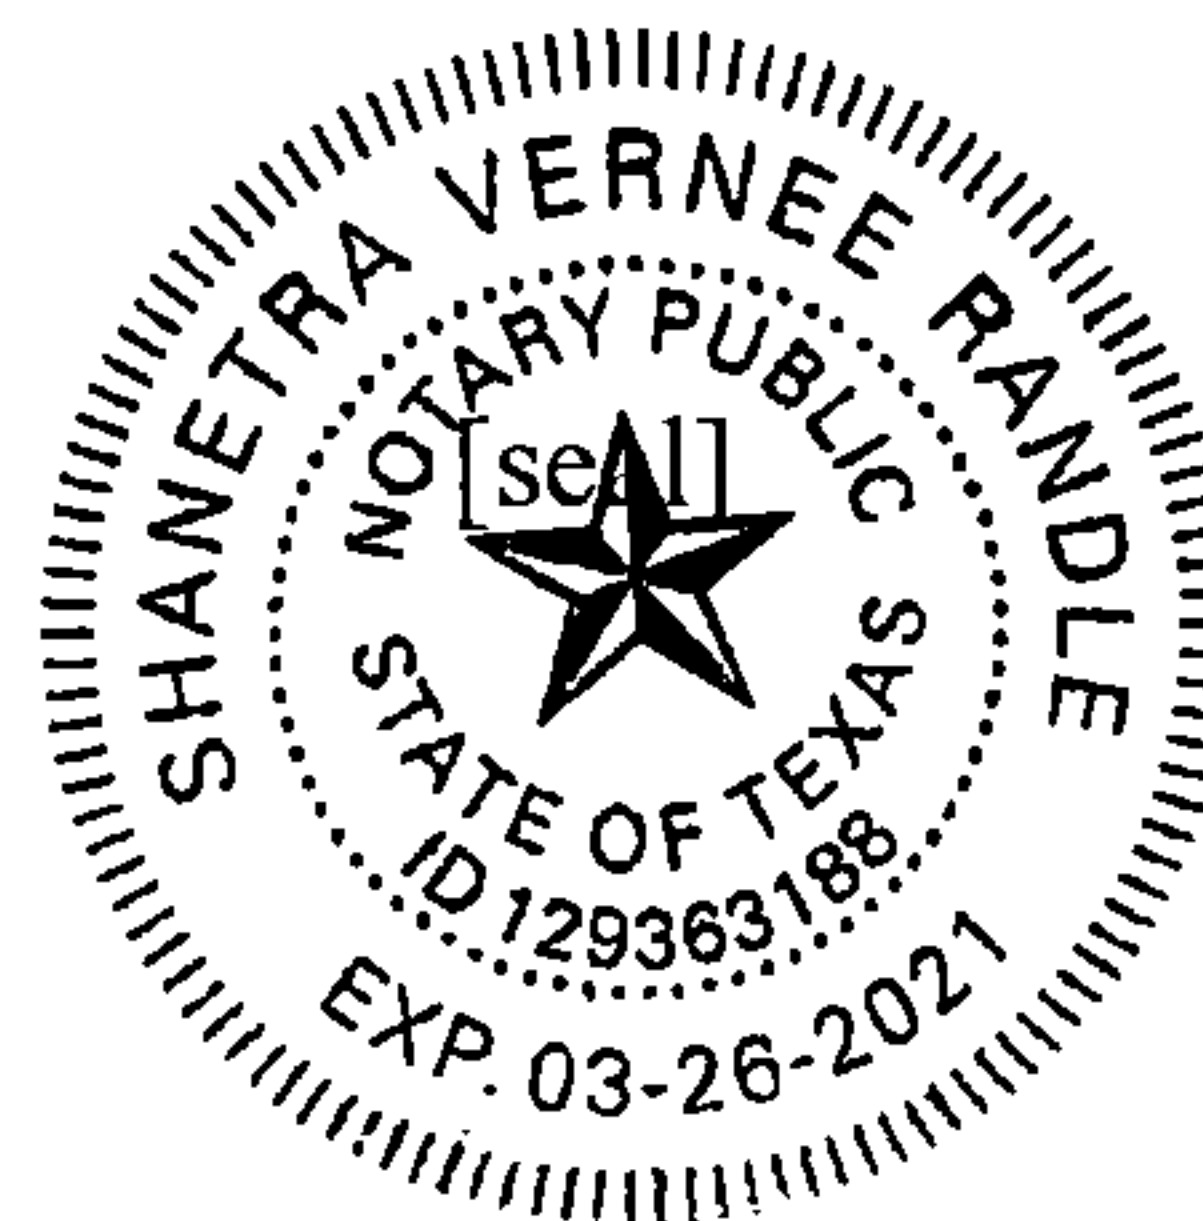

RETURN TO: Shanetra Randle
Kinder Morgan, Inc.
1001 Louisiana Street, Suite # 1475D
Houston, TX 77002


20200526000207530 2/5 \$35.00
Shelby Cnty Judge of Probate, AL
05/26/2020 10:28:13 AM FILED/CERT

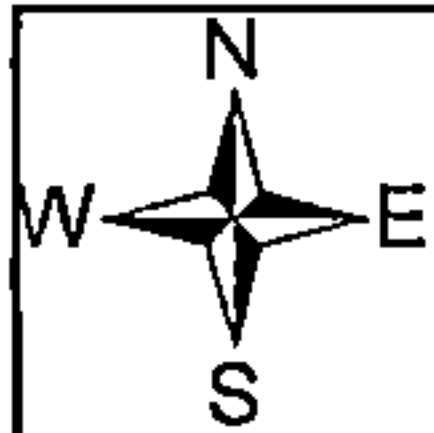

SHELBY COUNTY
T-20S, R-03W
SECTION 21

EXHIBIT A-1

APCo W.E. No. A6170-08-AV19
APCo Parcel No. 72250875-001

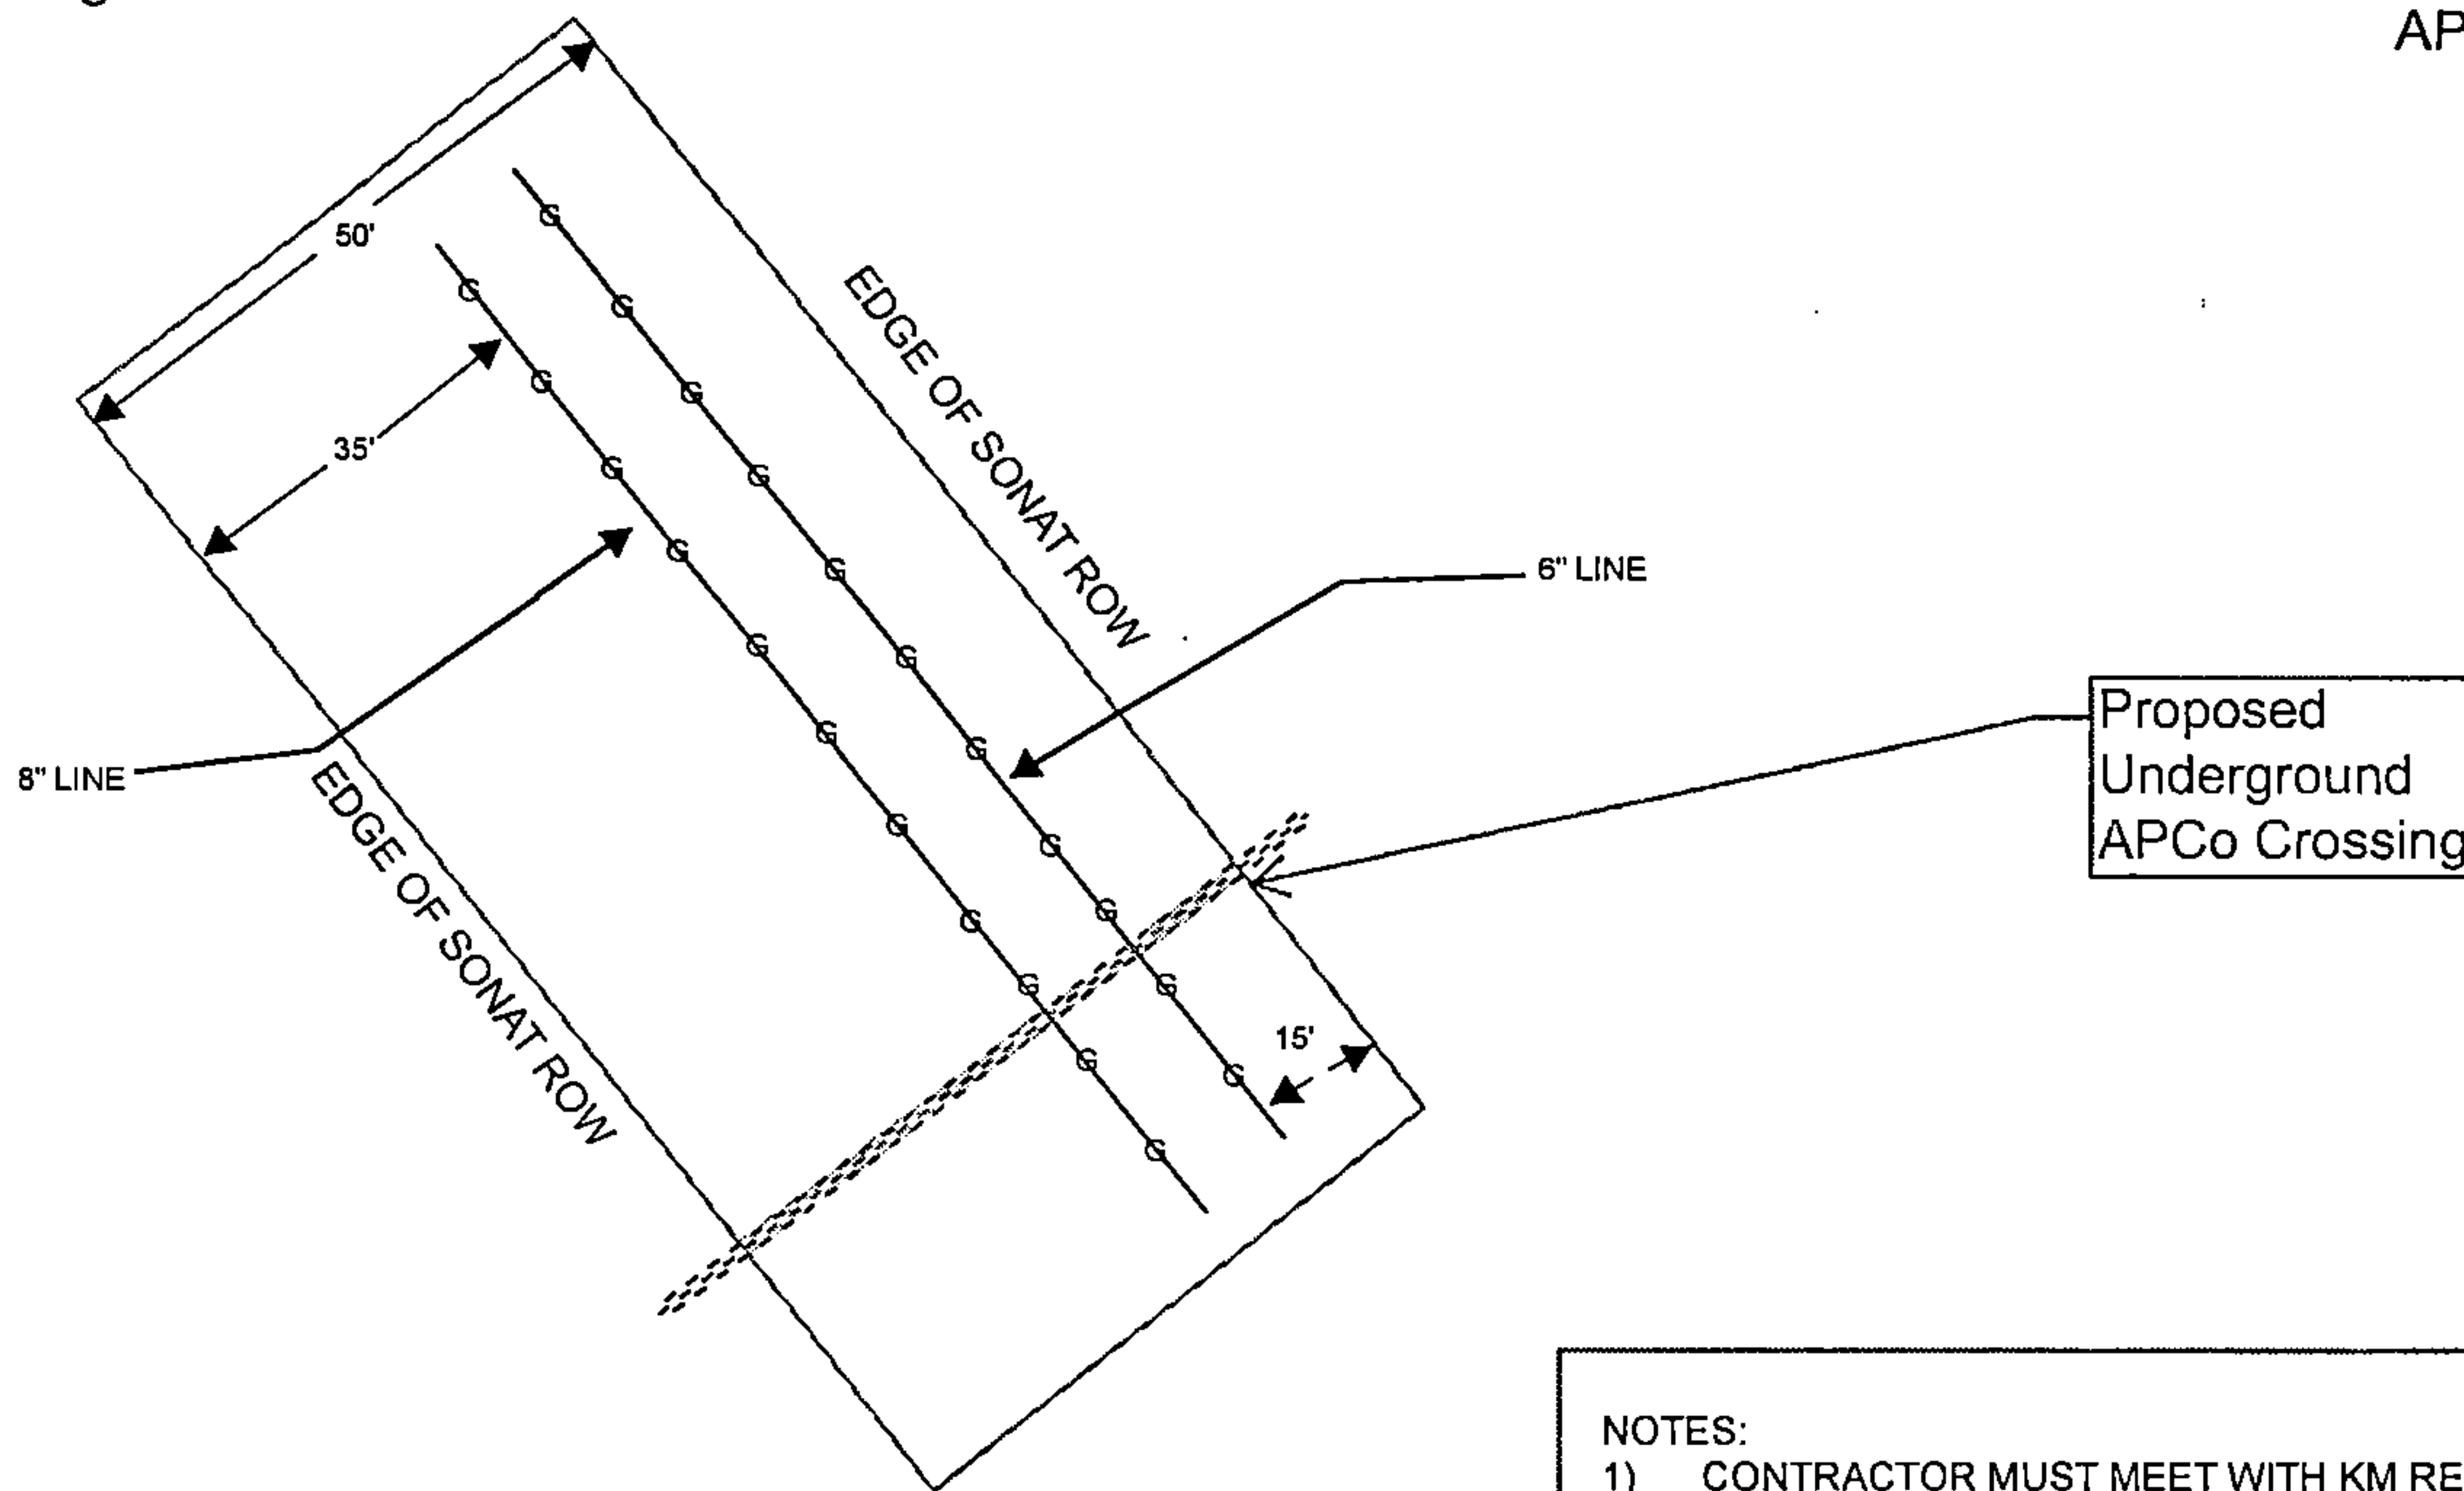

PLAN

LEGEND

—●—●—●— SONAT LINE
- - - - - APCO UG LINE
IN DUCT BANK

NOTES:

- 1) CONTRACTOR MUST MEET WITH KM REPRESENTATIVE PRIOR TO CONSTRUCTION AND RECEIVE NOTIFICATION LISTINGS FOR APPROPRIATE AREA OPERATIONS AND EMERGENCY PERSONNEL
- 2) THE CONTRACTOR MUST EXPOSE ALL KM TRANSMISSION AND DISTRIBUTION LINES PRIOR TO CROSSING TO DETERMINE THE EXACT ALIGNMENT AND DEPTH OF THE LINES. A KM REPRESENTATIVE MUST BE PRESENT.
- 3) KM WILL NOT ALLOW PIPELINES TO REMAIN EXPOSED OVERNIGHT WITHOUT CONSENT OF A DESIGNATED KM REPRESENTATIVE.
- 4) A KM REPRESENTATIVE WILL DO ALL LINE LOCATES.
- 5) HEAVY EQUIPMENT SHALL ONLY BE ALLOWED TO CROSS KM PIPELINES AT LOCATIONS DESIGNATED BY KM, INC. CONTRACTOR SHALL COMPLY WITH ALL PRECAUTIONARY MEASURES REQUIRED BY KM TO PROTECT PIPELINES.
- 6) CABLE DEPTH SHALL BE MEASURED FROM THE TOP OF CABLE, CABLE DEPTH SHALL NOT BE LESS THAN 24" BETWEEN PIPELINE AND ELECTRIC UTILITY
- 7) NOTIFICATION SHALL BE GIVEN TO KM AT LEAST 72 HOURS PRIOR TO THE START OF CONSTRUCTION

UserID
chrisjoh

Created
12/19/2019

WORK ORDER #
A6170-08-AV19


Distribution System
NTS

Alabama Power

Map Center
1752822 - 12075804





20200526000207530 3/5 \$35.00
Shelby Cnty Judge of Probate, AL
05/26/2020 10:28:13 AM FILED/CERT

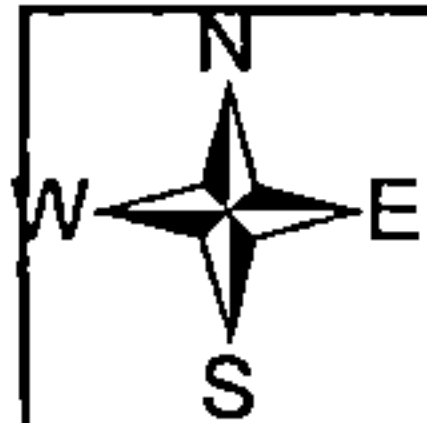

SHELBY COUNTY
T-20S, R-03W
SECTION 21

EXHIBIT A-2

APCo W.E. No. A6170-08-AV19
APCo Parcel No. 72250875-001

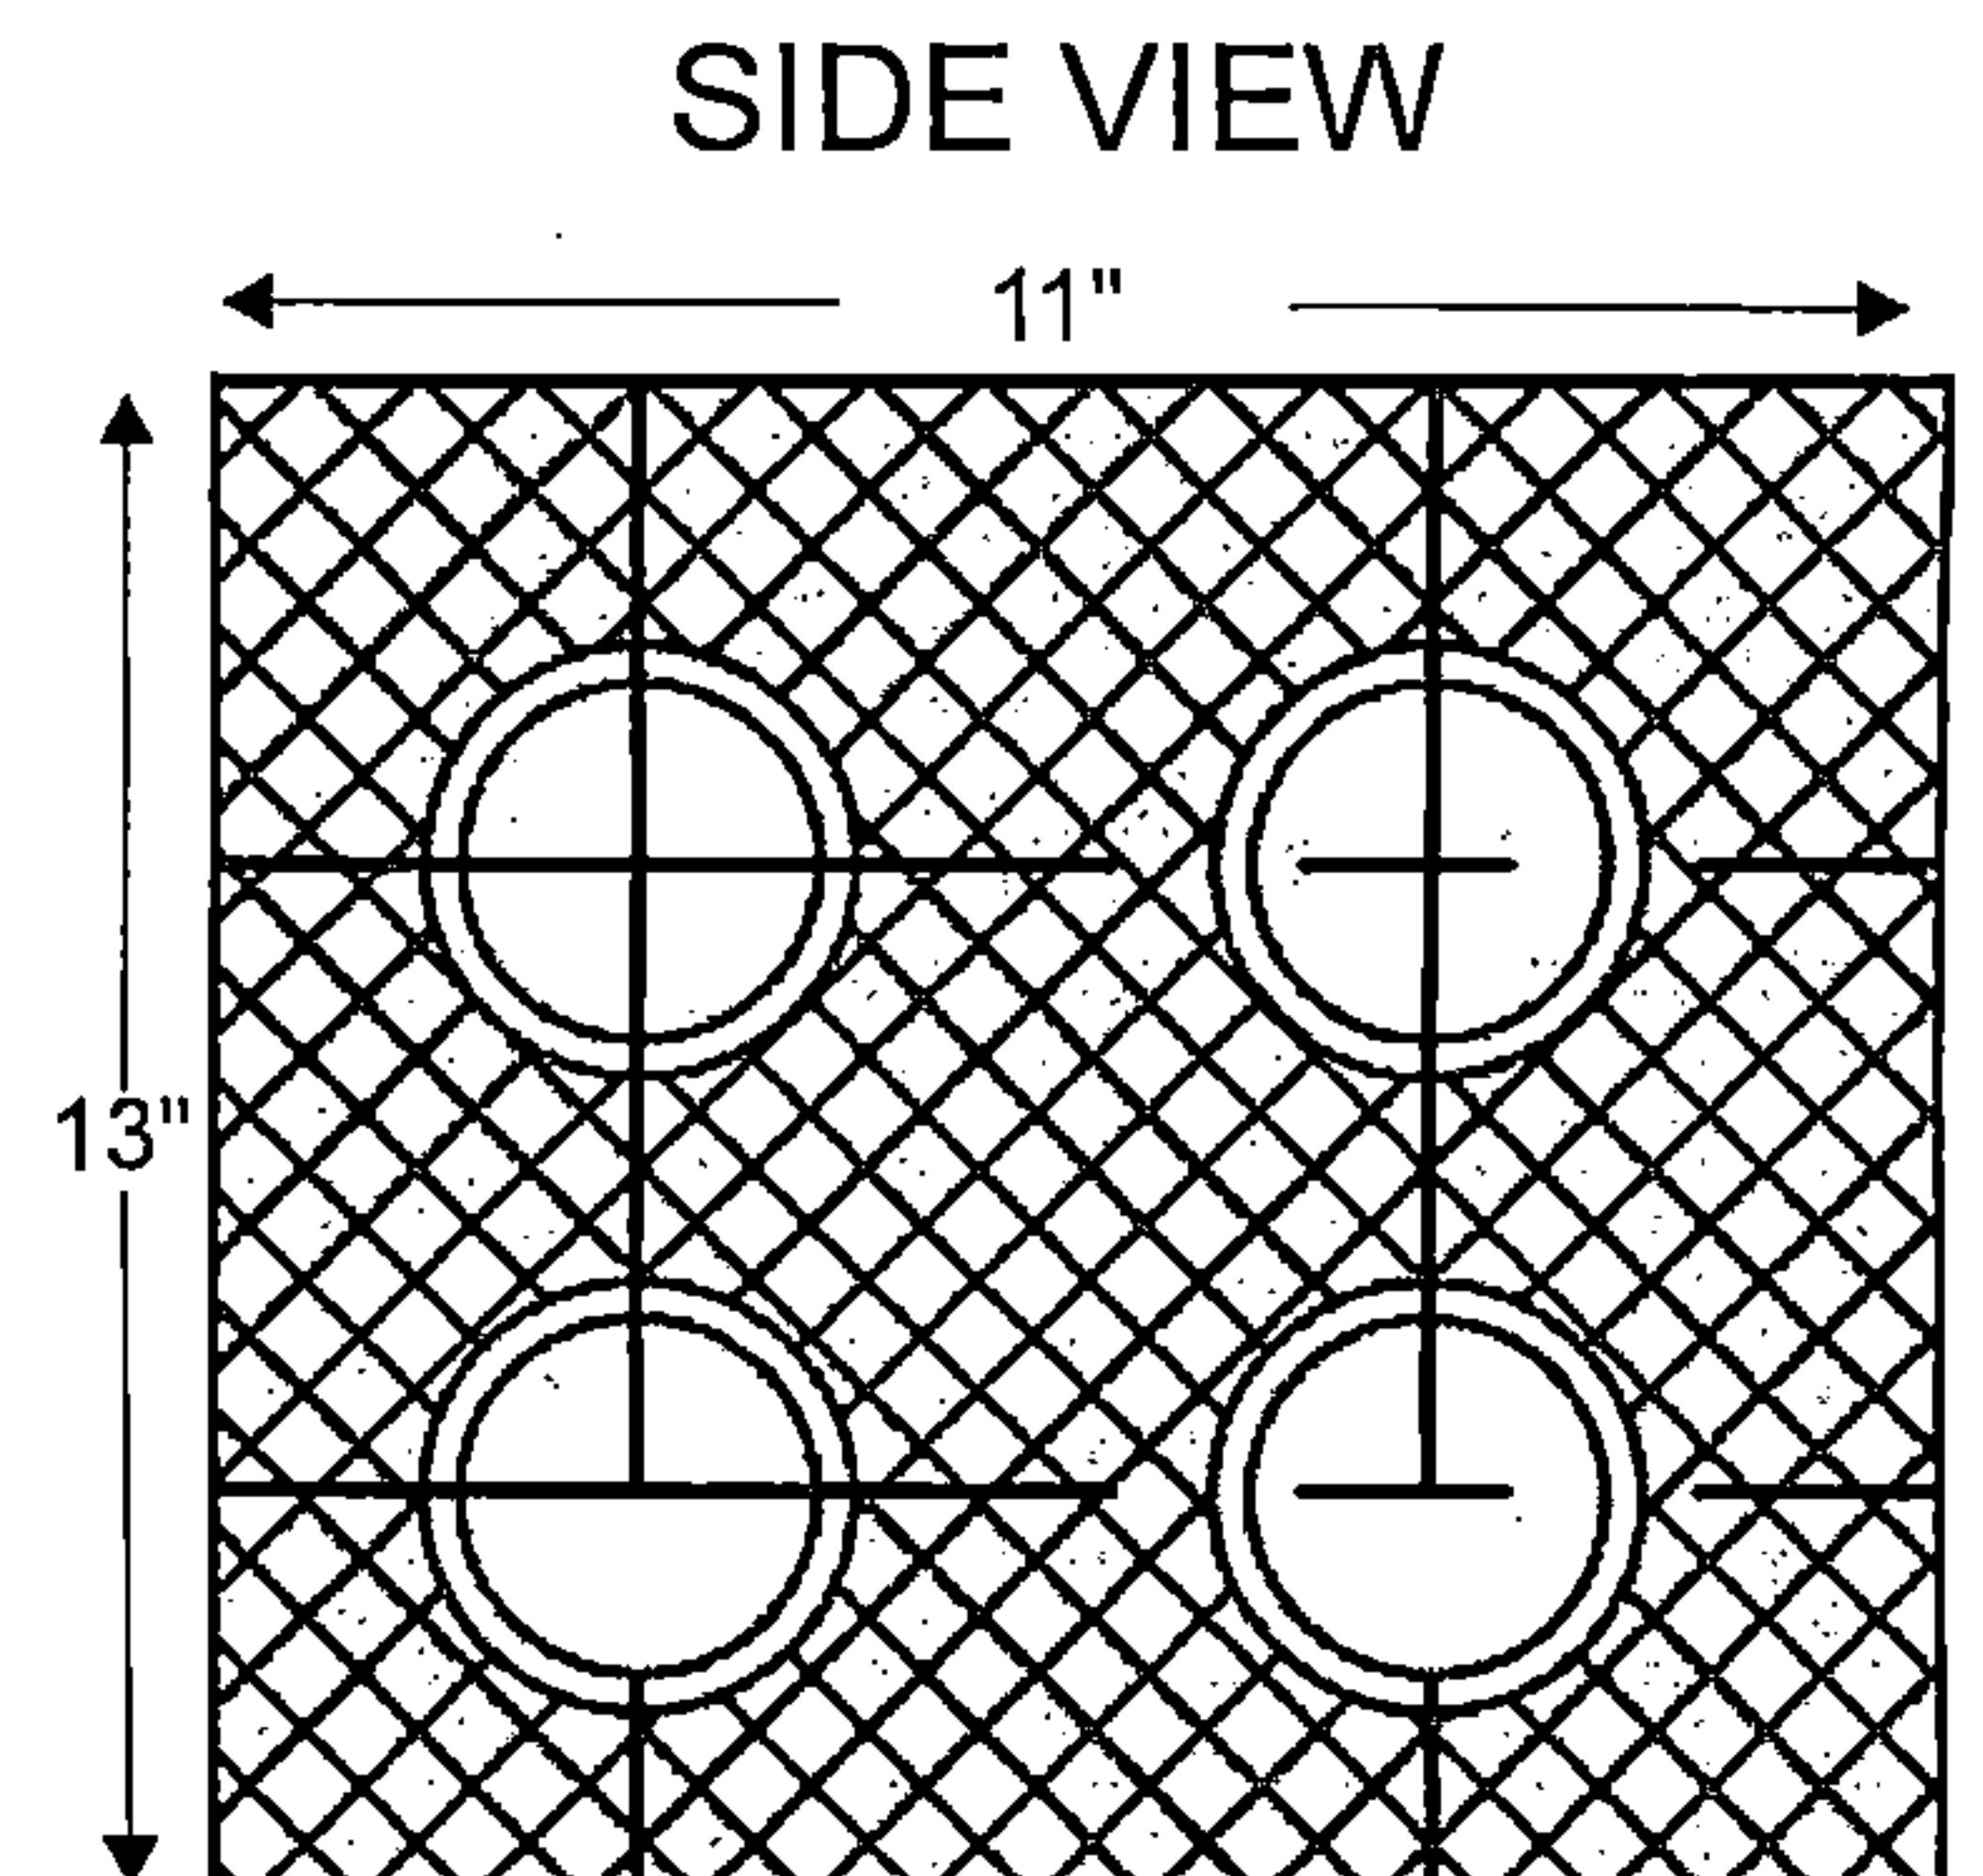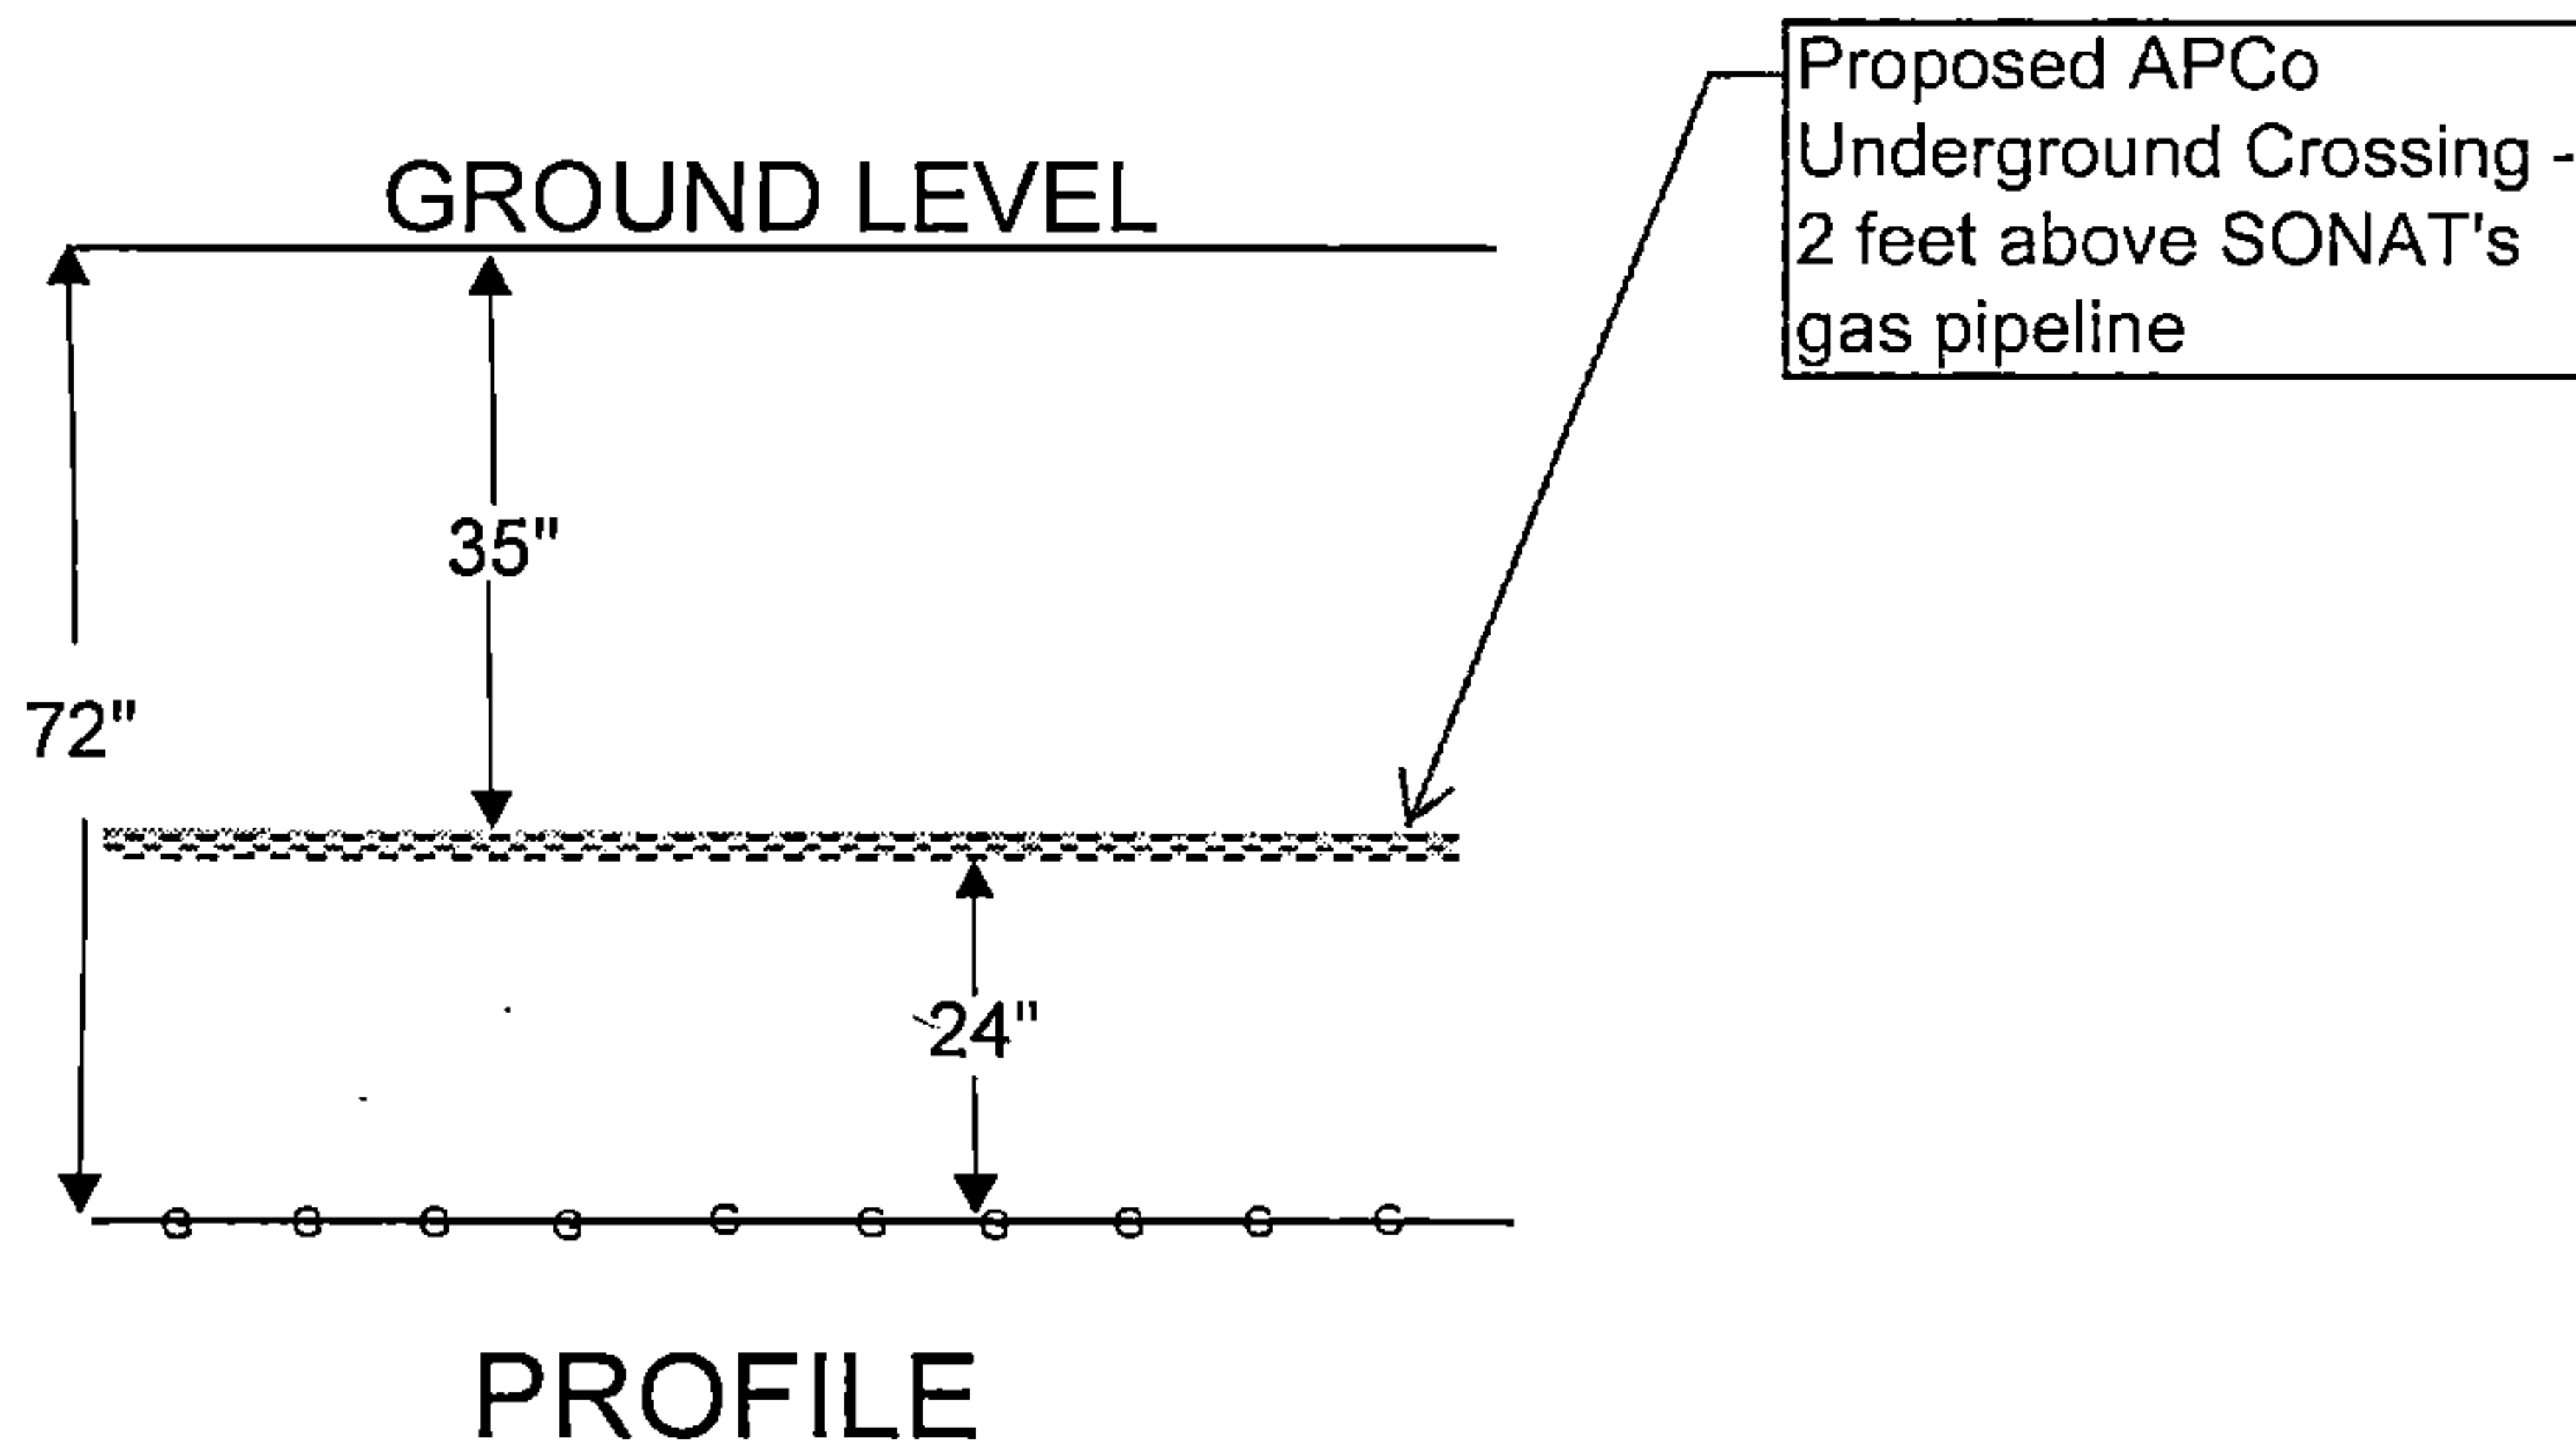

LEGEND

—●—●—●— SONAT LINE
- - - - - APCO UG LINE
IN DUCT BANK

NOTES:

- 1) CONTRACTOR MUST MEET WITH KM REPRESENTATIVE PRIOR TO CONSTRUCTION AND RECEIVE NOTIFICATION LISTINGS FOR APPROPRIATE AREA OPERATIONS AND EMERGENCY PERSONNEL
- 2) THE CONTRACTOR MUST EXPOSE ALL KM TRANSMISSION AND DISTRIBUTION LINES PRIOR TO CROSSING TO DETERMINE THE EXACT ALIGNMENT AND DEPTH OF THE LINES. A KM REPRESENTATIVE MUST BE PRESENT.
- 3) KM WILL NOT ALLOW PIPELINES TO REMAIN EXPOSED OVERNIGHT WITHOUT CONSENT OF A DESIGNATED KM REPRESENTATIVE.
- 4) A KM REPRESENTATIVE WILL DO ALL LINE LOCATES.
- 5) HEAVY EQUIPMENT SHALL ONLY BE ALLOWED TO CROSS KM PIPELINES AT LOCATIONS DESIGNATED BY KM, INC. CONTRACTOR SHALL COMPLY WITH ALL PRECAUTIONARY MEASURES REQUIRED BY KM TO PROTECT PIPELINES.
- 6) CABLE DEPTH SHALL BE MEASURED FROM THE TOP OF CABLE, CABLE DEPTH SHALL NOT BE LESS THAN 24" BETWEEN PIPELINE AND ELECTRIC UTILITY
- 7) NOTIFICATION SHALL BE GIVEN TO KM AT LEAST 72 HOURS PRIOR TO THE START OF CONSTRUCTION

UserID
chrisjoh

Created
12/19/2019

WORK ORDER #
A6170-08-AV19

Distribution System
NTS

Alabama Power

Map Center
1752822 - 12075804




20200526000207530 4/5 \$35.00

Shelby Cnty Judge of Probate, AL

05/26/2020 10:28:13 AM FILED/CERT

EXHIBIT A-3

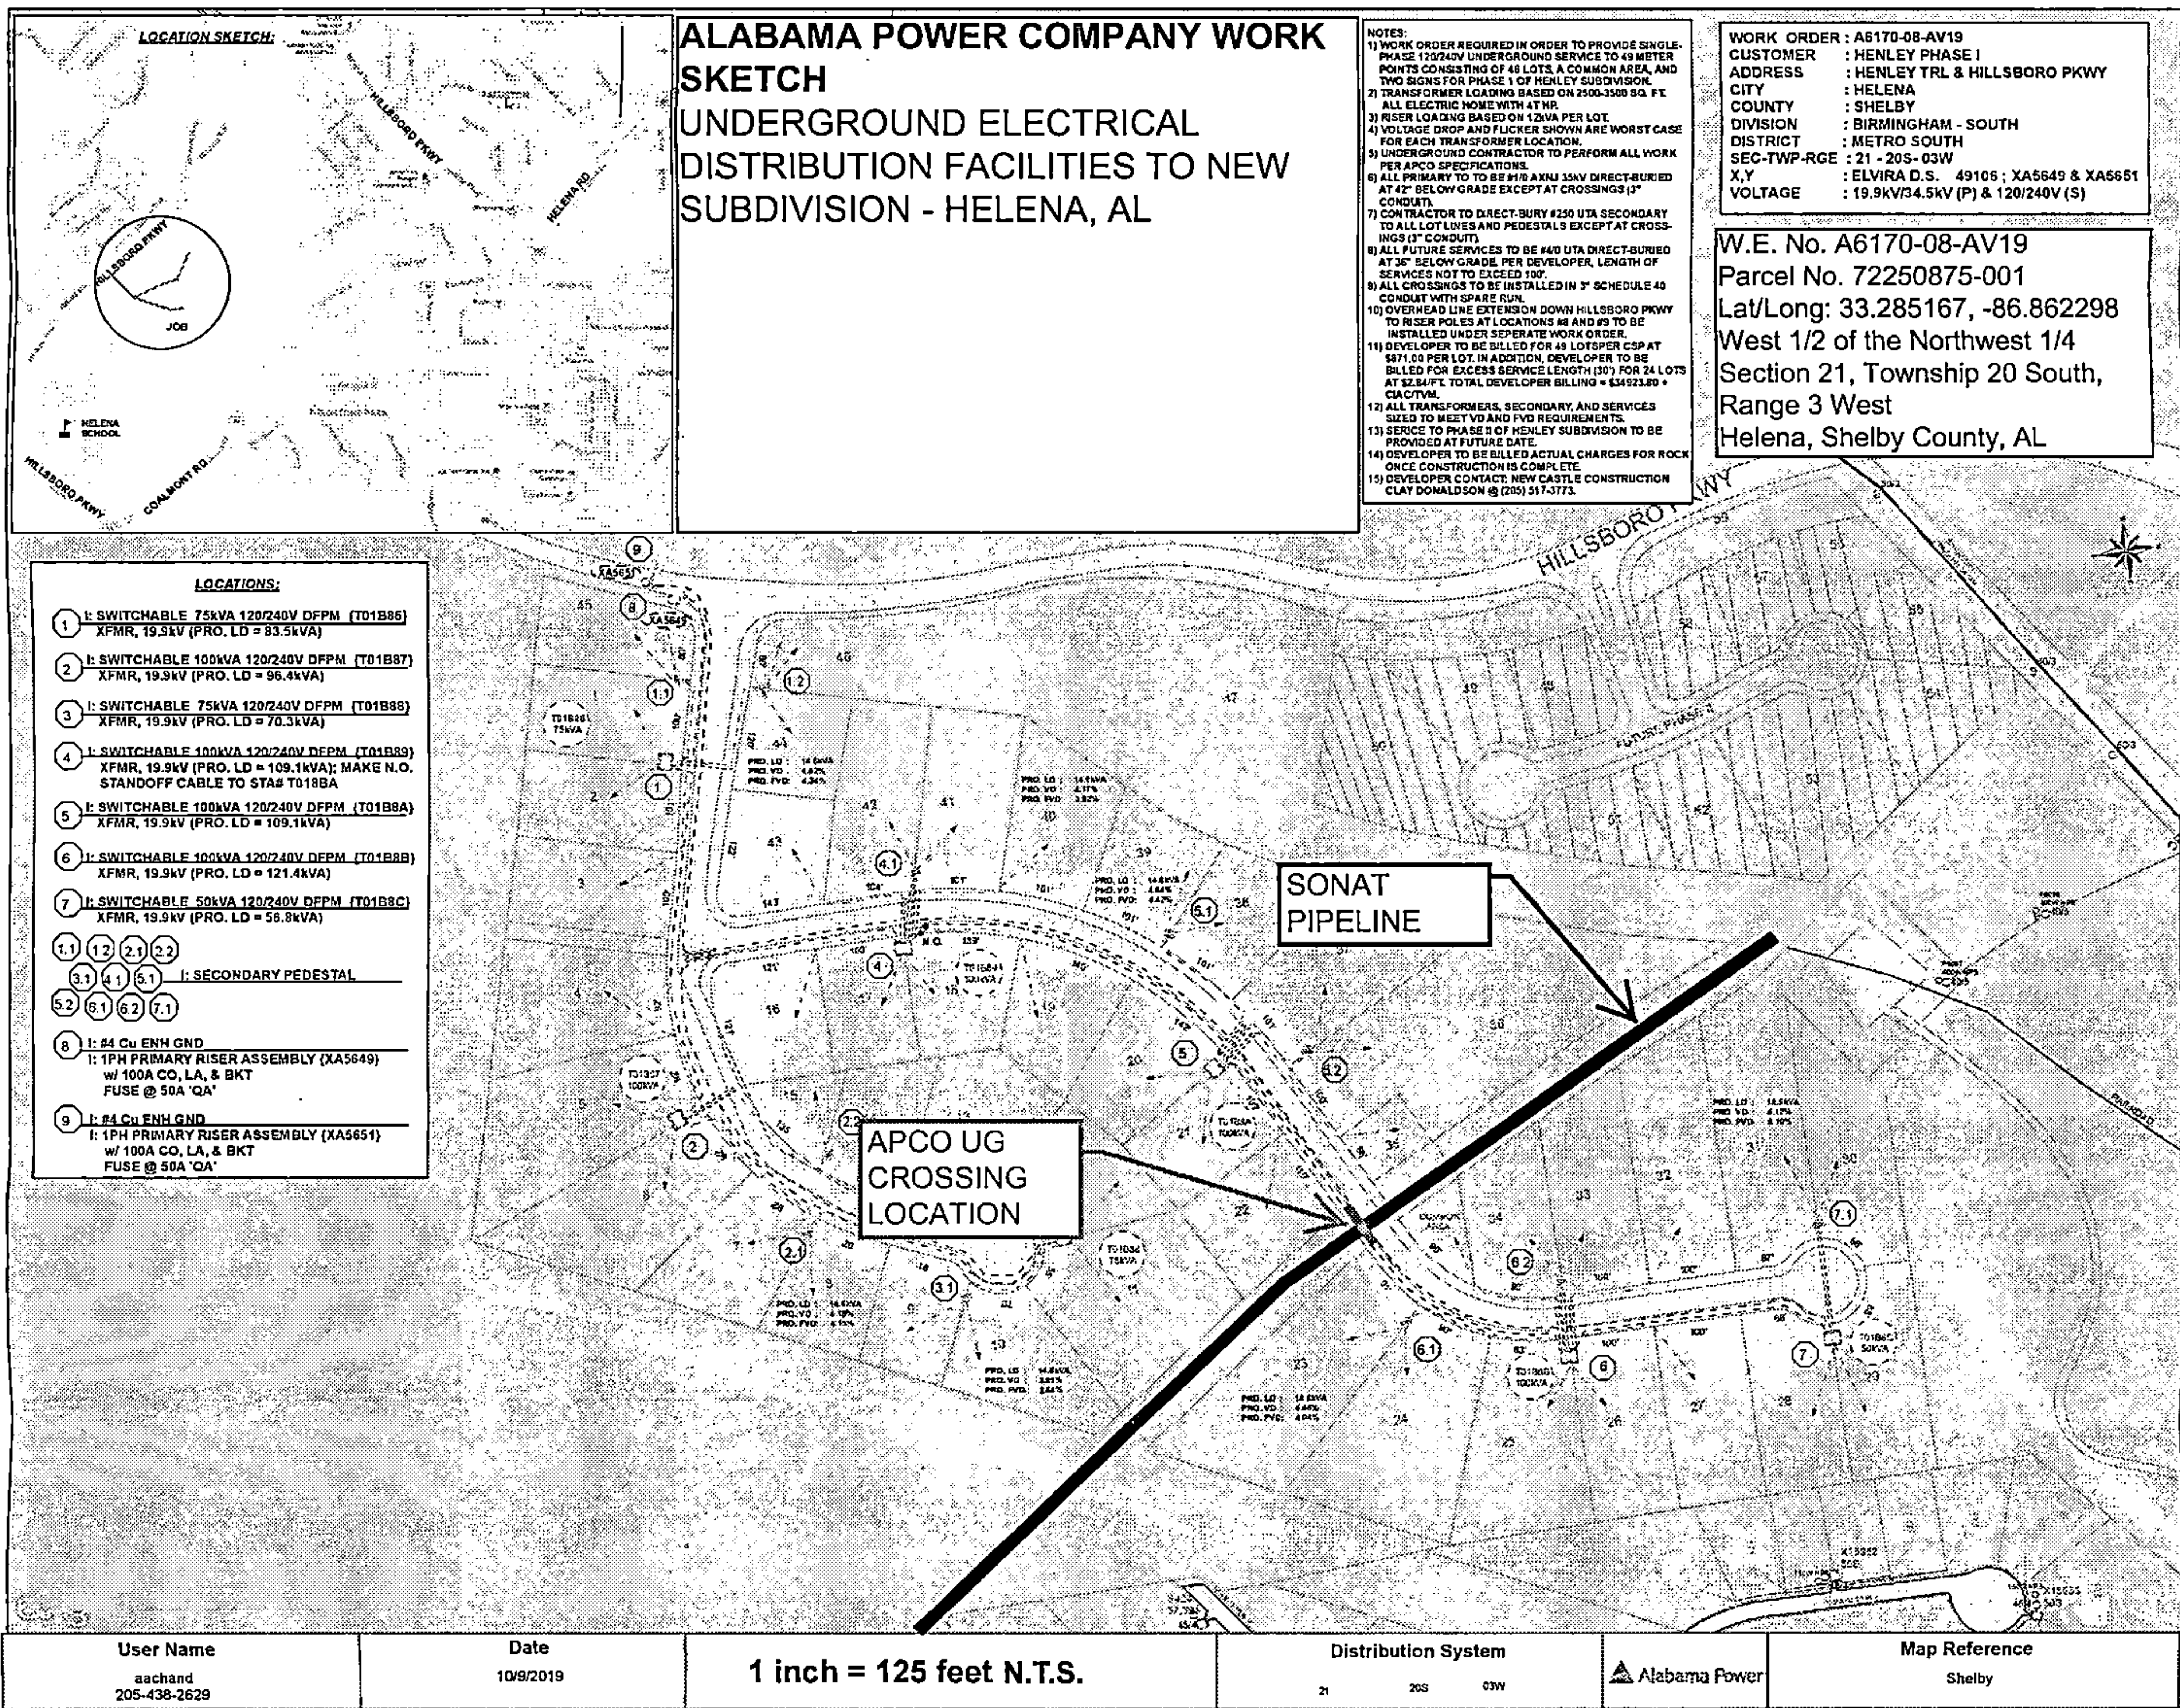

20200526000207530 5/5 \$35.00
Shelby Cnty Judge of Probate, AL
05/26/2020 10:28:13 AM FILED/CERT